AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTE1406
B	DESIGN: N/A
	DR'N: TV
	CH'D: MA/MB
	DATE: 13.11.25
A.E.M.	S.P.
STOCK CODES UPDATED	

NOTES

1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.
2. MAXIMUM SPAN LENGTH VARIES WITH CONDUCTOR TYPE/TENSION & ULTIMATE MECHANICAL LOADING ON POST INSULATORS.

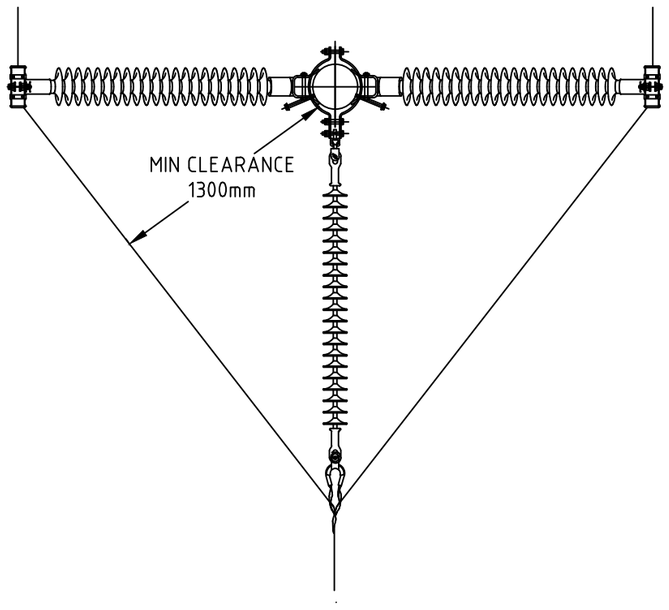

ITEM	PART/ASSEMBLY NUMBER	DRG Nos.	DESCRIPTION	QTY
1	-	295702	POLE PRESTRESED CONCRETE	1
2	1000006147	370399	STEP,POLE,HEX,M16x180MM(L),50MM(T),+NUTS	A/R
3	ALR001	398038	INSULATOR LONG ROD ASSEMBLY	3
4	ALP001	398035	INSULATOR LINE POST ASSEMBLY	3
5	-	048761	POLE BAND 125kN (DIAMETER TO SUIT)	3
6	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
7a	AEC-A	051125	EARTH CONNECTION AEC-A	1
7b	AEC-B	051125	EARTH CONNECTION AEC-B	3
7c	AEC-C	051125	EARTH CONNECTION AEC-C	3
7e	AEC-E	051125	EARTH CONNECTION AEC-E	1
7d	AEC-D	051125	EARTH CONNECTION AEC-D	3
8a	ACP001	240600	M20 BOLT ASSEMBLY FOR LINE POST INSULATOR	3
8b	ACP002	240600	M20 BOLT ASSEMBLY FOR LINE POST INSULATOR	3

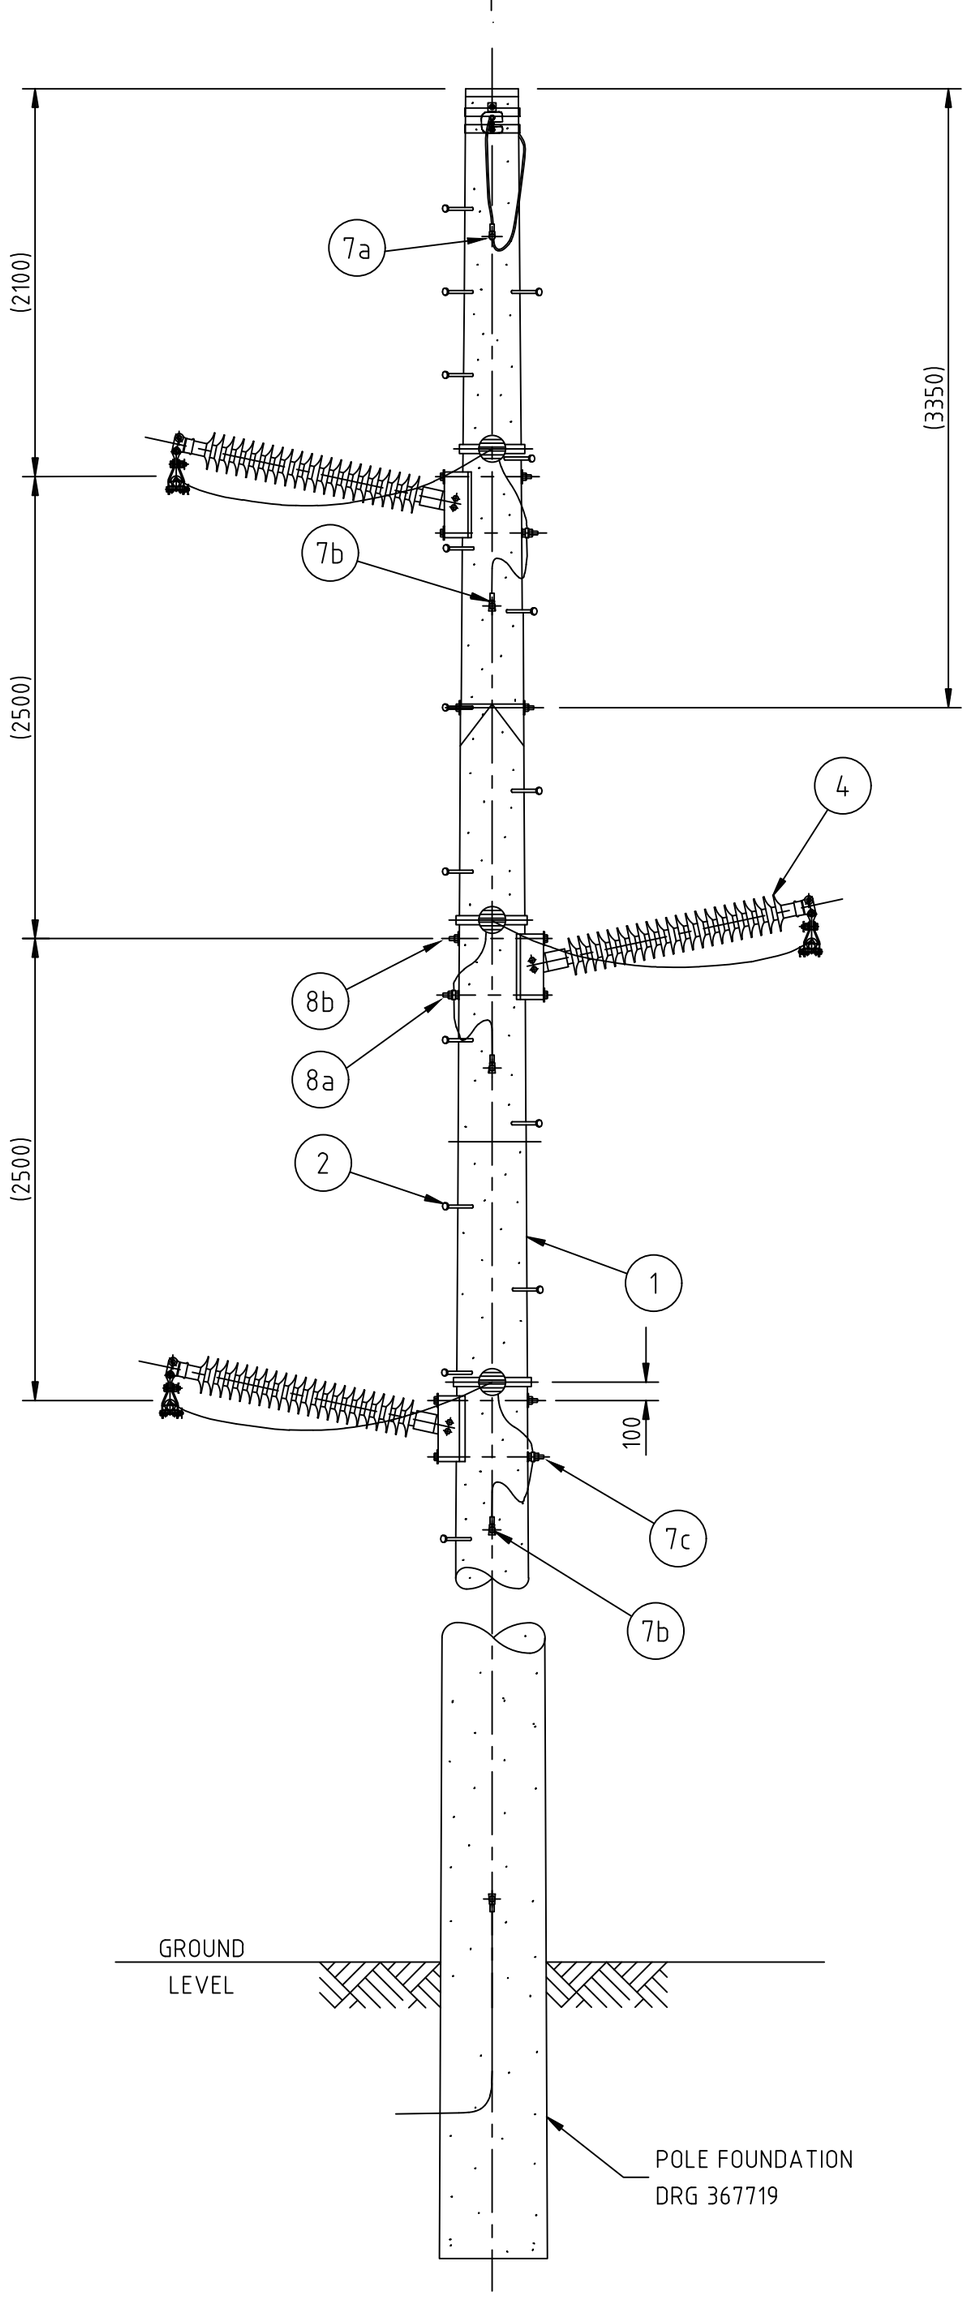

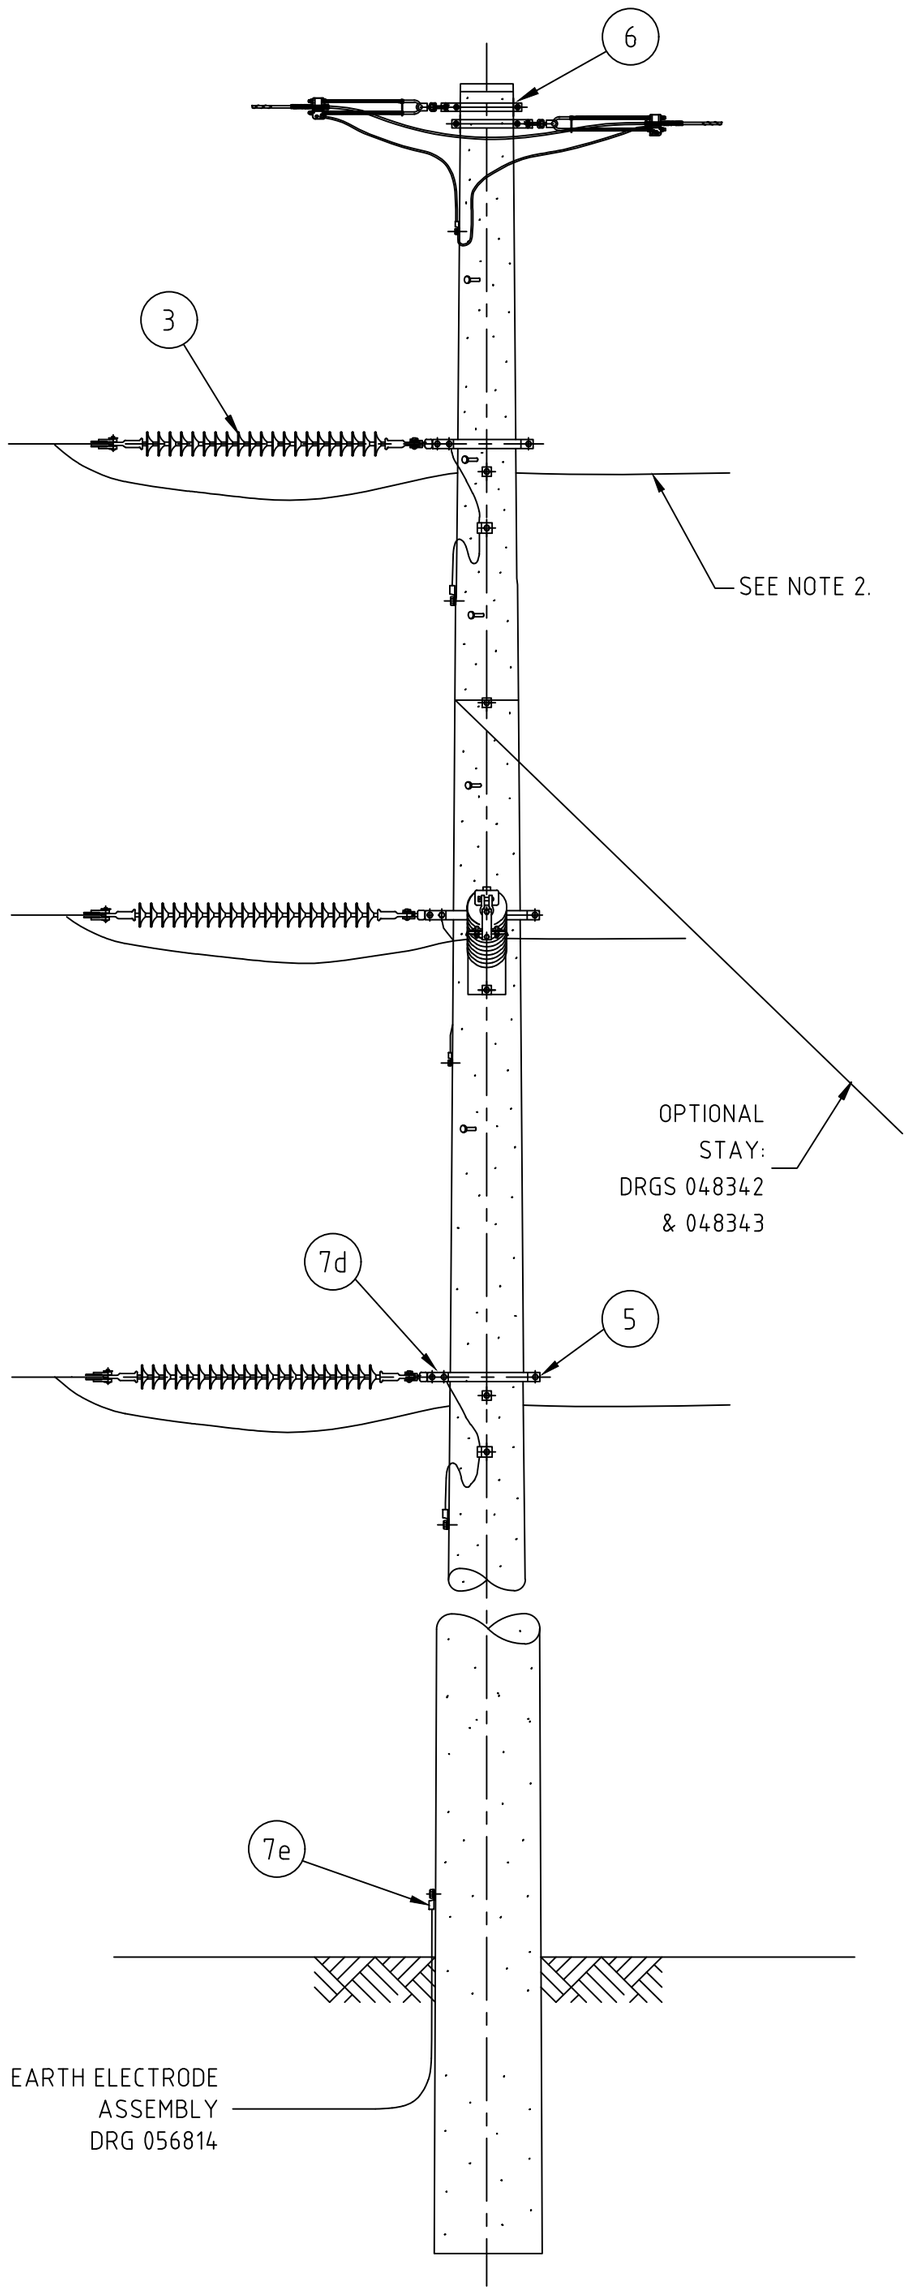

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE 1:34	APPROVED S.F.Williams		
DRAWN	KT		
DATE	02.06.14		
CH'D	J.B./R.L.		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
D.Mate

NETWORK MAINS MANAGER 31.10.14

OVERHEAD TRANSMISSION 132kV CONSTRUCTION No.86VC VERTICAL TERMINATION

A2P 397796 Rev. B

SHEET No 1 OF 1 SHEETS