


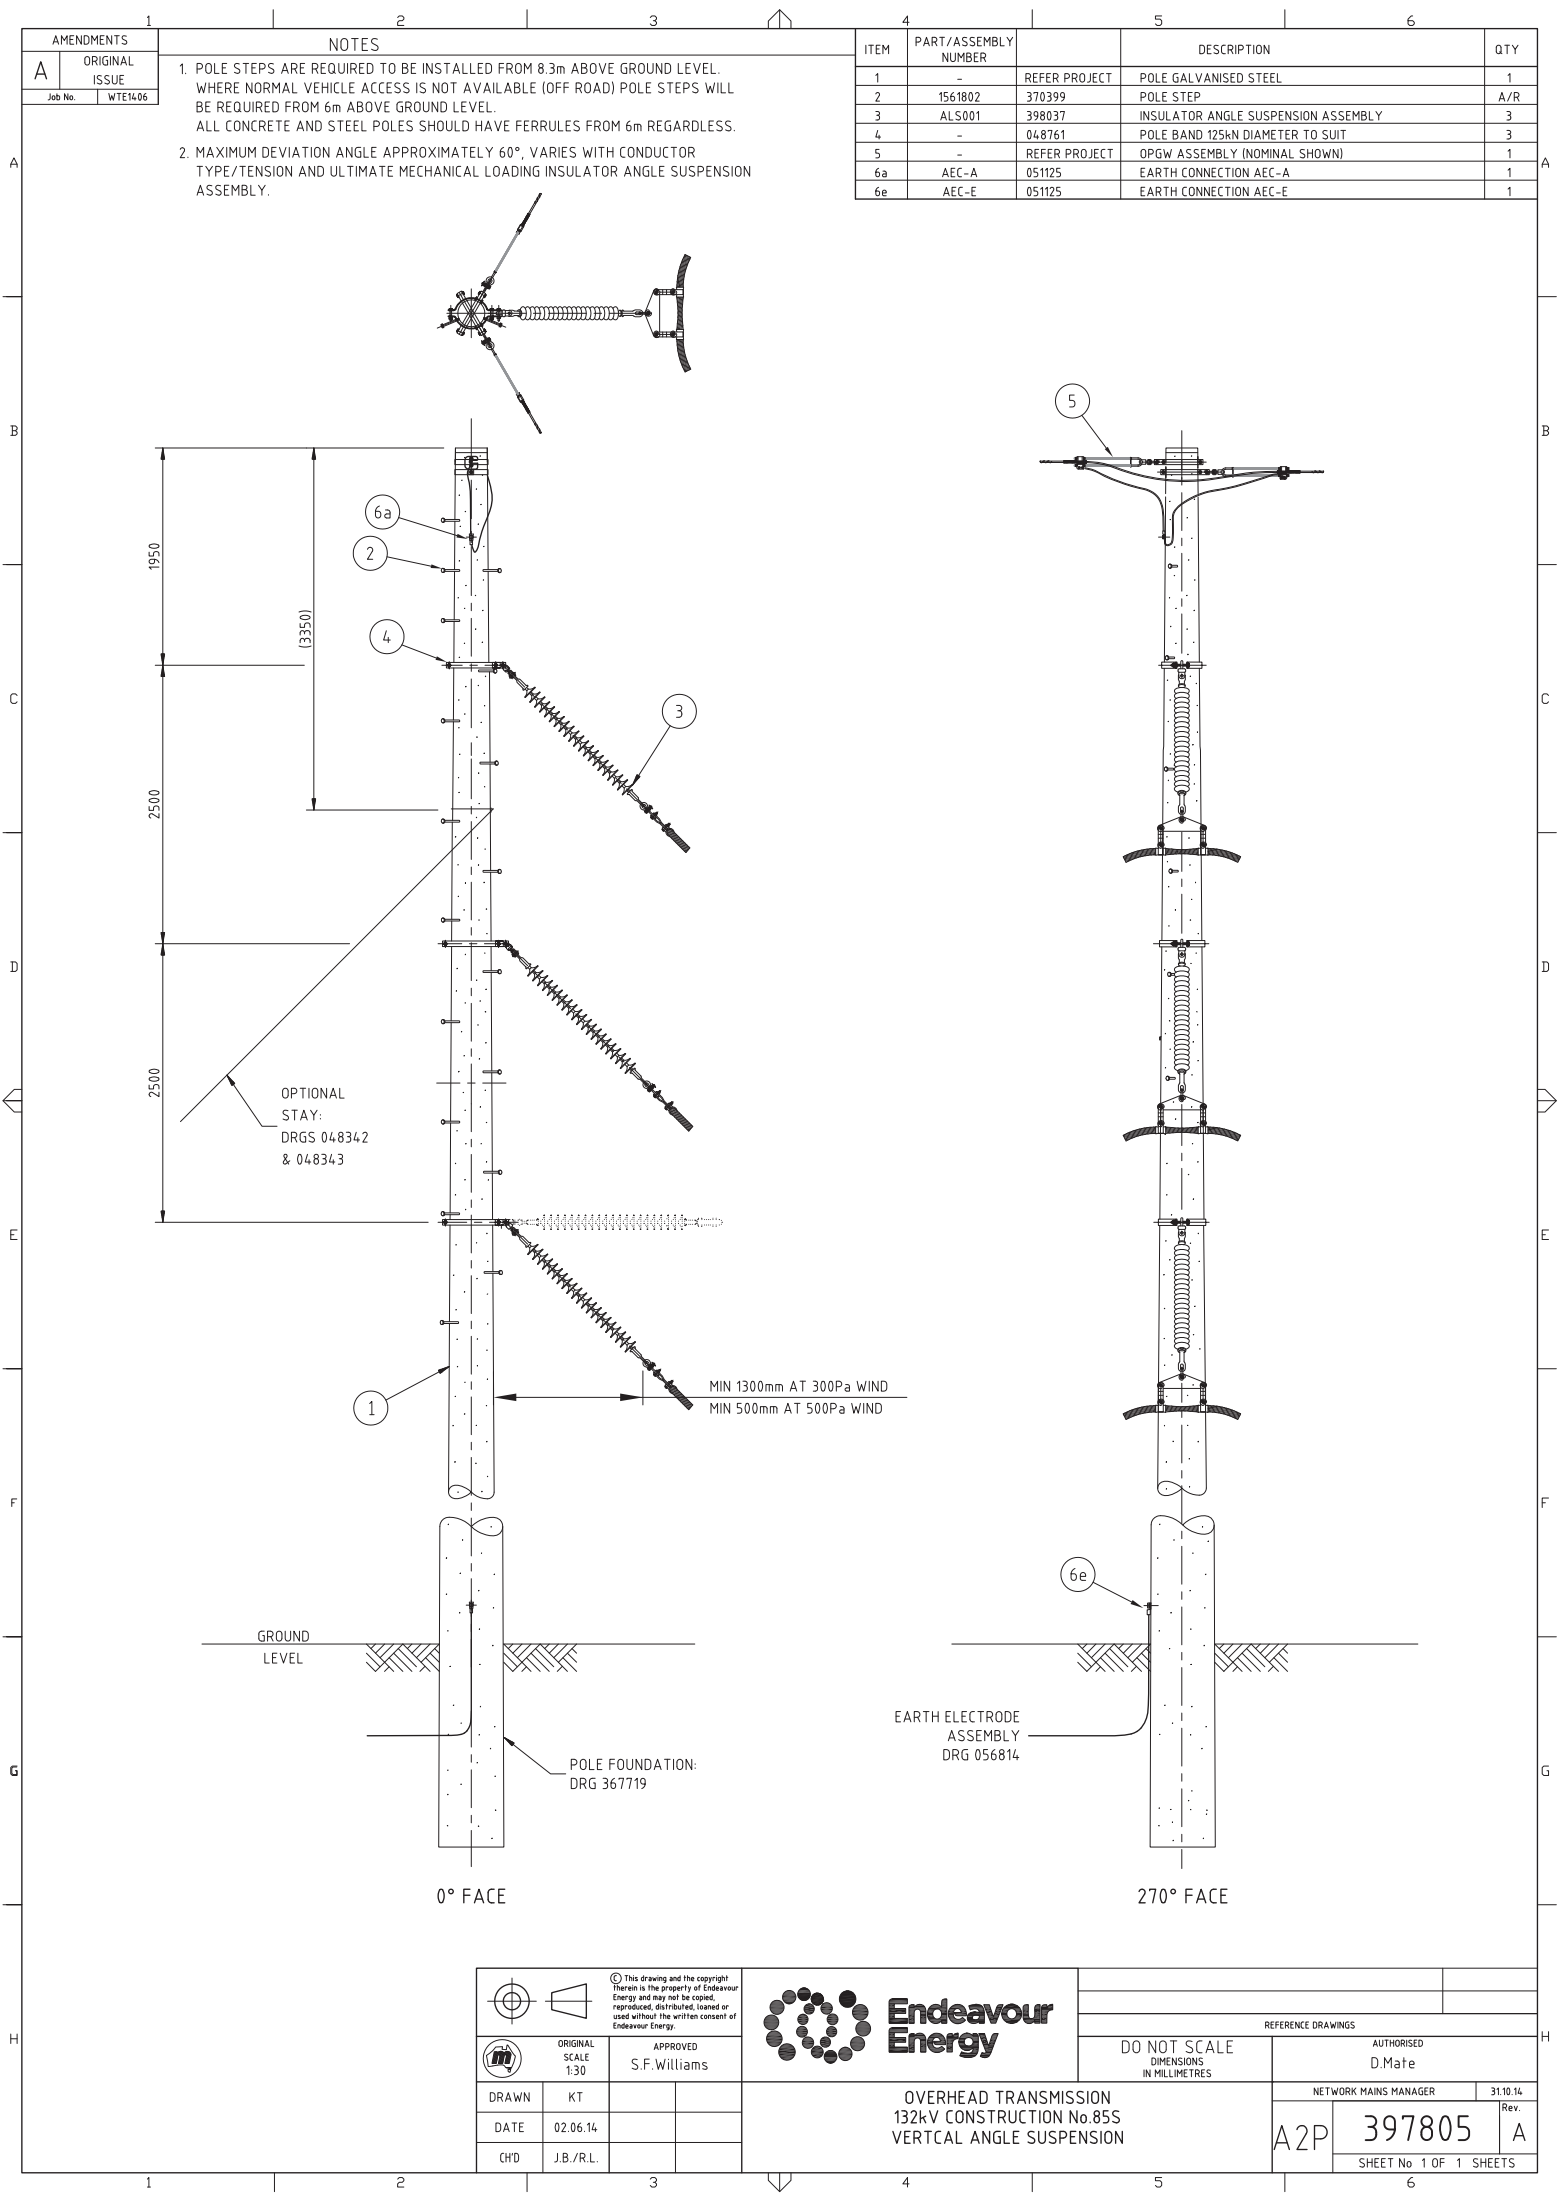

AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTE14.06

NOTES

- POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.
- MAXIMUM DEVIATION ANGLE APPROXIMATELY 60°. VARIES WITH CONDUCTOR TYPE/TENSION AND ULTIMATE MECHANICAL LOADING INSULATOR ANGLE SUSPENSION ASSEMBLY.

ITEM	PART/ASSEMBLY NUMBER	REFER PROJECT	DESCRIPTION	QTY
1	-	REFER PROJECT	POLE GALVANISED STEEL	1
2	1561802	370399	POLE STEP	A/R
3	ALS001	398037	INSULATOR ANGLE SUSPENSION ASSEMBLY	3
4	-	048761	POLE BAND 125kN DIAMETER TO SUIT	3
5	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
6a	AEC-A	051125	EARTH CONNECTION AEC-A	1
6e	AEC-E	051125	EARTH CONNECTION AEC-E	1

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
ORIGINAL SCALE	1:30	APPROVED	S.F.Williams
DRAWN	KT		
DATE	02.06.14		
CHD	J.B./R.L.		



Endeavour Energy

OVERHEAD TRANSMISSION
132kV CONSTRUCTION No.855
VERTICAL ANGLE SUSPENSION

REFERENCE DRAWINGS		AUTHORISED D.Mate	
DO NOT SCALE DIMENSIONS IN MILLIMETRES		NETWORK MAINS MANAGER 31.10.14	
A2P		397805	
SHEET No 1 OF 1 SHEETS		Rev. A	