AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	
B	DESIGN: N/A
	DR'N: TV
	CH'D: MA/MB
	DATE: 12.11.25
A.E.M.	S.P.
STOCK CODES UPDATED	

NOTES

1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.

ITEM	PART/ASSEMBLY NUMBER	DRG	DESCRIPTION	QTY
1	-	REFER PROJECT	POLE GALVANISED STEEL	1
2	1000006147	370399	STEP,POLE,HEX,M16x180MM(L),50MM(T),+NUTS	A/R
3	1000007527	052796	XARM,METAL,3000x152x152MM,6.3MM(T)	1
4	1000000468	054790	BRACE,XARM,ANG,TYPE 3H,GALV,2 X M18	2
5	ALR001	398038	INSULATOR LONG ROD ASSEMBLY	6
6	ALP002	398035	INSULATOR LINE POST ASSEMBLY BONDING	1
7	SEE TABLE	399844	SLEEVE NON TENSION TO SUIT CONDUCTOR	3
8	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
9a	AEC-A	051125	EARTH CONNECTION AEC-A	1
9e	AEC-E	051125	EARTH CONNECTION AEC-E	1
10	ASP001	398036	M20 BOLT ASSEMBLY FOR LINE POST INSULATOR	1
11	ASP006	398036	M20 EYEBOLT ASSEMBLY FOR CROSSARM	2
12	ASP007	398036	M20 BOLT ASSEMBLY FOR CROSSARM	1
13a	ASP009	398036	M16 BOLT ASSEMBLY FOR CROSSARM BRACE	2
13b	ASP010	398036	M16 BOLT ASSEMBLY FOR CROSSARM BRACE	1
14	-	048761	POLE BAND 125kN DIAMETER TO SUIT	2

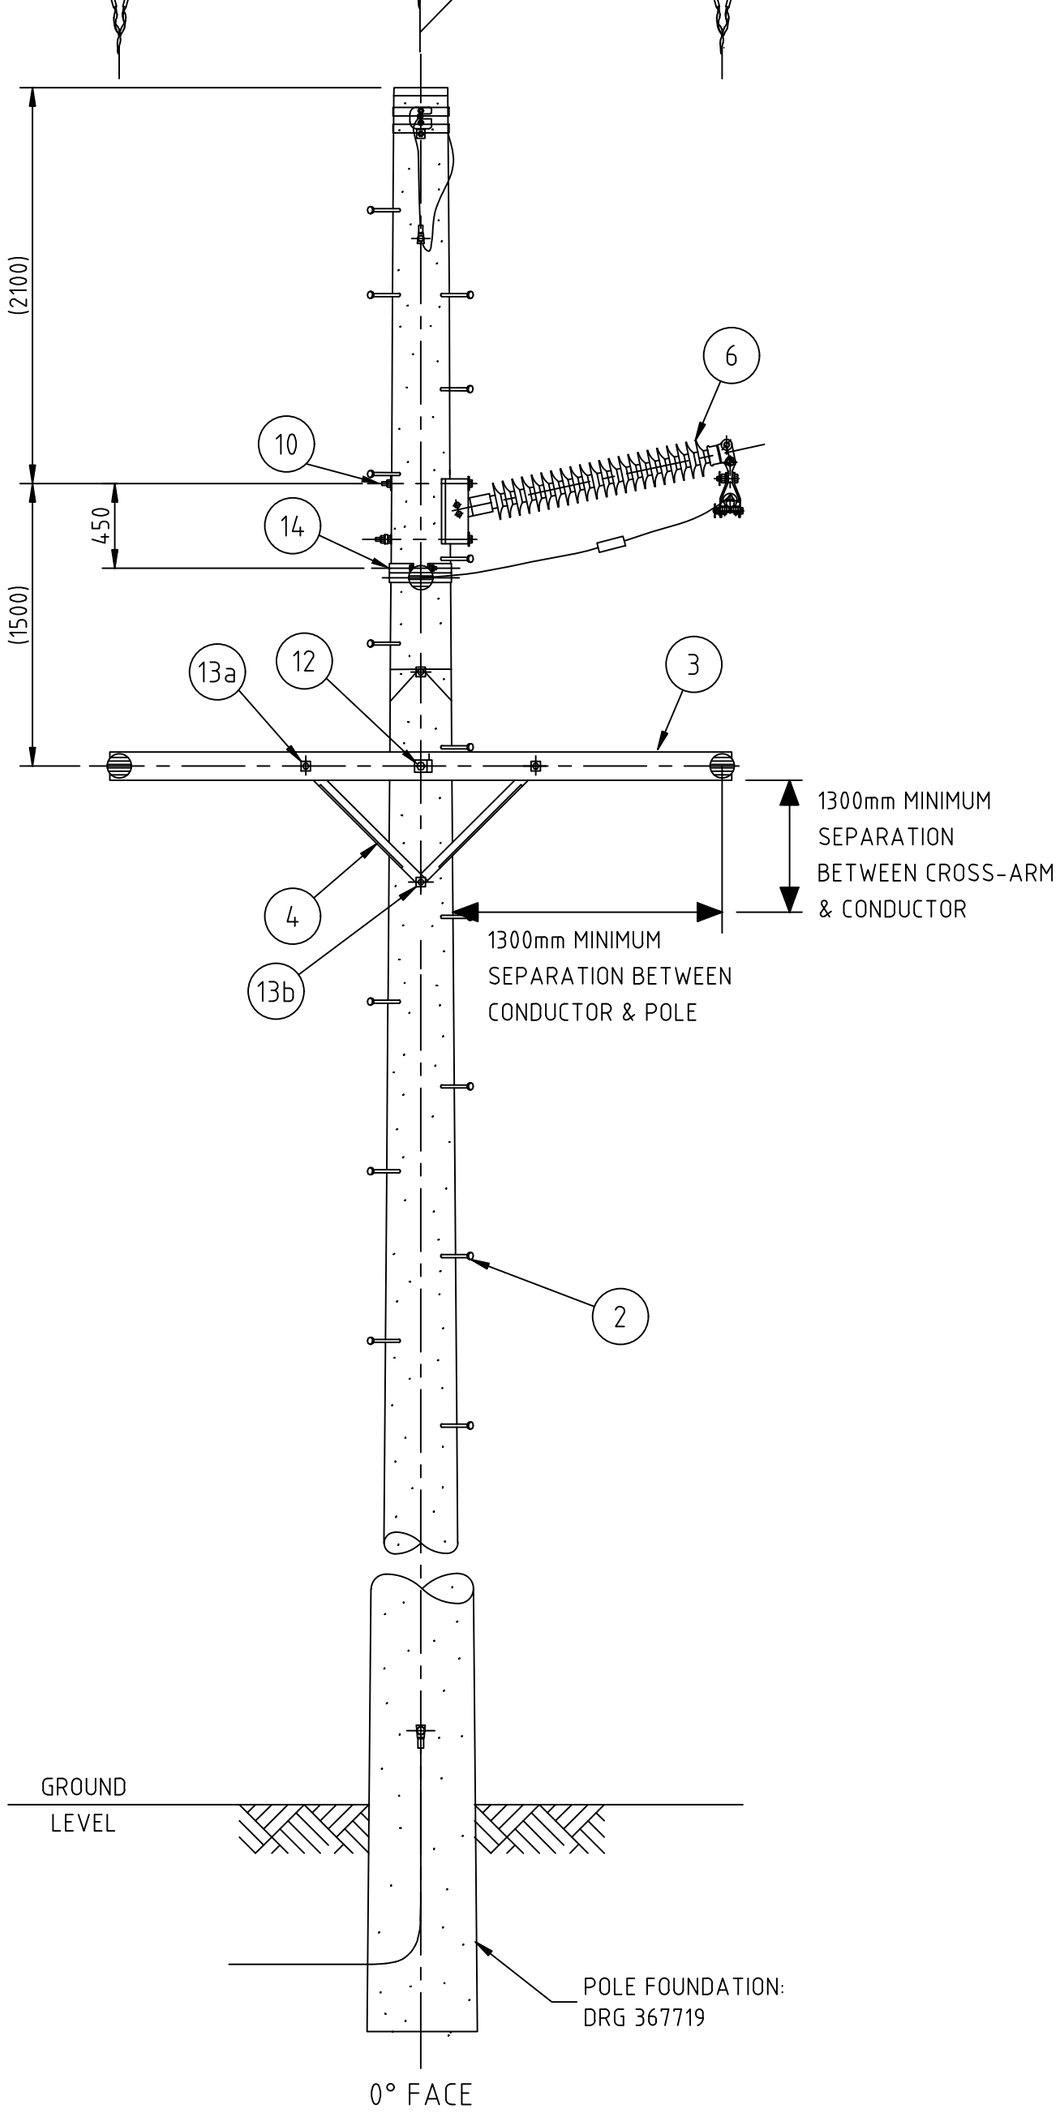

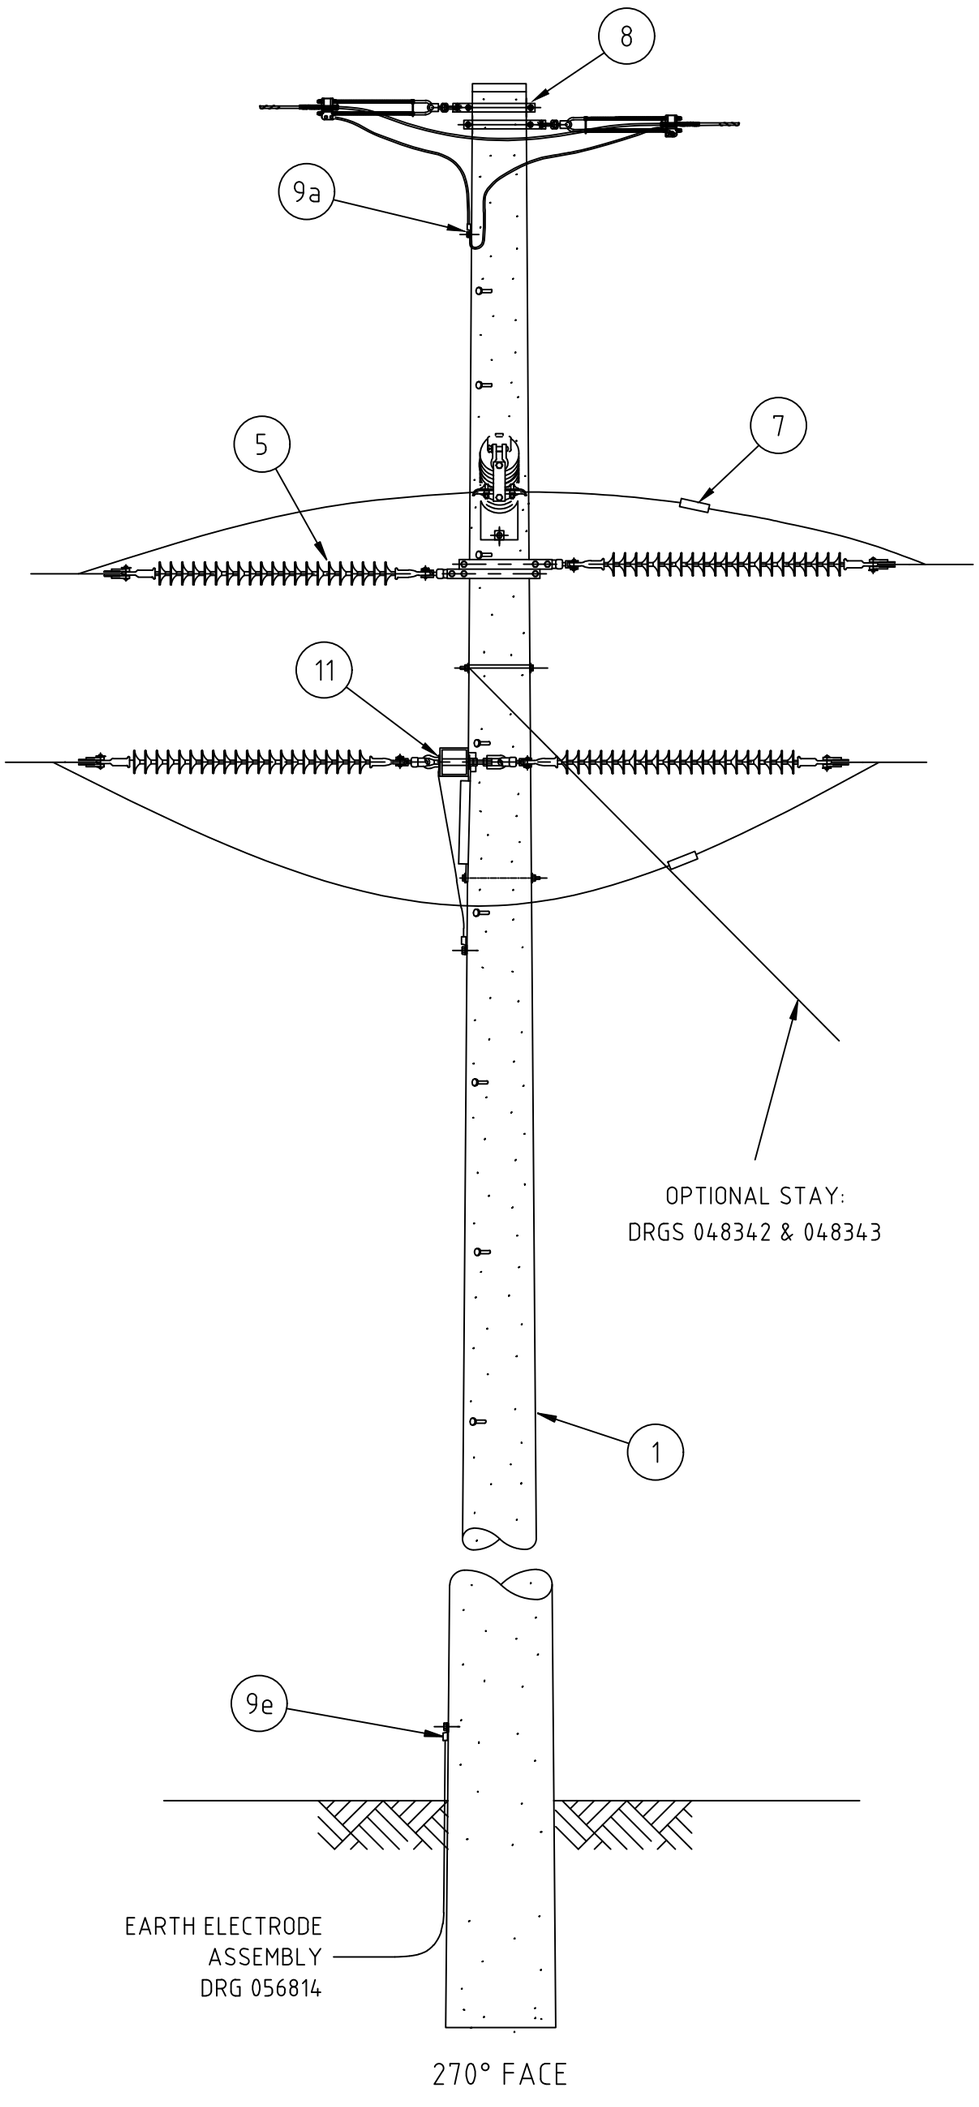

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE	NTS	APPROVED	S.F.Williams
DRAWN	KT		
DATE	29.08.14		
CH'D	J.B./R.L.		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
D.Mate

NETWORK MAINS MANAGER 31.10.14

OVERHEAD TRANSMISSION 132kV CONSTRUCTION No. 86S DELTA THROUGH STRAIN

A2P 397807 Rev. B

SHEET No 1 OF 1 SHEETS