


1		2		3		4		5		6			
AMENDMENTS		NOTES						ITEM	PART/ASSEMBLY NUMBER	DRG Nos.	DESCRIPTION	QTY	
A	ORIGINAL ISSUE							1	-	REFER PROJECT	POLE GAVANISED STEEL	1	
Job No.								2	1000006368	061648	CROSSARM STEEL SHS-10,000x150x150mm	1	
B	DESIGN DR'N							N/A TV	3	1000000468	054790	BRACE,XARM,ANG,TYPE 3H,GALV,2 X M18	2
	CH'D							MA/MB	4	ALR001	398038	INSULATOR LONG ROD ASSEMBLY	3
	DATE							12.11.25	5	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
A.E.M.								S.P.	6b	AEC-B	051125	EARTH CONNECTION AEC-B	2
STOCK CODES UPDATED		3	MINIMUM CLEARANCE FROM ANY BONDS/DROPPERS TO BE AT LEAST 1300mm FROM EARTHED SECTIONS.	6e	AEC-E	051125	EARTH CONNECTION AEC-E	2					
		4	FOUNDATION DEPTH BASED ON 14/24 POLE.	7a	ASP006	398036	M20 EYEBOLT ASSEMBLY FOR CROSSARM	3					
				7b	ASP007	398036	M20 BOLT ASSEMBLY FOR CROSSARM	2					
				8a	ASP009	398036	M16 BOLT ASSEMBLY FOR CROSSARM BRACE	2					
				8b	ASP010	398036	M16 BOLT ASSEMBLY FOR CROSSARM BRACE	2					

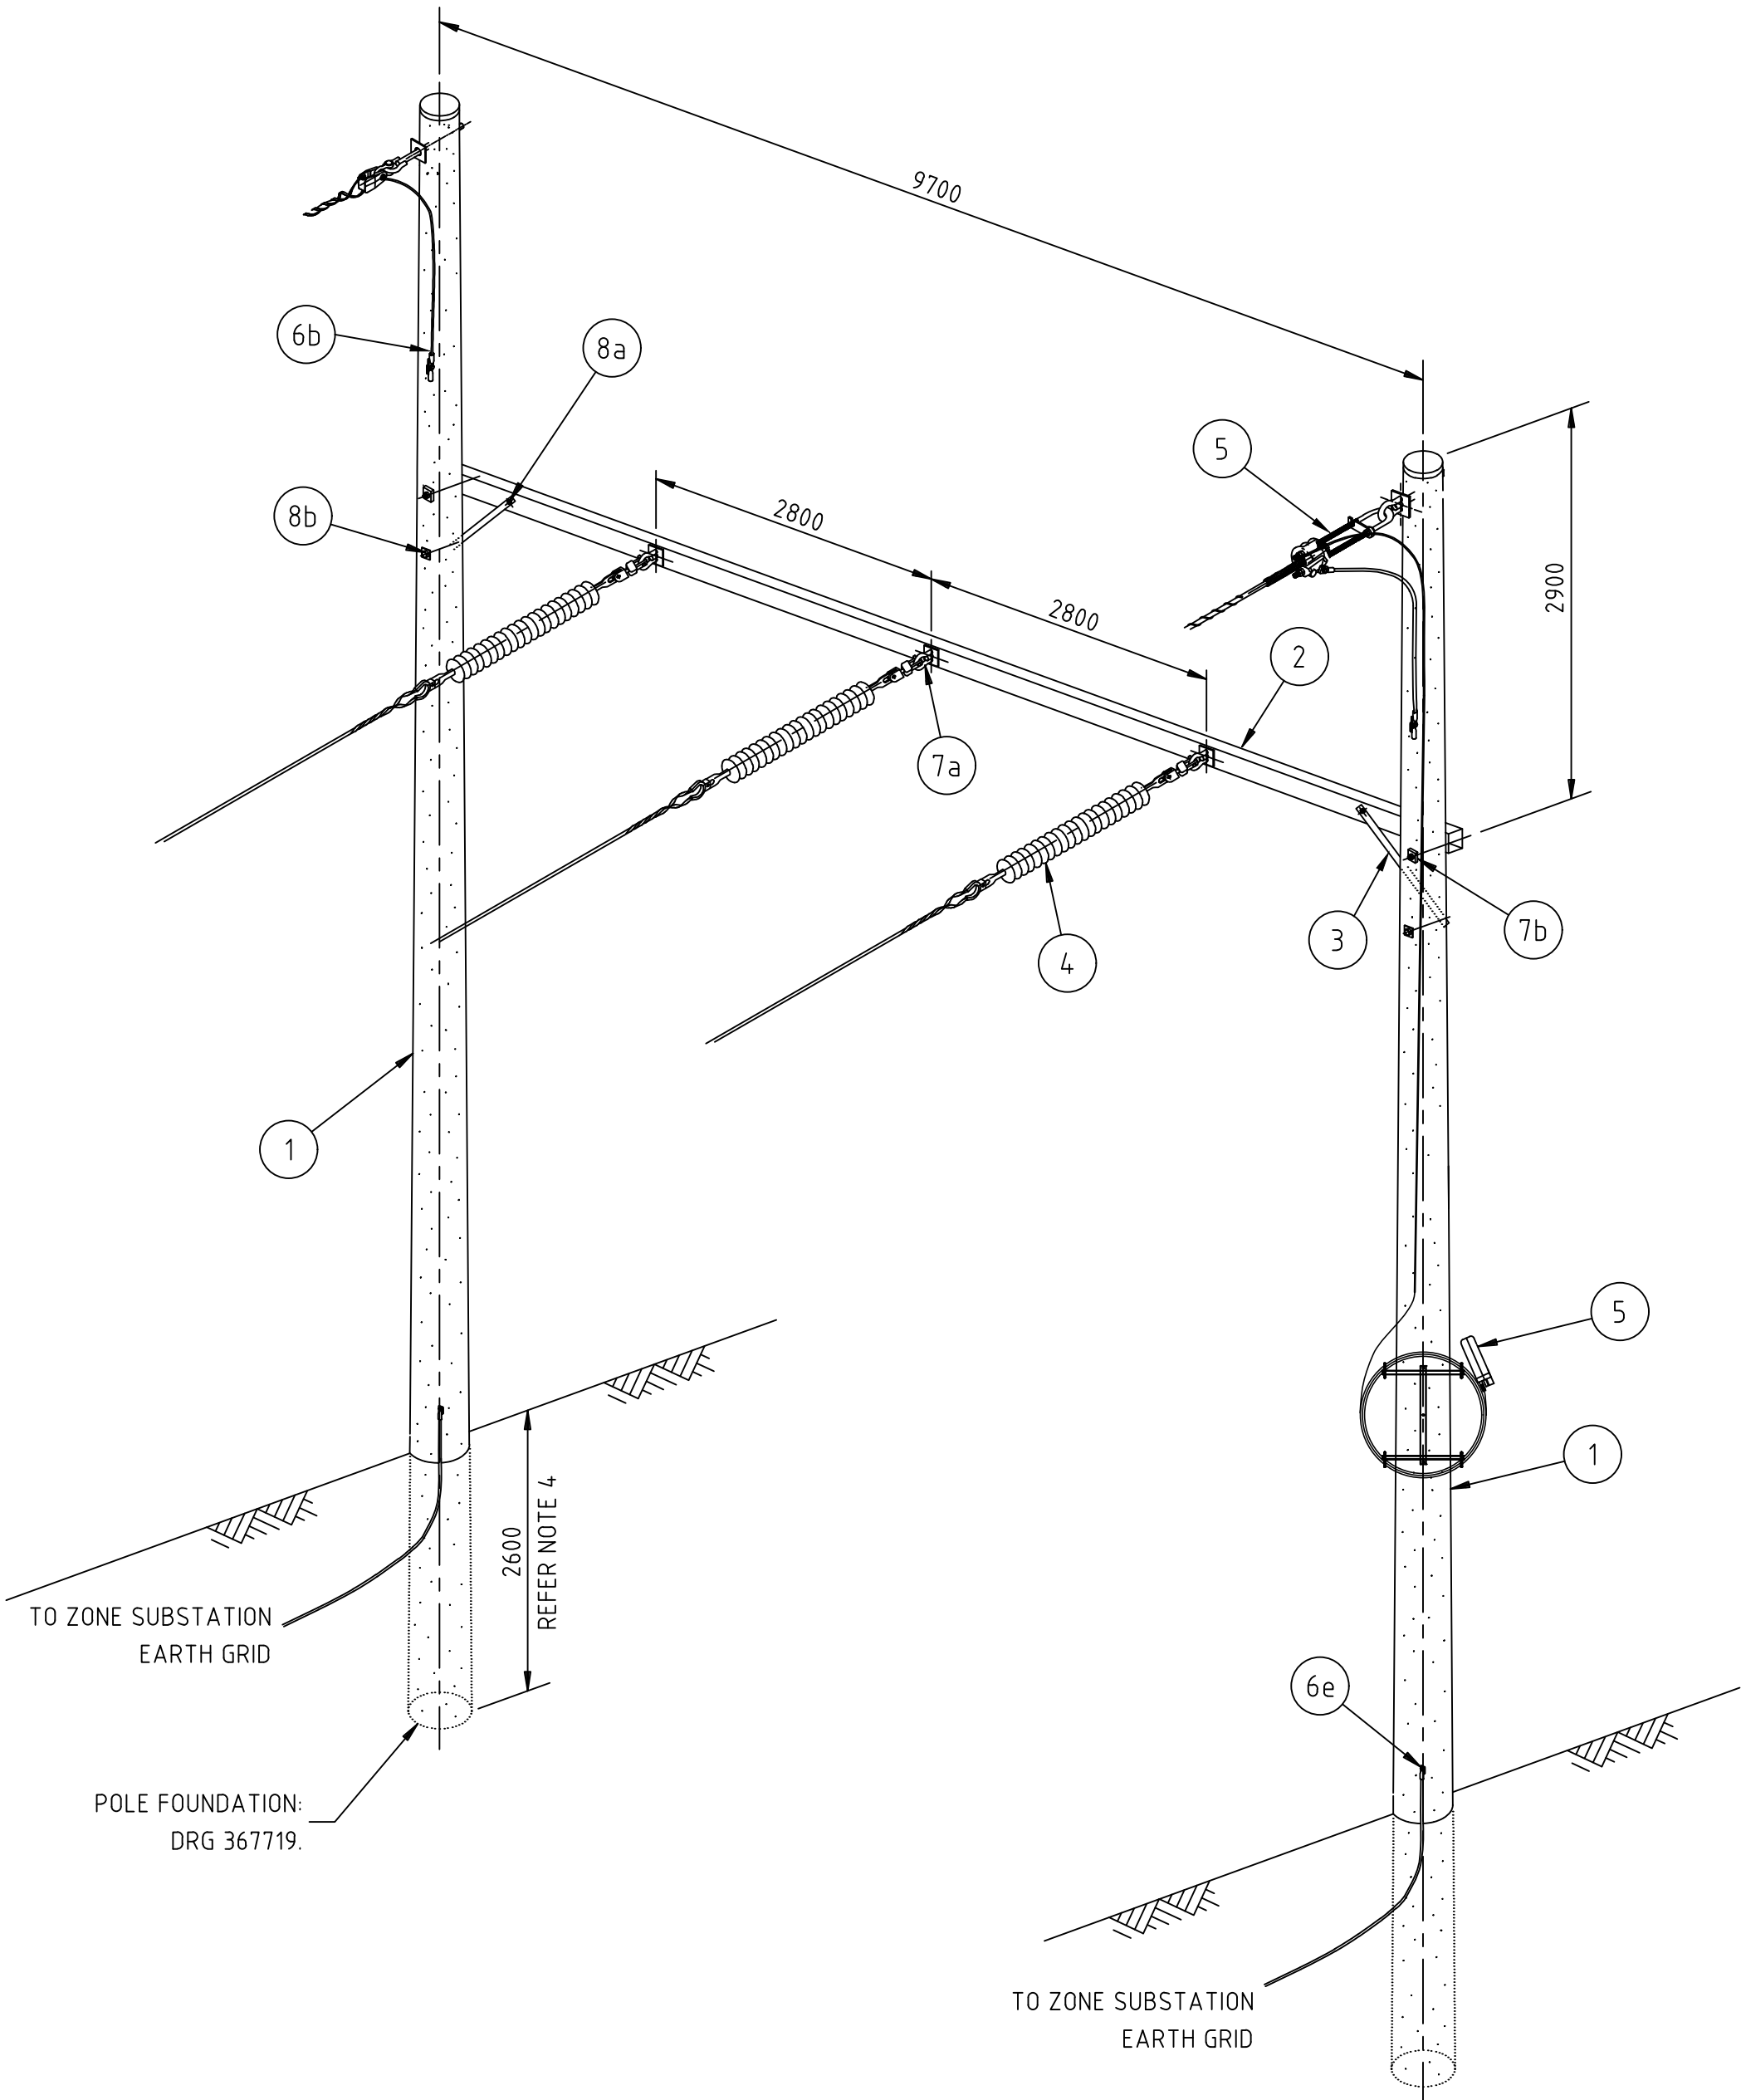

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

Endeavour Energy

ORIGINAL SCALE
NONE

APPROVED

S.F.Williams

DRAWN

KT

DATE

02.06.14

CH'D

J.B./R.L.

DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

AUTHORISED
D.Mate

NETWORK MAINS MANAGER

31.10.14

A2P

397808

Rev. B

SHEET No 1 OF 1 SHEETS

OVERHEAD TRANSMISSION
132kV SUBSTATION LANDING STRUCTURE
2 POLE STEEL