AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	
B	DESIGN: N/A
	DR'N: TV
	CH'D: MA/MB
	DATE: 12.11.25
A.E.M.	S.P.
STOCK CODES UPDATED	

NOTES

1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL.

ITEM	PART	DRG	DESCRIPTION	QTY
1	-	REFER PROJECT	POLE TIMBER	1
2	1000000477	015357	STEP,POLE,WOOD,M16x260MM(L),GALV	A/R
3	1000007527	052796	XARM,METAL,3000x152x152MM,6.3MM(T)	1
4	1000000468	054790	BRACE,XARM,ANG,TYPE 3H,GALV,2 X M18	2
5	ALR001	398038	INSULATOR LONG ROD ASSEMBLY	6
6	ALP002	398035	INSULATOR LINE POST ASSEMBLY BONDING	1
7	SEE TABLE	399844	SLEEVE NON TENSION TO SUIT CONDUCTOR	3
8	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
9	ATP012	054798	INSULATOR DOWN LEAD ASSEMBLY	1
10	ATP002	054798	M20 BOLT ASSEMBLY FOR LINE POST INSULATOR	2
11	ATP006	054798	M20 EYEBOLT ASSEMBLY FOR POLE	2
12	ACP006	240600	M20 EYEBOLT ASSEMBLY FOR CROSSARM	2
13	ATP009	054798	M20 BOLT ASSEMBLY FOR CROSSARM	1
14	ACP009	240600	M16 BOLT ASSEMBLY FOR CROSSARM BRACE	2
15	ATP011	054798	COACHSCREW ASSEMBLY FOR CROSSARM BRACE	1

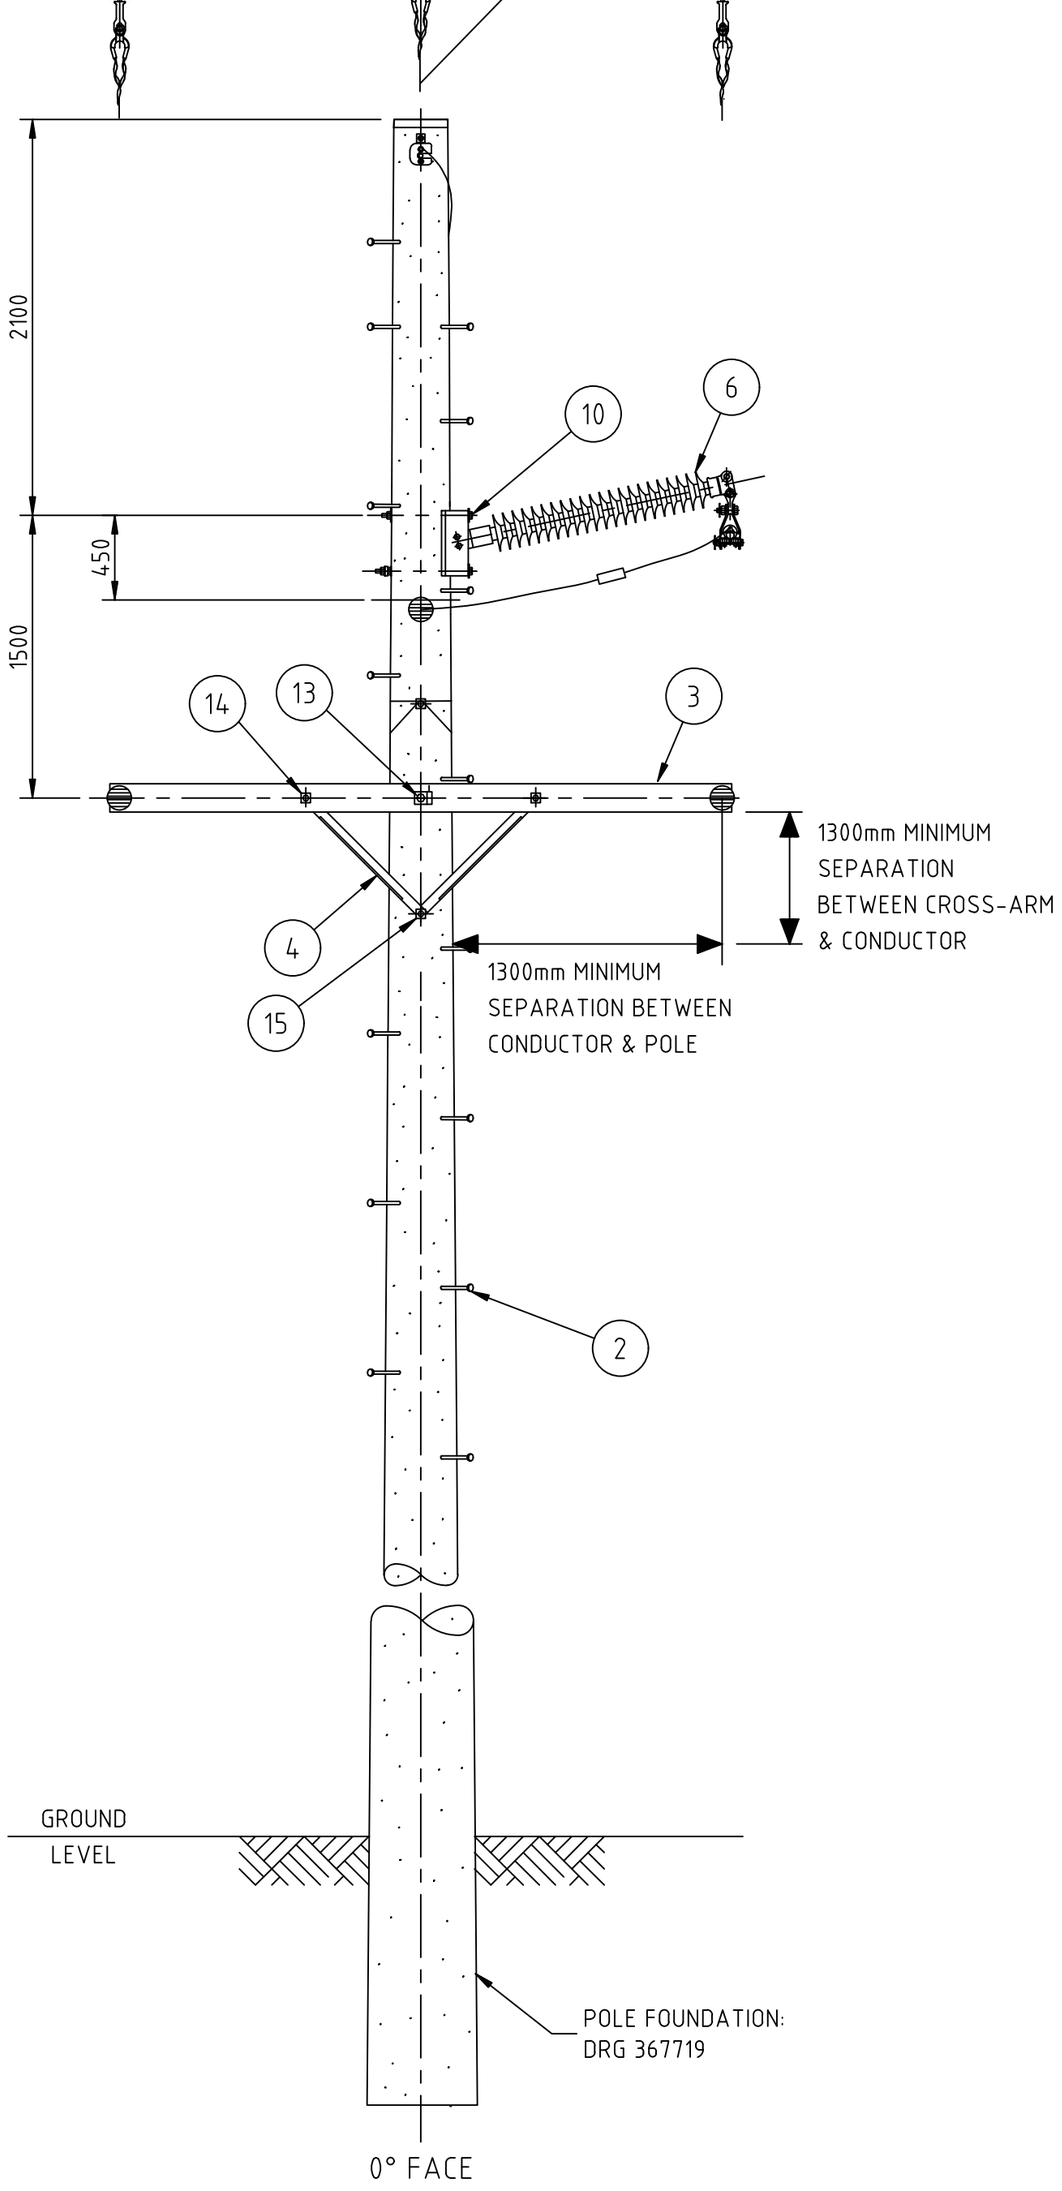

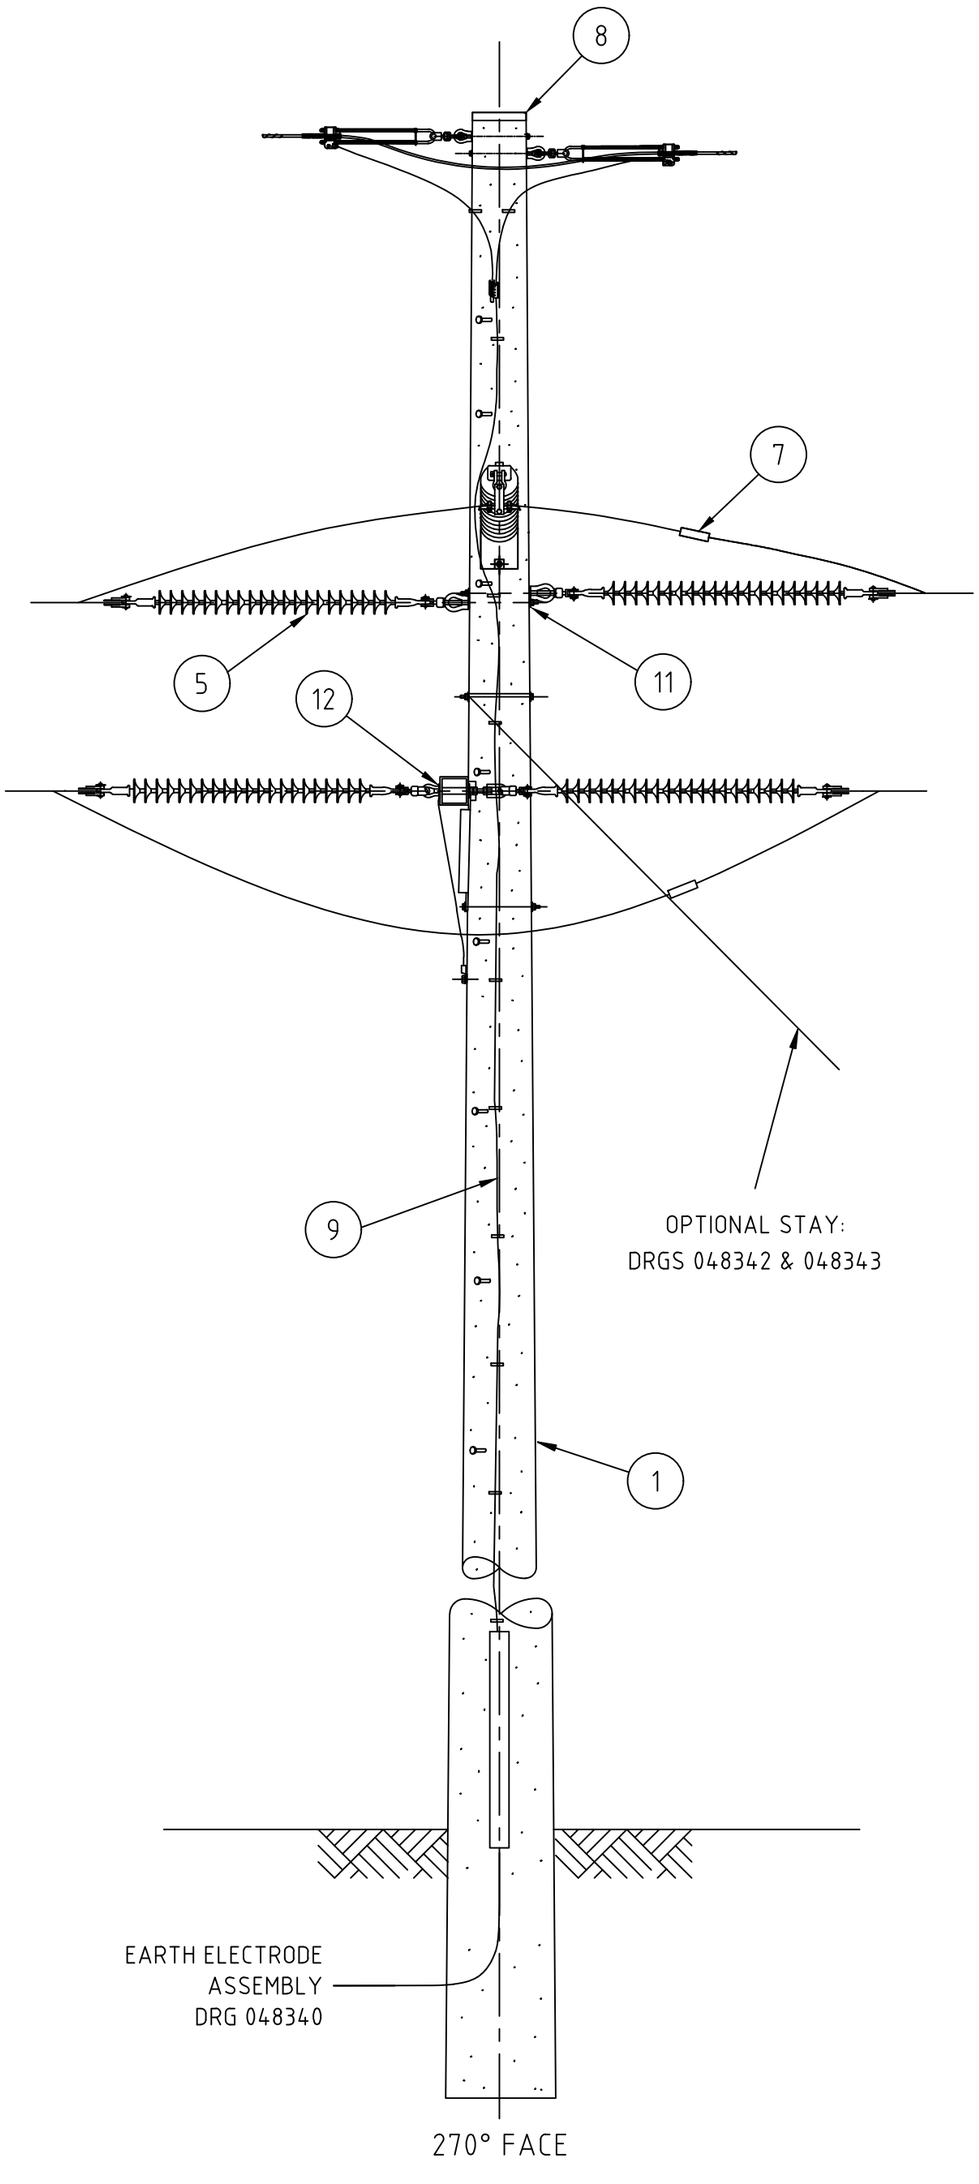

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE	NTS	APPROVED	S.F.Williams
DRAWN	KT		
DATE	29.08.14		
CH'D	J.B./R.L.		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
D.Mate

NETWORK MAINS MANAGER 31.10.14

OVERHEAD TRANSMISSION 132kV CONSTRUCTION No. 86T DELTA THROUGH STRAIN

A2P 397817 Rev. B

SHEET No 1 OF 1 SHEETS