


1		2		3		4		5		6	
AMENDMENTS			NOTES				ITEM	PART/ASSEMBLY NUMBER	DRG Nos.	DESCRIPTION	QTY
A	ORIGINAL ISSUE						1	-	REFER PROJECT	POLE TIMBER	1
Job No.			1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS. 2. STRUCTURE TO BE ERECTED SO THAT POLE TOPS ARE LEVEL & CROSSARM IS HORIZONTAL. 3. MINIMUM CLEARANCE FROM ANY BONDS/DROPPERS TO BE AT LEAST 1300mm FROM EARTHED SECTIONS. 4. FOUNDATION DEPTH BASED ON 12.5/32 POLE				2	1000006368	061648	XARM,METAL,SHS,10000x150x150MM,6MM(T)	1
B	DESIGN	N/A					3	1000000468	054790	BRACE,XARM,ANG,TYPE 3H,GALV,2 X M18	2
	DR'N	TV					4	ALR001	398038	INSULATOR LONG ROD ASSEMBLY	3
	CH'D	MA/MB					5	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
DATE		12.11.25					6	ACP006	24.0600	M20 EYEBOLT ASSEMBLY FOR CROSSARM	3
A.E.M.	S.P.						7	ATP009	054798	M20 BOLT ASSEMBLY FOR CROSSARM	2
STOCK CODES UPDATED							8a	ACP009	24.0600	M16 BOLT ASSEMBLY FOR CROSSARM BRACE	2
							8b	ATP011	054798	M16 COACHSCREW ASSEMBLY FOR CROSSARM BRACE	2
							9	ATP012	054798	INSULATED DOWNLEAD ASSEMBLY	2

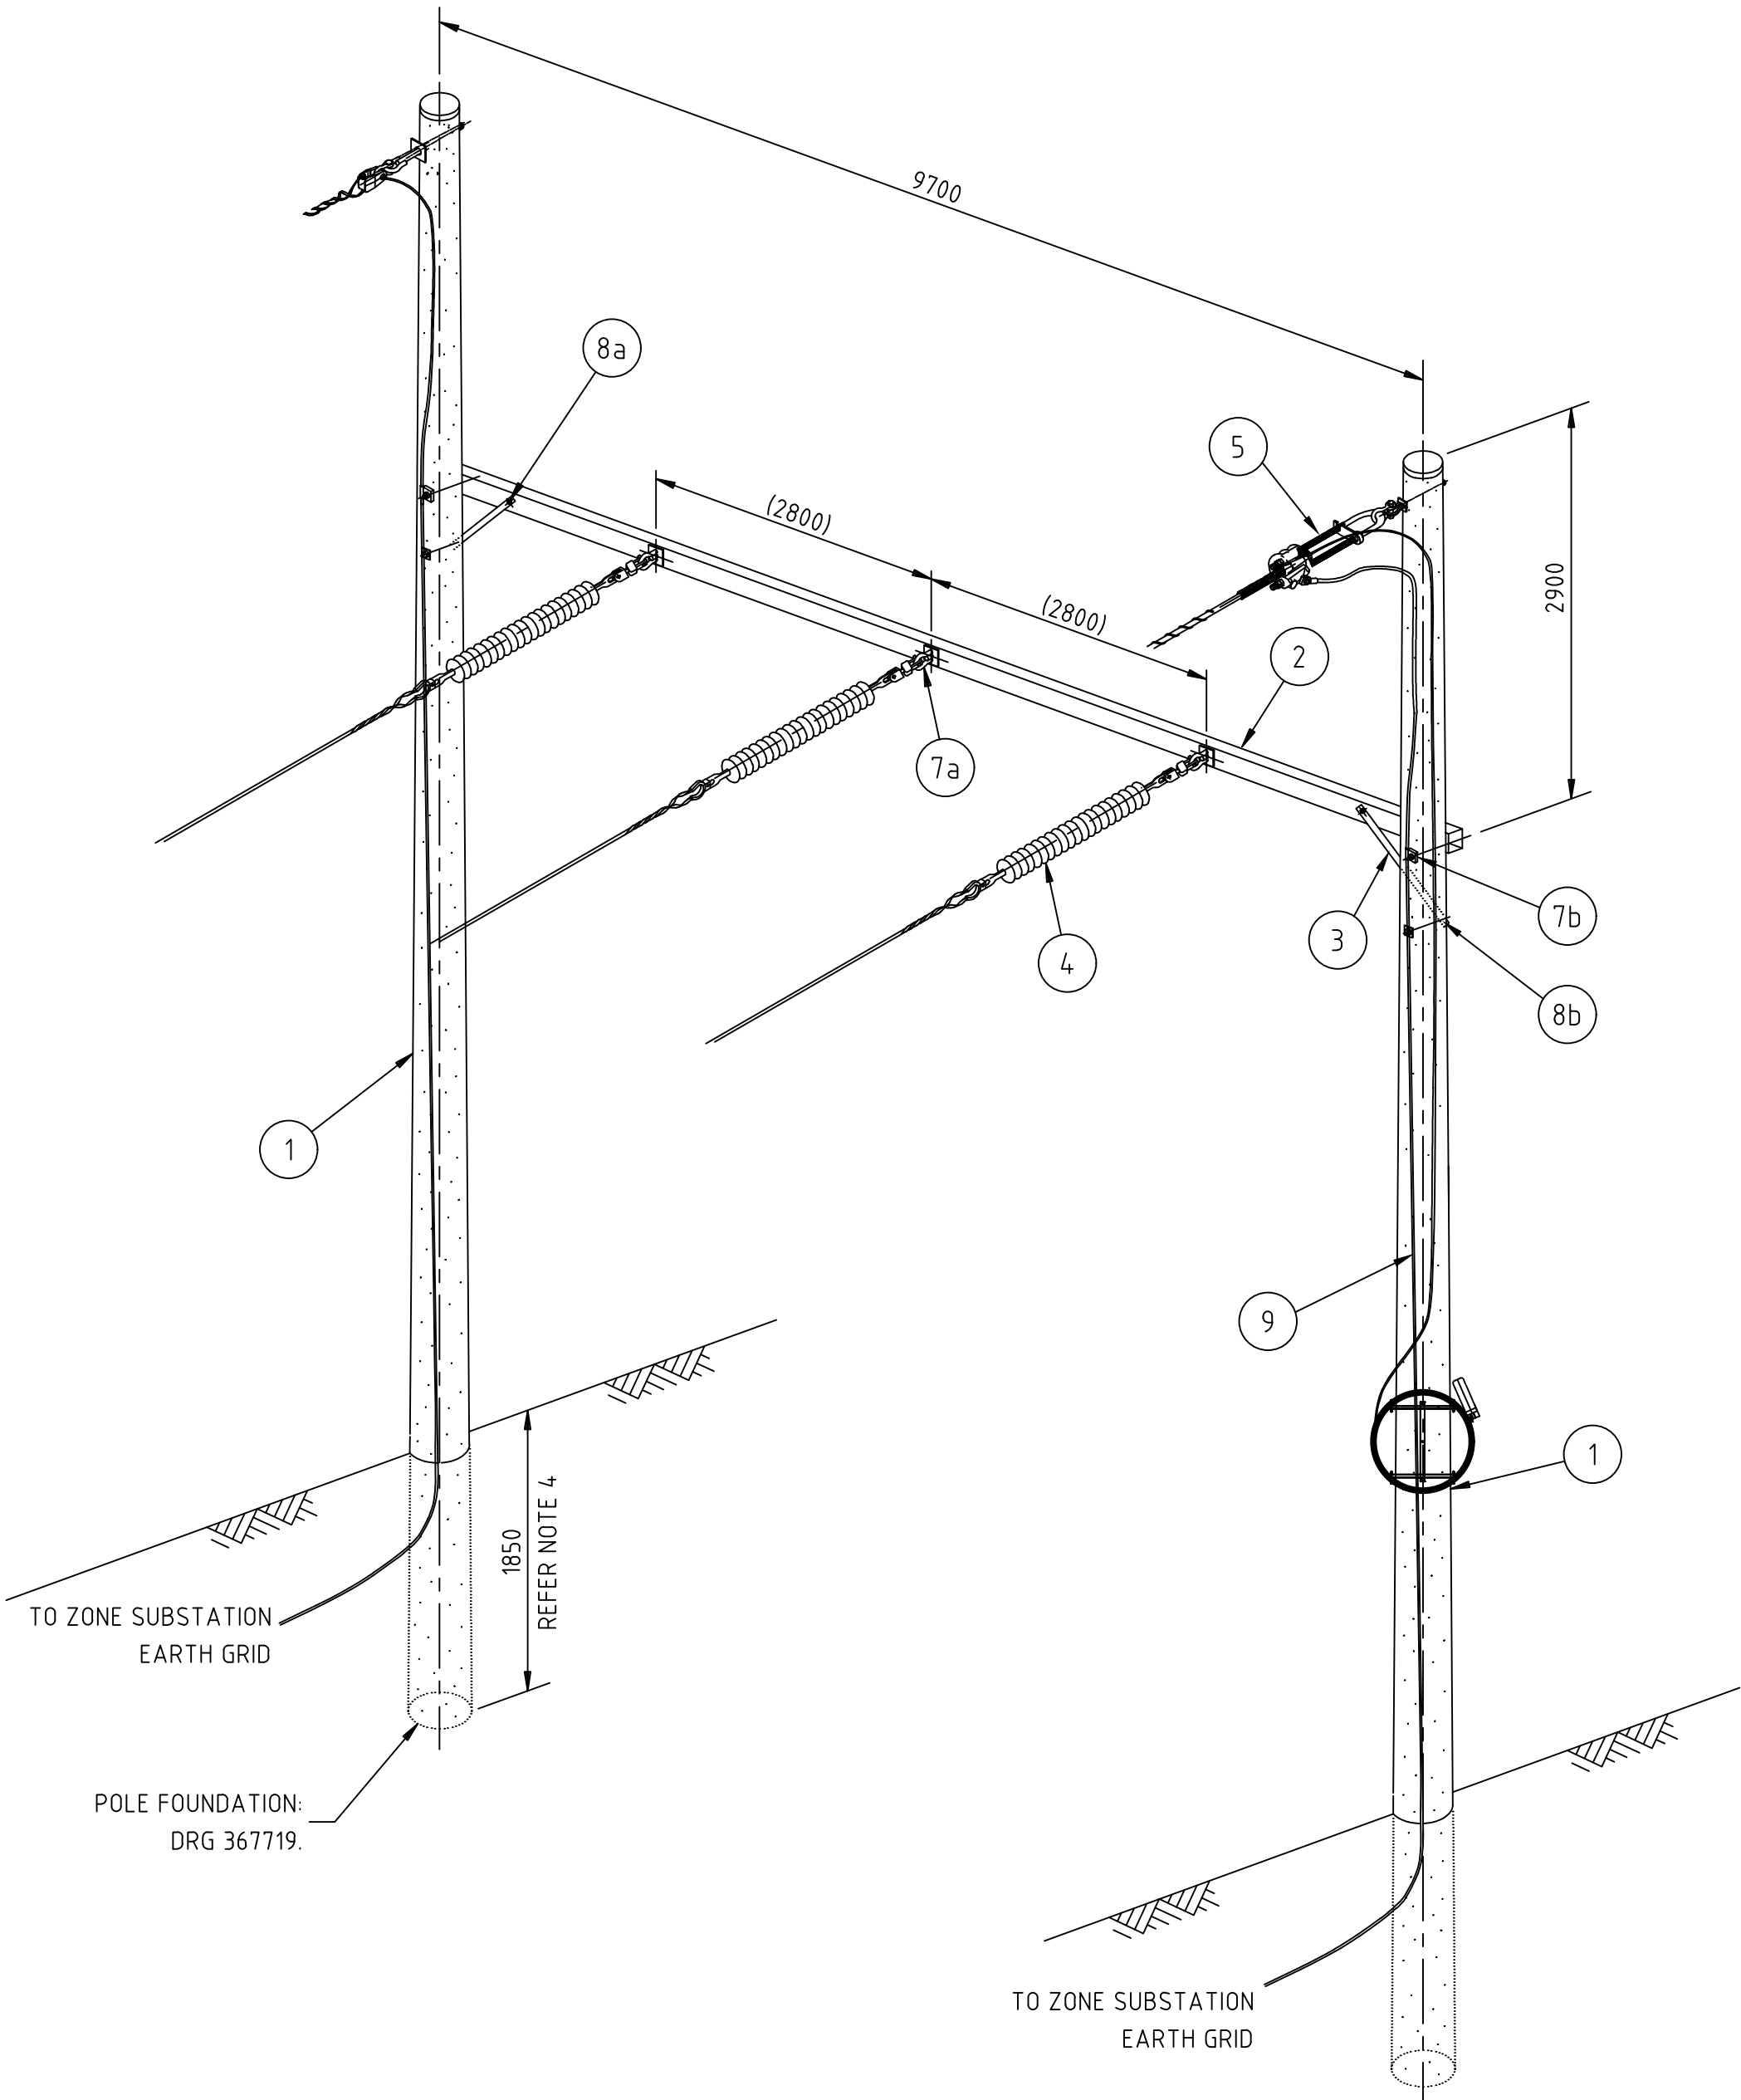

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED
D.Mate

NETWORK MAINS MANAGER

31.10.14
Rev.

DRAWN

KT

DATE

02.06.14

CH'D

J.B./R.S.

APPROVED

S.F.Williams

OVERHEAD TRANSMISSION

132kV SUBSTATION LANDING STRUCTURE

2 POLE TIMBER

A2P

397818

SHEET No 1 OF 1 SHEETS