


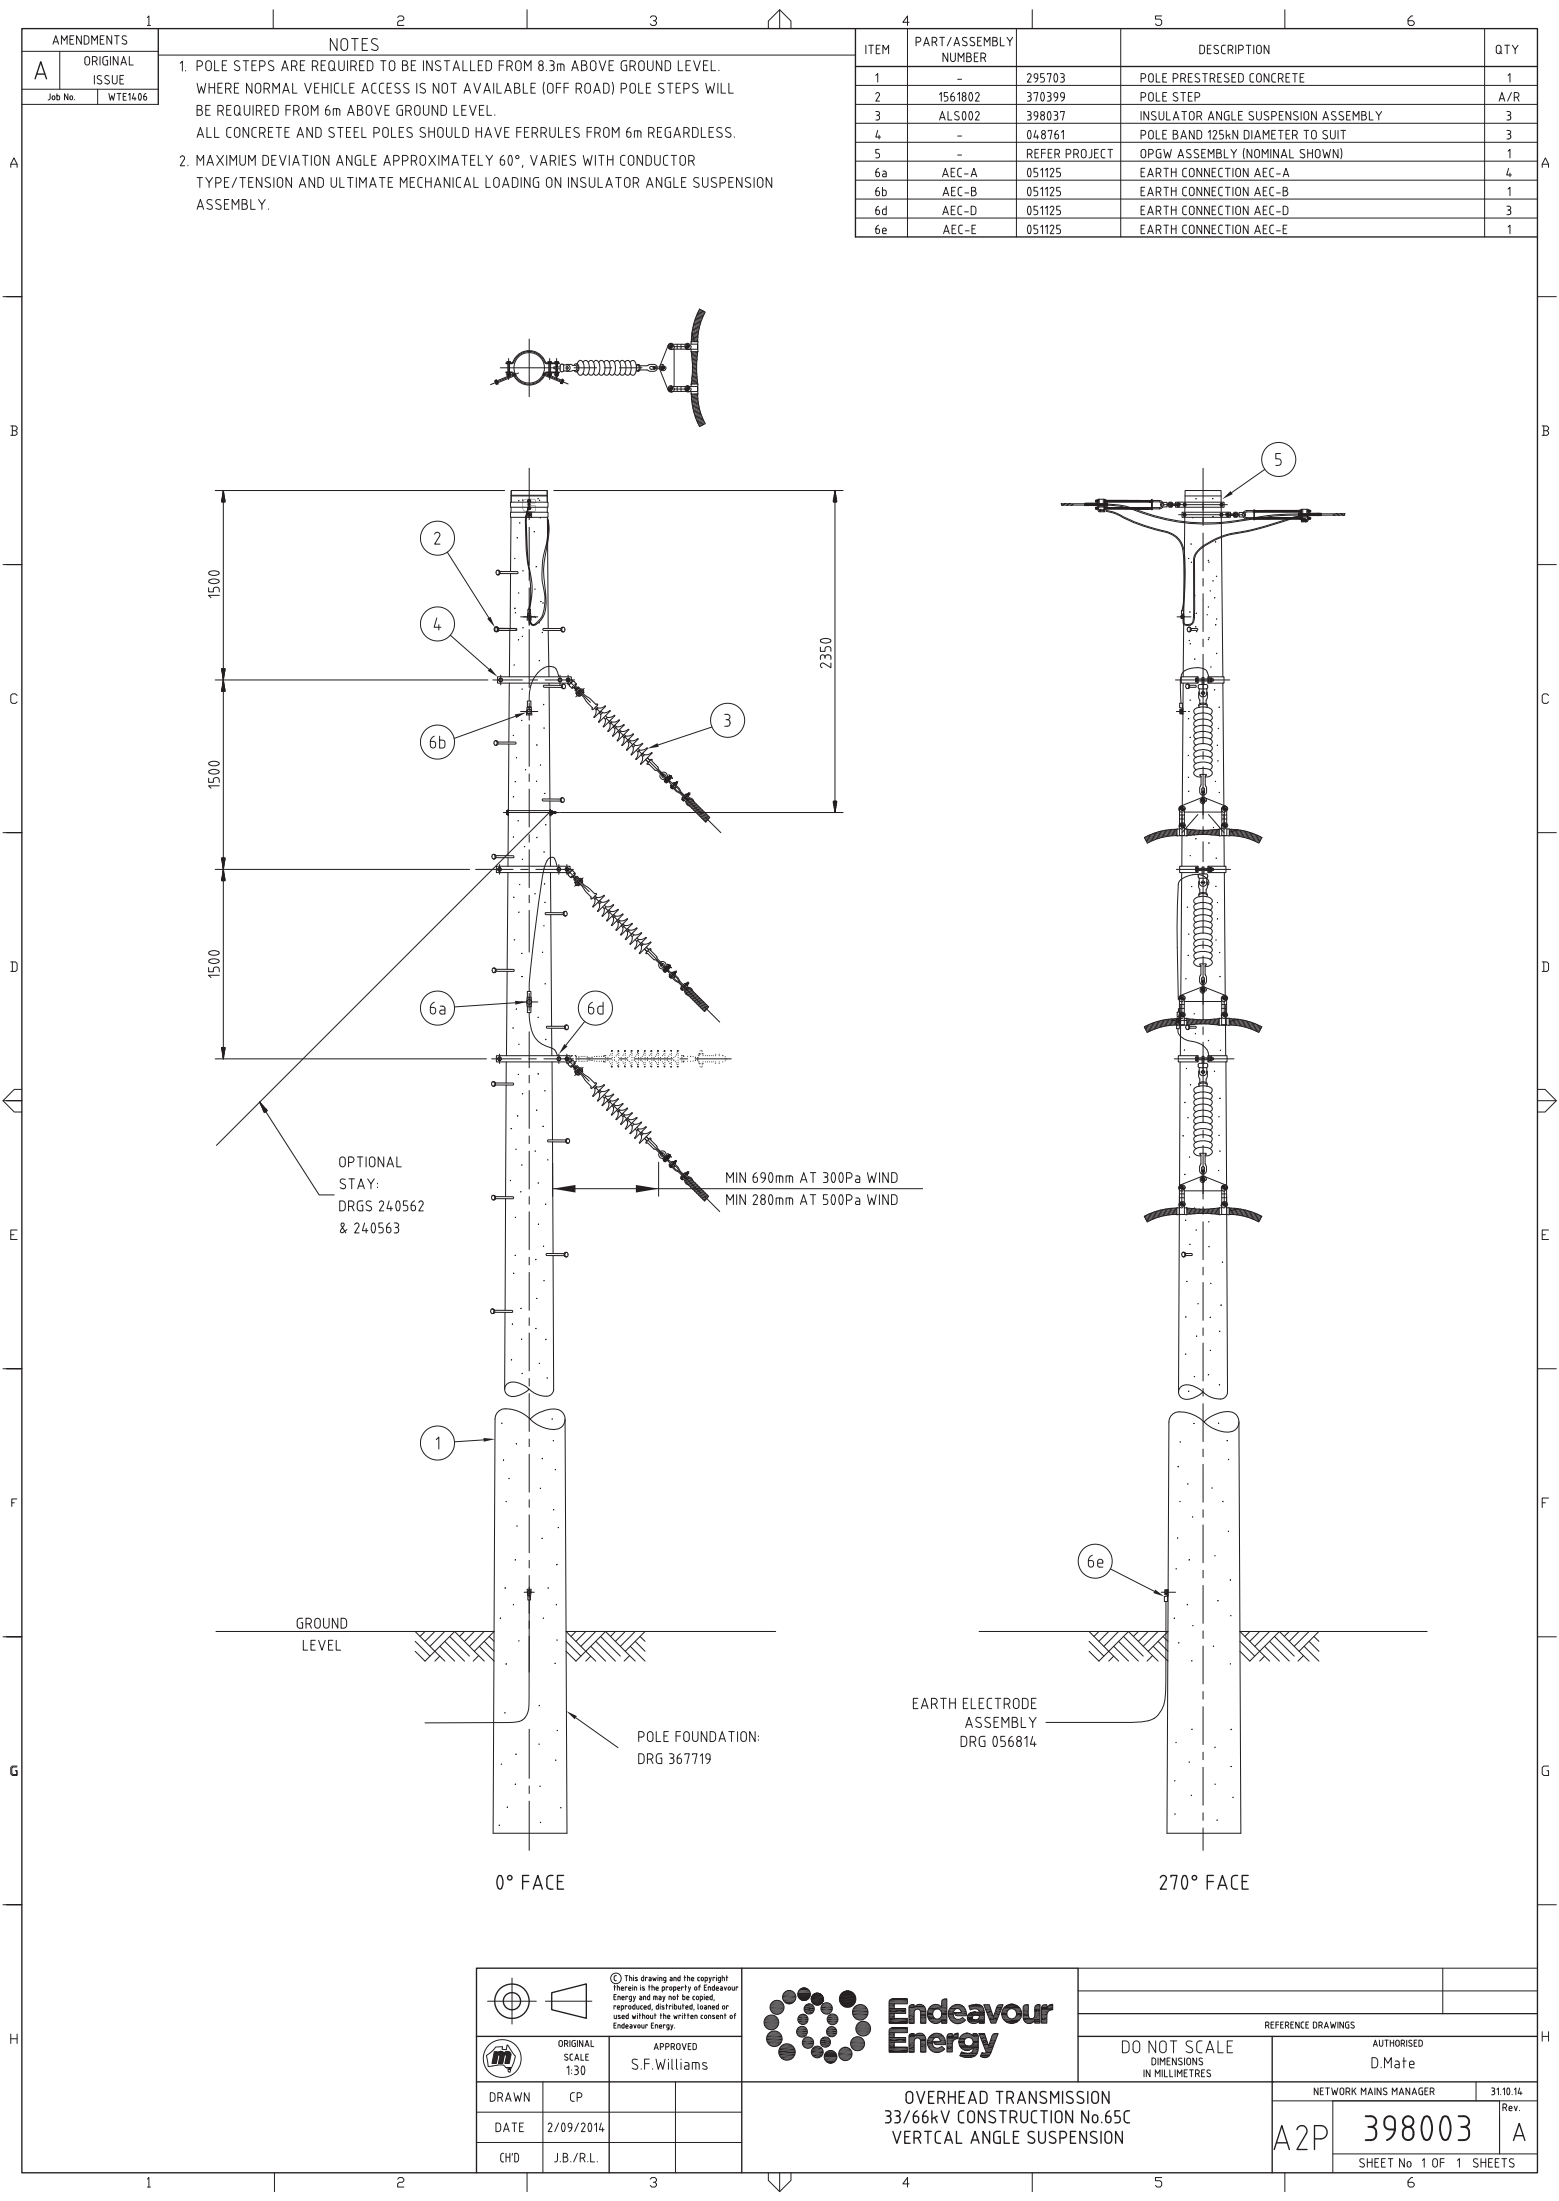

AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTETL06

NOTES

- POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.
- MAXIMUM DEVIATION ANGLE APPROXIMATELY 60°, VARIES WITH CONDUCTOR TYPE/TENSION AND ULTIMATE MECHANICAL LOADING ON INSULATOR ANGLE SUSPENSION ASSEMBLY.

ITEM	PART/ASSEMBLY NUMBER	DESCRIPTION	QTY
1	-	295703 POLE PRESTRESSED CONCRETE	1
2	1561802	370399 POLE STEP	A/R
3	ALS002	398037 INSULATOR ANGLE SUSPENSION ASSEMBLY	3
4	-	048761 POLE BAND 125kN DIAMETER TO SUIT	3
5	-	REFER PROJECT OPGW ASSEMBLY (NOMINAL SHOWN)	1
6a	AEC-A	051125 EARTH CONNECTION AEC-A	4
6b	AEC-B	051125 EARTH CONNECTION AEC-B	1
6d	AEC-D	051125 EARTH CONNECTION AEC-D	3
6e	AEC-E	051125 EARTH CONNECTION AEC-E	1

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
ORIGINAL SCALE 1:30	APPROVED S.F.Williams		
DRAWN CP			
DATE 2/09/2014			
GHD J.B./R.L.			



OVERHEAD TRANSMISSION
33/66kV CONSTRUCTION No.65C
VERTICAL ANGLE SUSPENSION

REFERENCE DRAWINGS			
DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED D.Mate	
SION No.65C NSION		NETWORK MAINS MANAGER 31.10.14	
	A2P	398003	Rev. A
		SHEET No 1 OF 1 SHEETS	