AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTE1406
B	DESIGN N/A
	DR'N K.T.
	CH'D RL/VB
	DATE 22.10.15
TMDM	S.F.W.
DATE 9/4/18	
ITEM 20 PART NUMBER ADDED.	
C	DESIGN N/A
	DR'N TV
	CH'D MA/MB
	DATE 15.12.25
A.E.M.	S.P.
STOCK CODES UPDATED	

NOTES

1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL.
   WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL.
   ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.
2. VISIBLE LOCATION 95mm² INSULATED EARTH ABOVE INSULATED COVER.
3. FIT POLE INSULATING COVER OVER CABLE GARD & FIX WITH S/STEEL STRAP. IF REQUIRED IN EARTHING REPORT.
4. CHECK CABLE SCREEN EARTHING REQUIREMENT.
5. IF AREA SURROUNDING POLE IS EXCAVATED FOR INSTALLATION OF CABLE:
   -POLE MAY REQUIRE TEMPORARY SUPPORT/STABILISATION
   -BACKFILL TO BE COMPACTED

ITEM	PART	DRG	DESCRIPTION	QTY
1	-	288603	POLE PRESTRESSED CONCRETE	1
2	1000006147	370399	STEP,POLE,HEX,M16x180MM(L),50MM(T),+NUTS	A/R
3	ALR002	398038	INSULATOR LONG ROD ASSEMBLY	3
4	-	-	OPGW ASSEMBLY TYPE AS PER PROJECT DWG.	1
5	1000006090	259304	PROTECTOR,CABLE,COVER,LONG TPR,3300x1228	1
6	1000005436	-	CLAMP,CABLE,UNIV,50-200MM(D) CABLE	18
7	1000006092	077162	BRACKET,MTG,SUP,GALV,33/66KV POLYMERIC,S	3
8	1000006091	078931	BRACKET,MTG,SUP,GALV,6KV POLYMERIC SURGE	3
9	1000005413	-	ARRESTER,SURGE,30KV,GND SIDE PED MTG,EFF	3
10	SEETABLE 1	-	33kV CABLE TERMINATION HEATSHRINK XLPE OUTDOOR	3
11	SEE TABLE 2	-	LUG CABLE	3
12	SEE TABLE	399844	LUG CONDUCTOR	3
13	SEE TABLE 3	-	CLAMP CABLE TO SUIT CABLE DIA	3
14a	AEC-A	051125	EARTH CONNECTION AEC-A	1
14e	AEC-E	051125	EARTH CONNECTION AEC-E	1
15	ACP005	240600	M20 EYEBOLT ASSEMBLY FOR CONCRETE POLE	3
16	1000005412		ARRESTER,SURGE DIVERTER,6KV,10KA,100KVA	3
17	1000006220	380808	PROTECTOR,CABLE,COVER,720MM(W),460MM(D)	4
18	1000007437	-	STRAPPING,BAND-IT,19MM(W),30M(L),SSTEEL	A/R
19	-	-	BOLT STEEL GALV M12 x 40	12
20	1000006472	-	WASHER,BEVEL,SQ,WEDGE SHAPE,D TPR,M12,40	A/R

POLE STEP
ANGLE 120°

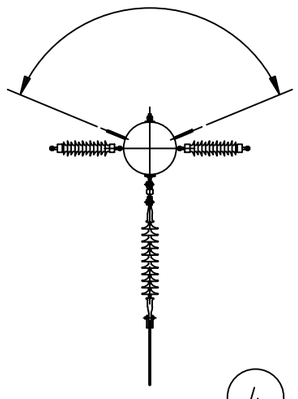


TABLE 1


CABLE	STOCK NUMBER
630mm 33kV CABLE TERMINATION	1000005407
800mm 33kV CABLE TERMINATION	1000005407
1200mm 33kV CABLE TERMINATION	1000005408


TABLE 2

CABLE	STOCK NUMBER
630mm 33kV CABLE LUG	1000005669
800mm 33kV CABLE LUG	1000001905
1200mm 33kV CABLE LUG	1000003250

TABLE 3

CABLE DIA RANGE	STOCK NUMBER
55mm - 60mm	1000007539
63mm - 70mm	1000007536
70mm - 75mm	-
80mm - 85mm	1000001893
0mm - 84mm	1000008089

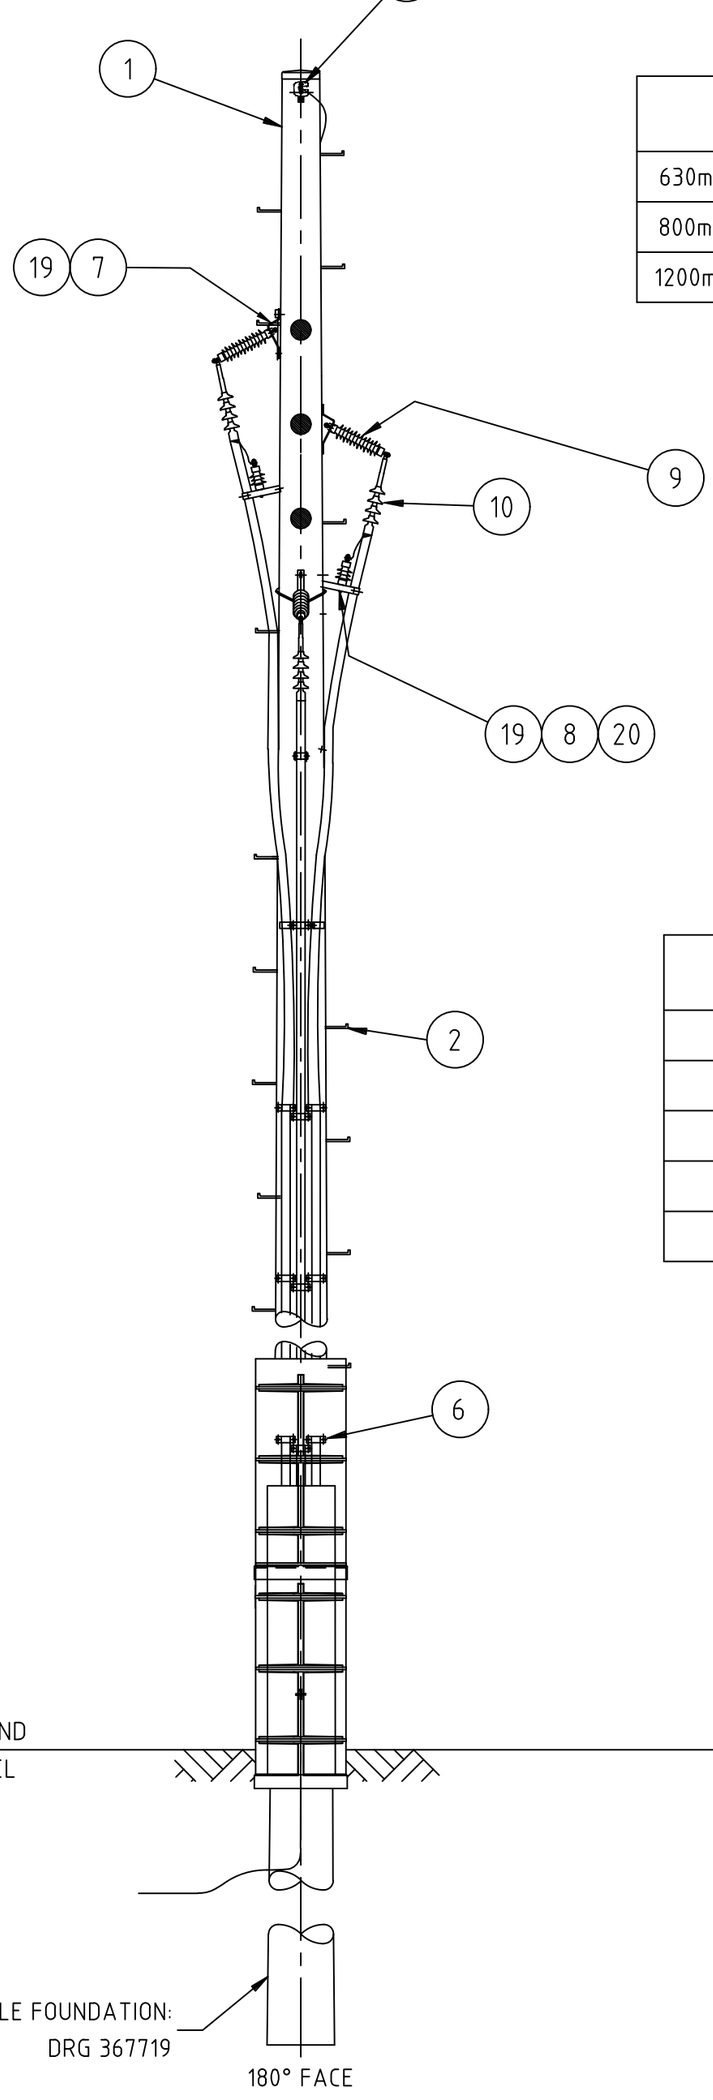

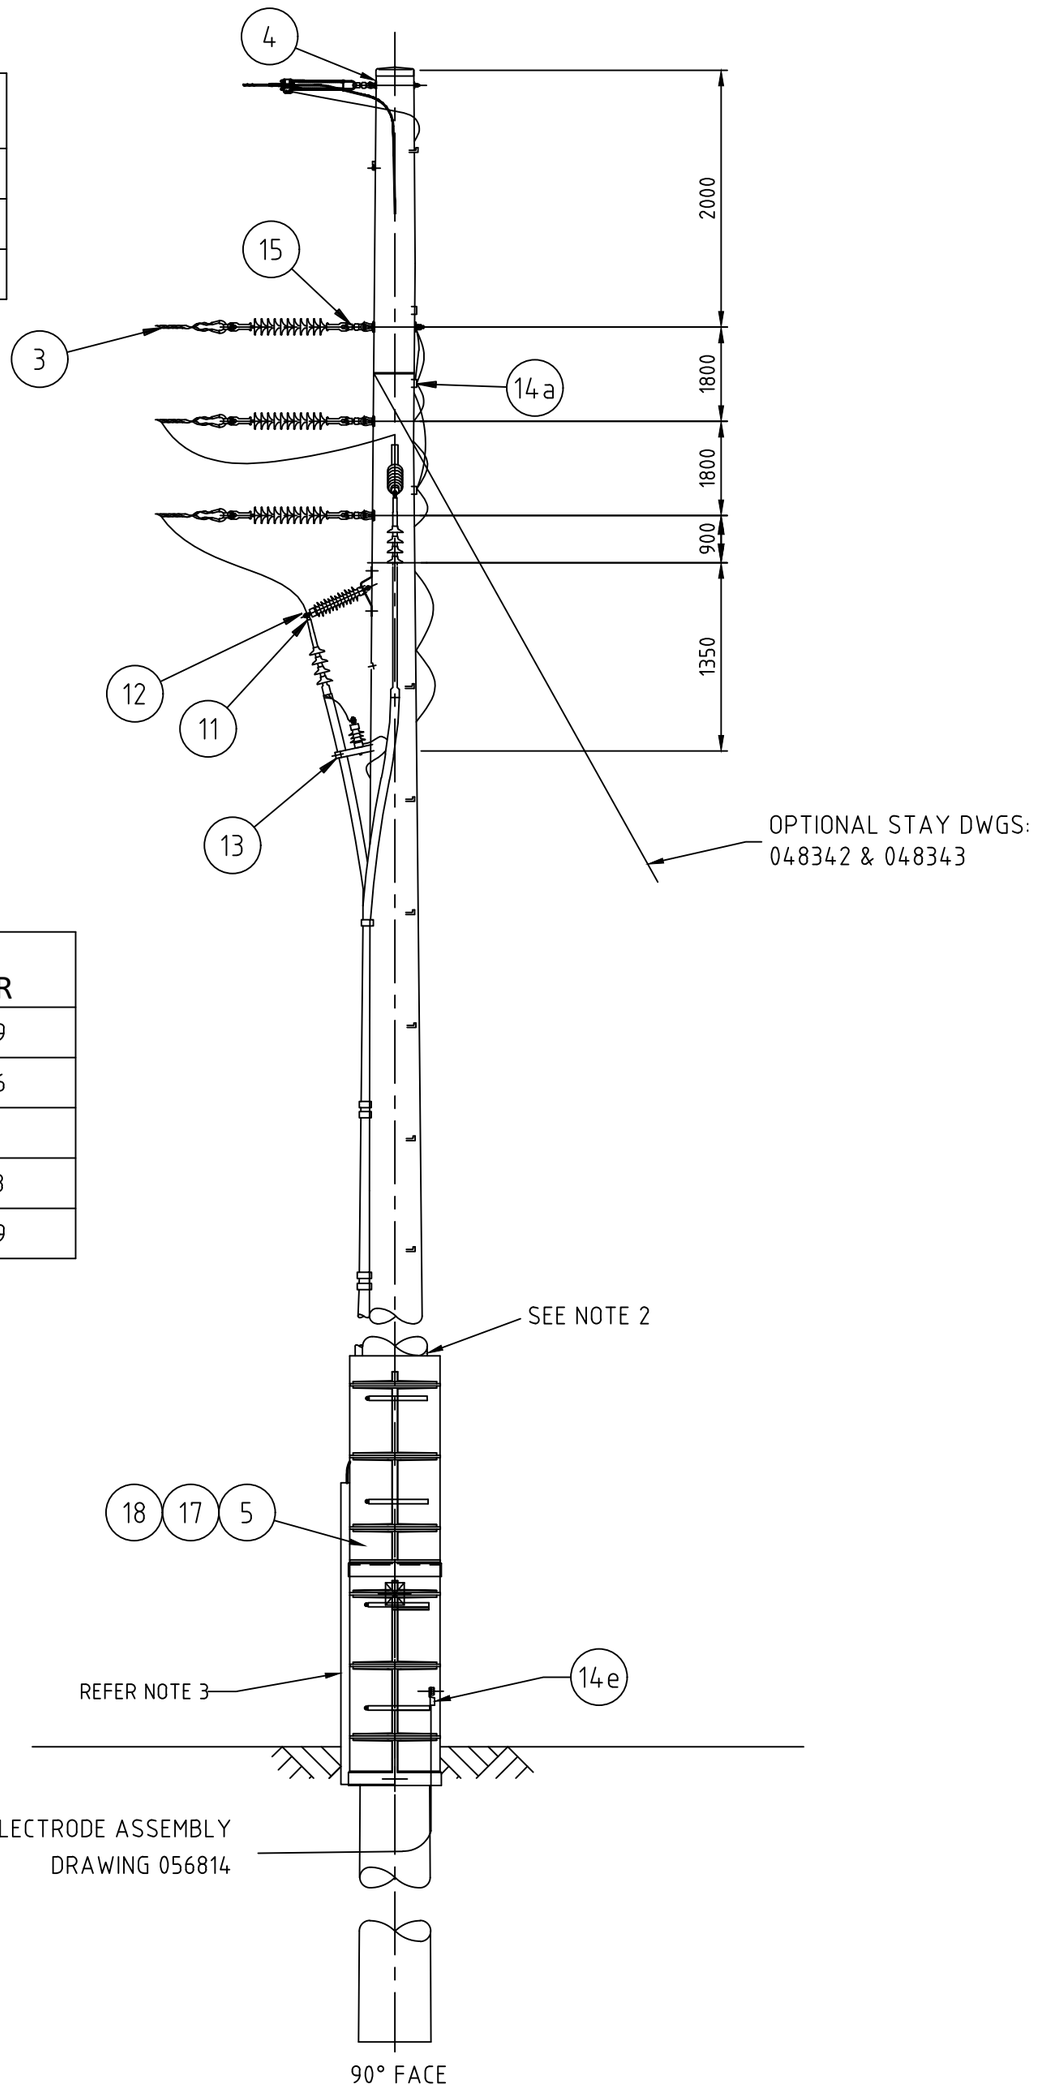

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE NIL		APPROVED S.F.Williams	
DRAWN	CP		
DATE	4/09/2014		
CH'D	J.B./R.L.		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
D.Mate
NETWORK MAINS MANAGER 31.10.14

OVERHEAD TRANSMISSION
33kV CONSTRUCTION No. 50VC UG/OH
VERTICAL TERMINATION

A2P 398008 Rev. C
SHEET No 1 OF 1 SHEETS