


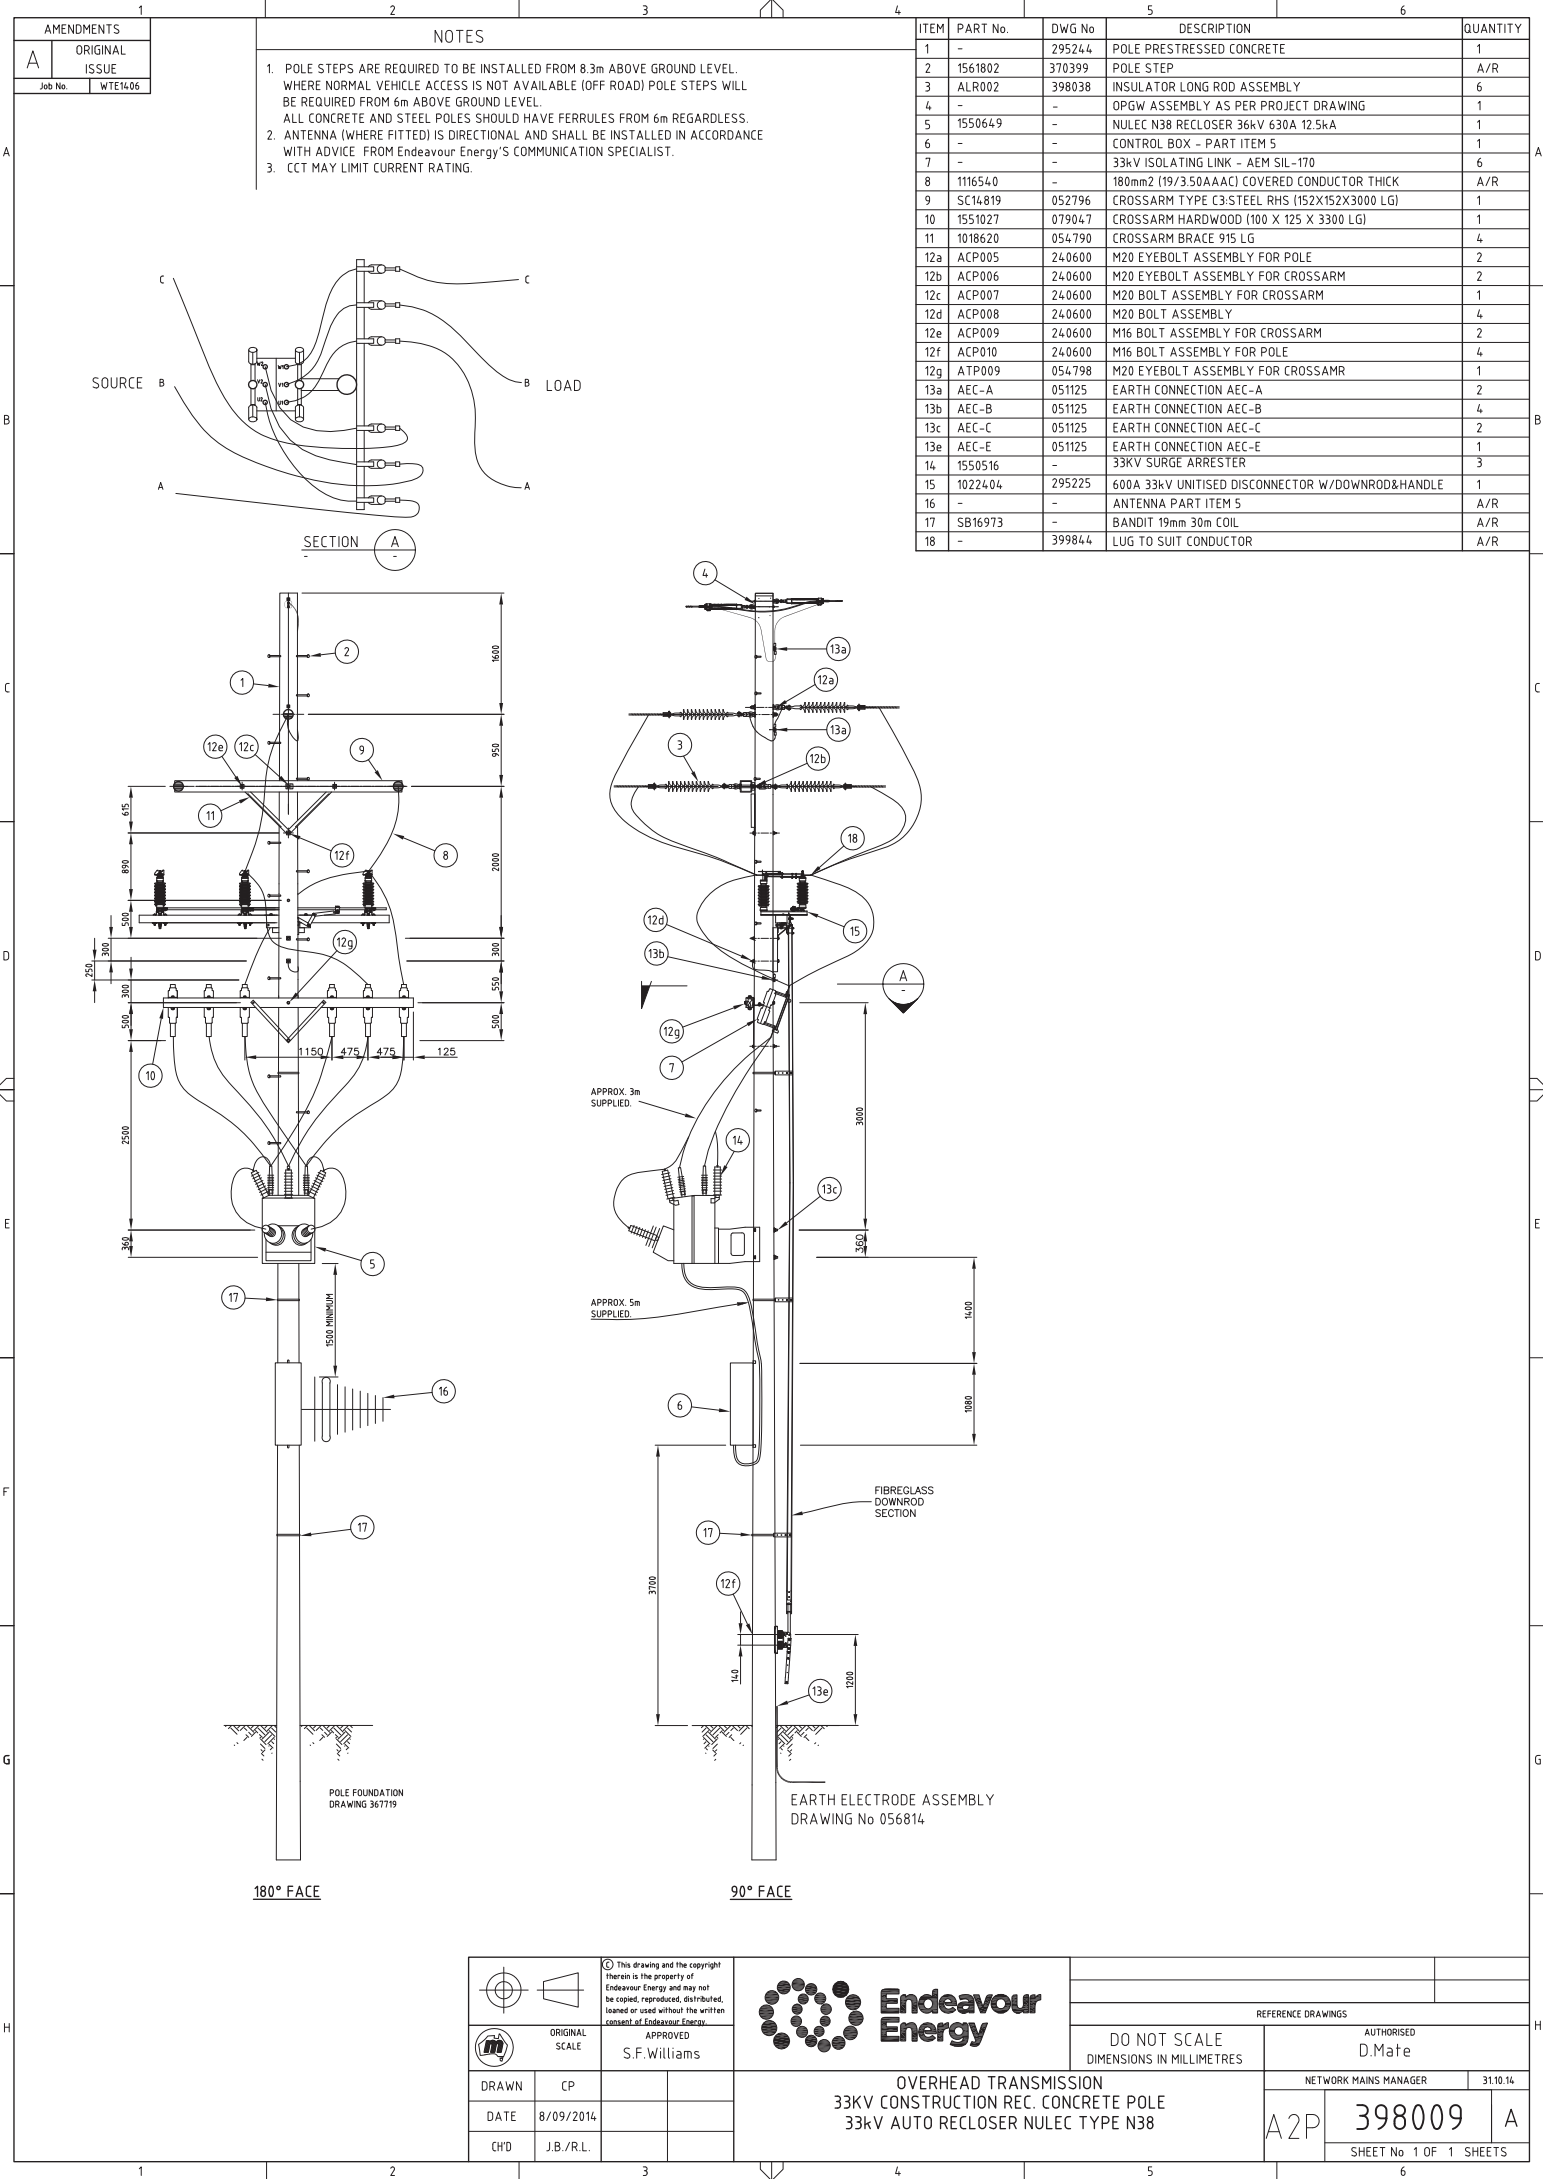

AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTE14.06

NOTES

- POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.
- ANTENNA (WHERE FITTED) IS DIRECTIONAL AND SHALL BE INSTALLED IN ACCORDANCE WITH ADVICE FROM Endeavour Energy'S COMMUNICATION SPECIALIST.
- CCT MAY LIMIT CURRENT RATING.

ITEM	PART No.	DWG No	DESCRIPTION	QUANTITY
1	-	295244	POLE PRESTRESSED CONCRETE	1
2	1561802	370399	POLE STEP	A/R
3	ALR002	398038	INSULATOR LONG ROD ASSEMBLY	6
4	-	-	OPGW ASSEMBLY AS PER PROJECT DRAWING	1
5	1550649	-	NULEC N38 RECLOSER 36kV 630A 12.5kA	1
6	-	-	CONTROL BOX - PART ITEM 5	1
7	-	-	33kV ISOLATING LINK - AEM SIL-170	6
8	1116540	-	180mm2 (19/3.50AAAC) COVERED CONDUCTOR THICK	A/R
9	SC14.819	052796	CROSSARM TYPE C3-STEEL RHS (152X152X3000 LG)	1
10	1551027	079047	CROSSARM HARDWOOD (100 X 125 X 3300 LG)	1
11	1018620	054790	CROSSARM BRACE 915 LG	4
12a	ACP005	240600	M20 EYEBOLT ASSEMBLY FOR POLE	2
12b	ACP006	240600	M20 EYEBOLT ASSEMBLY FOR CROSSARM	2
12c	ACP007	240600	M20 BOLT ASSEMBLY FOR CROSSARM	1
12d	ACP008	240600	M20 BOLT ASSEMBLY	4
12e	ACP009	240600	M16 BOLT ASSEMBLY FOR CROSSARM	2
12f	ACP010	240600	M16 BOLT ASSEMBLY FOR POLE	4
12g	ATP009	054798	M20 EYEBOLT ASSEMBLY FOR CROSSAMR	1
13a	AEC-A	051125	EARTH CONNECTION AEC-A	2
13b	AEC-B	051125	EARTH CONNECTION AEC-B	4
13c	AEC-C	051125	EARTH CONNECTION AEC-C	2
13e	AEC-E	051125	EARTH CONNECTION AEC-E	1
14	1550516	-	33kV SURGE ARRESTER	3
15	1022404	295225	600A 33kV UNITISED DISCONNECTOR W/DOWNROD&HANDLE	1
16	-	-	ANTENNA PART ITEM 5	A/R
17	SB16973	-	BANDIT 19mm 30m COIL	A/R
18	-	399844	LUG TO SUIT CONDUCTOR	A/R



Endeavour Energy

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

APPROVED
S.F.Williams

ORIGINAL SCALE

DRAWN	CP
DATE	8/09/2014
CHD	J.B./R.L.

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS

398009	A
--------	---

OVERHEAD TRANSMISSION
33kV CONSTRUCTION REC. CONCRETE POLE
33kV AUTO RECLOSER NULEC TYPE N38

AUTHORISED
D.Mate

NETWORK MAINS MANAGER

31.10.14

SHEET No 1 OF 1 SHEETS