


1		2		3		4		5		6				
AMENDMENTS			NOTES					ITEM	PART/ASSEMBLY NUMBER	DRG Nos.	DESCRIPTION	QTY		
A		ORIGINAL ISSUE						1.	POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.	1	-	REFER PROJECT	POLE GALVANISED STEEL	1
Job No.								2.	STRUCTURE TO BE ERECTED SO THAT POLE TOPS ARE LEVEL & CROSSARM IS HORIZONTAL.	2	1000001983	056304	XARM,METAL,RHS,6300x152x152MM,6.3MM(T)	1
B	DESIGN	N/A						3.	MINIMUM CLEARANCE FROM ANY BONDS/DROPPERS TO BE AT LEAST 690mm FROM EARTHED SECTIONS.	3	1000000468	054790	BRACE,XARM,ANG,TYPE 3H,GALV,2 X M18	2
	DR'N	NK						4.	FOUNDATION DEPTH BASED ON 14/24 POLE	4	ALR002	398038	INSULATOR LONG ROD ASSEMBLY	3
	CH'D	MA/MB								5	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	2
	DATE	15.10.25								6b	AEC-B	051125	EARTH CONNECTION AEC-B	2
A.E.M.		S.P.								6e	AEC-E	051125	EARTH CONNECTION AEC-E	2
STOCK CODES UPDATED										7a	ASP006	398036	M20 EYEBOLT ASSEMBLY FOR CROSSARM	3
										7b	ASP007	398036	M20 BOLT ASSEMBLY FOR CROSSARM	2
					7c	ASP009	398036	M16 BOLT ASSEMBLY FOR CROSSARM BRACE	2					
					7d	ASP010	398036	M16 BOLT ASSEMBLY FOR CROSSARM BRACE	2					

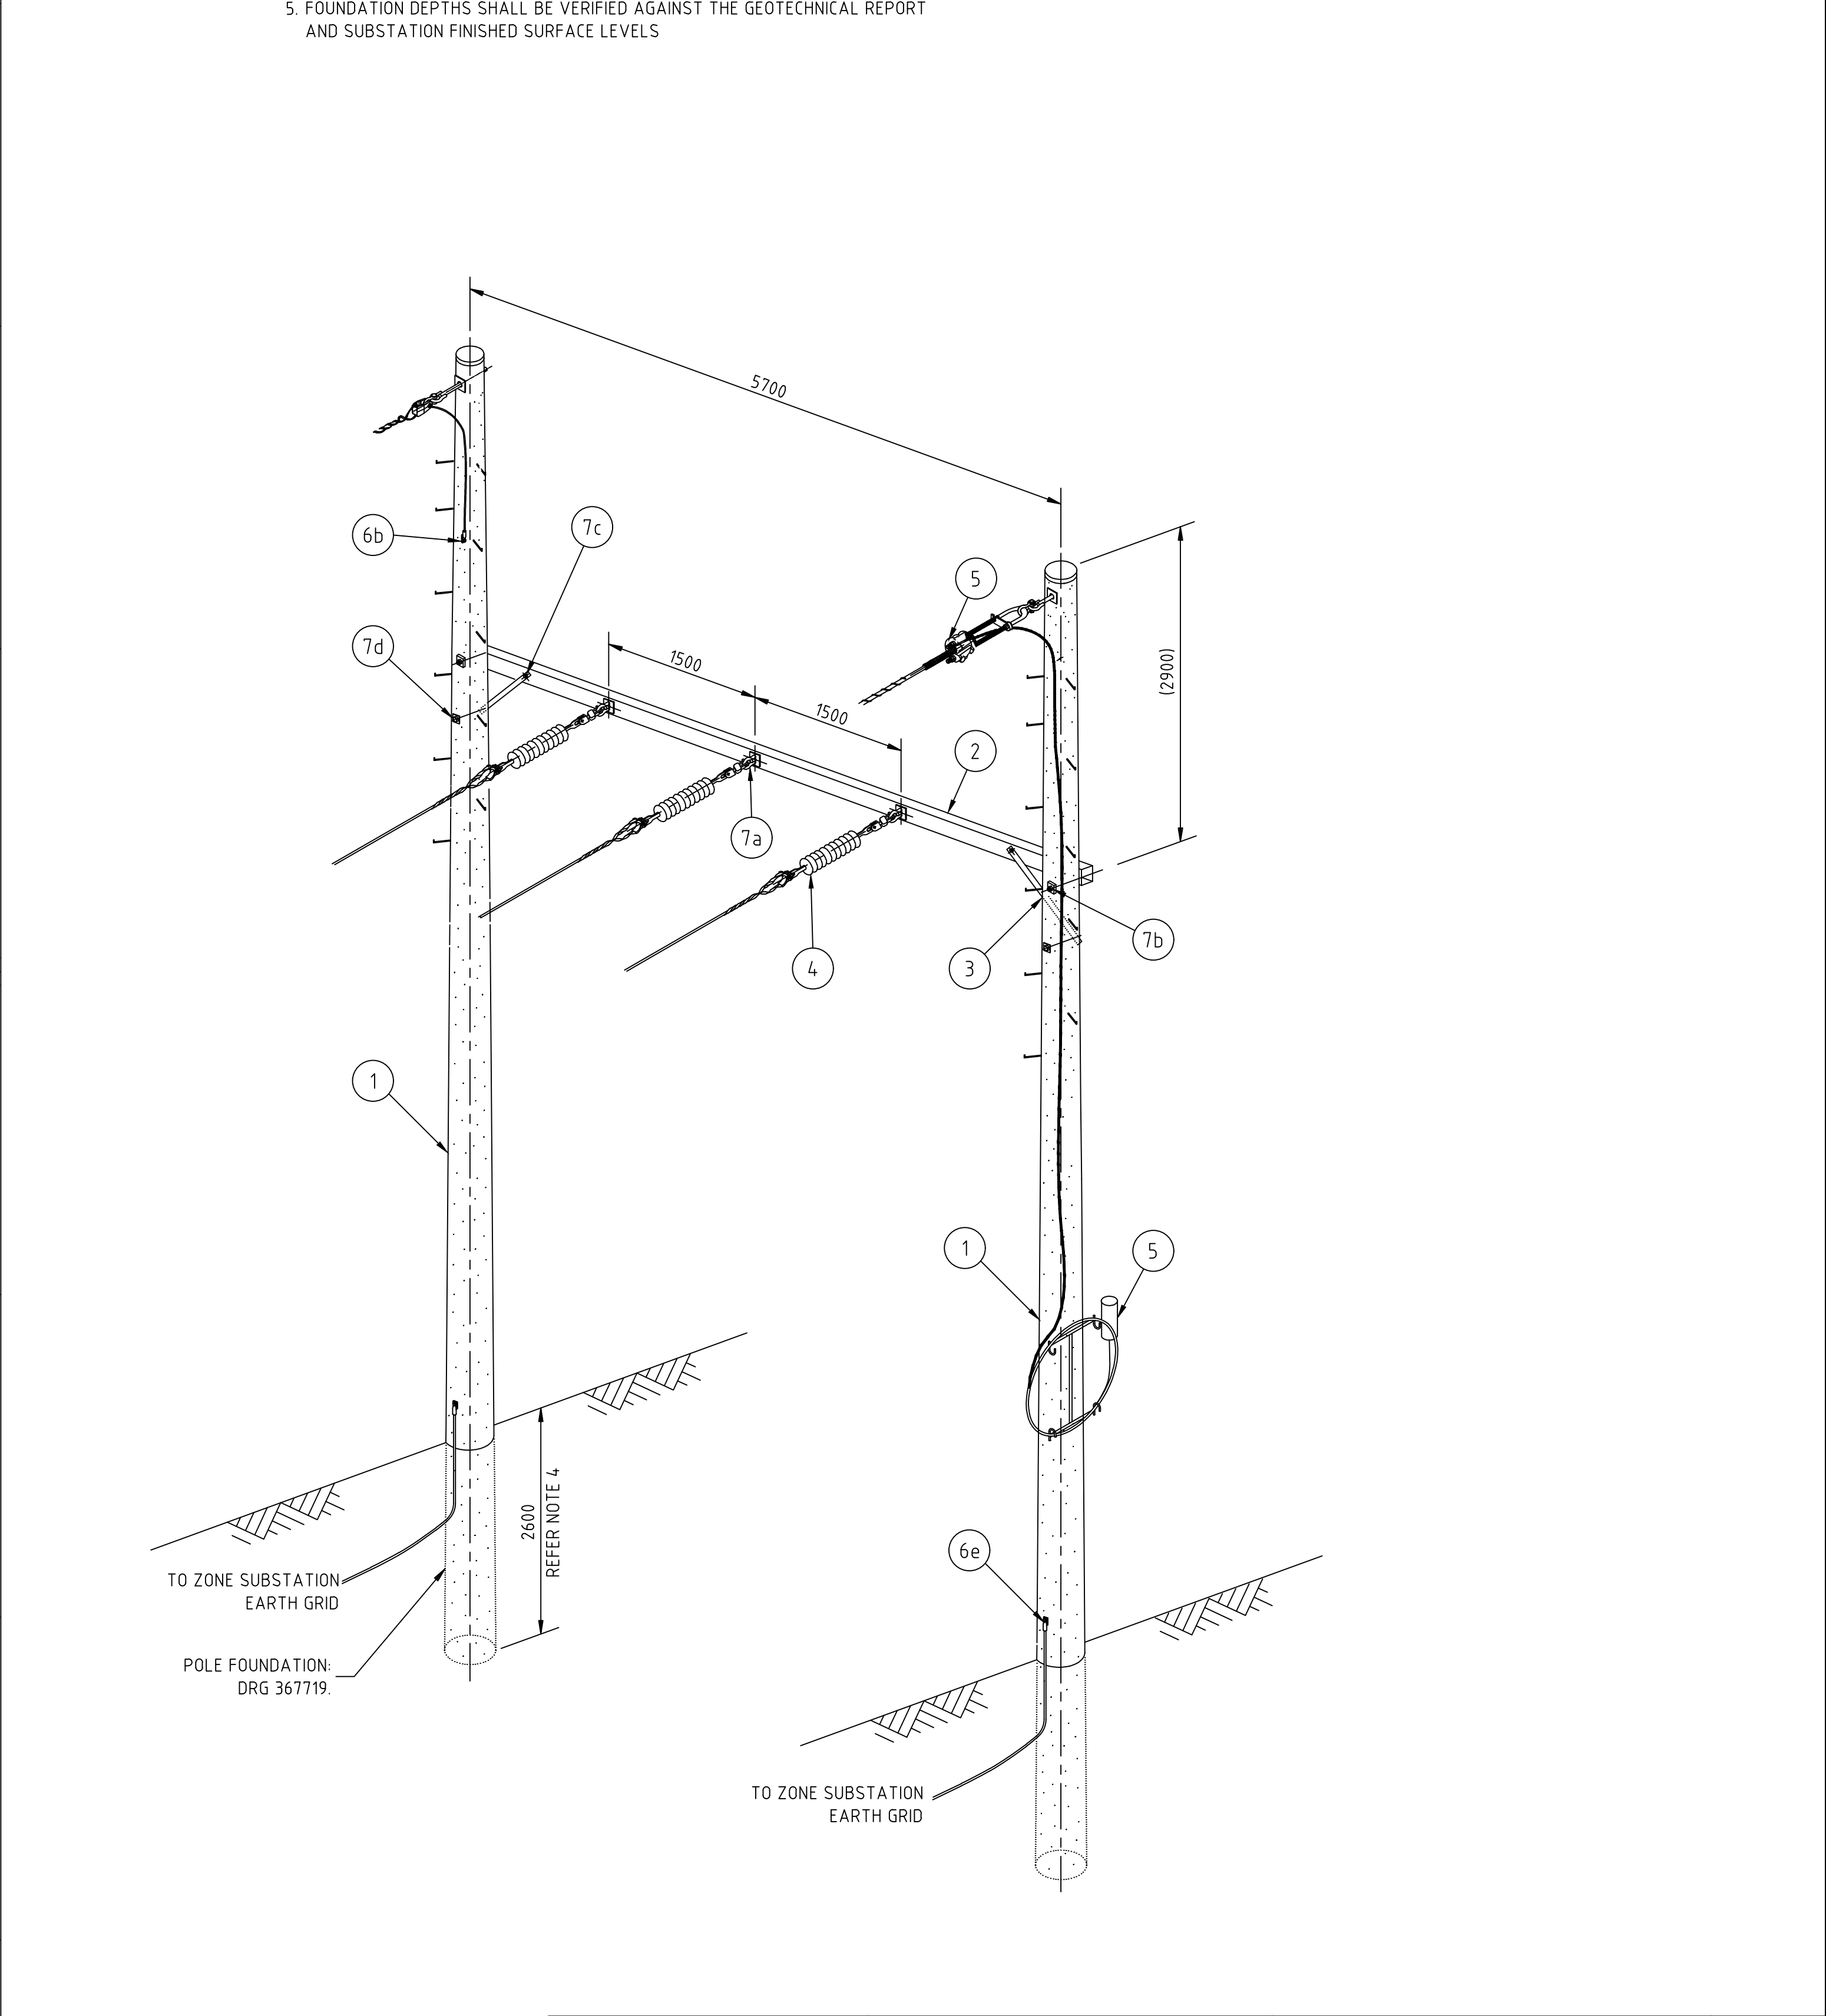

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.							
		ORIGINAL SCALE NONE	APPROVED S.F.Williams		DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED D.Mate		
DRAWN	CP			OVERHEAD TRANSMISSION 33/66kV SUBSTATION LANDING STRUCTURE 2 POLE STEEL		NETWORK MAINS MANAGER			
DATE	4/09/2014					31.10.14			
CH'D	J.B./R.L.					Rev.			
						A2P	398017		
						SHEET No 1 OF 1 SHEETS			