AMENDMENTS	
A	ORIGINAL ISSUE

Job No.	
B	DESIGN: N/A
	DR'N: NK
	CH'D: MA/MB
	DATE: 15.10.25
A.E.M.: S.P.	
STOCK CODES UPDATED	

NOTES

1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL.
2. LINE POST INSULATOR (ITEM 4) TO BE LOCATED INSIDE ANGLE TO MINIMISE BOND LENGTH.

ITEM	PART/ASSEMBLY NUMBER	DRG Nos.	DESCRIPTION	QTY
1	-	REFER PROJECT	POLE TIMBER	1
2	1000000477	015357	STEP,POLE,WOOD,M16x260MM(L),GALV	A/R
3	ALR003	398038	INSULATOR LONG ROD ASSEMBLY	6
4	ALP004	398035	INSULATOR LINE POST ASSEMBLY BONDING	3
5	SEE TABLE	399844	SLEEVE NON TENSION TO SUIT CONDUCTOR	3
6	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
7a	ATP002	054798	M20 BOLT ASSEMBLY FOR LINE POST INSULATOR	6
7b	ATP006	054798	M20 EYEBOLT ASSEMBLY	6
7c	ATP012	054798	INSULATED DOWN LEAD ASSEMBLY	1

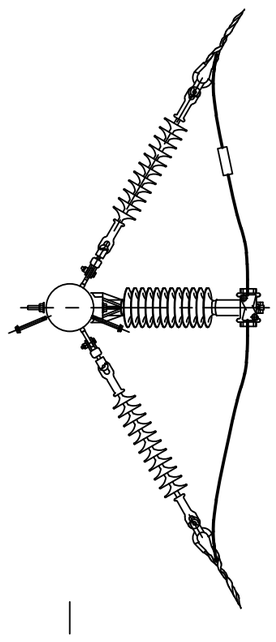

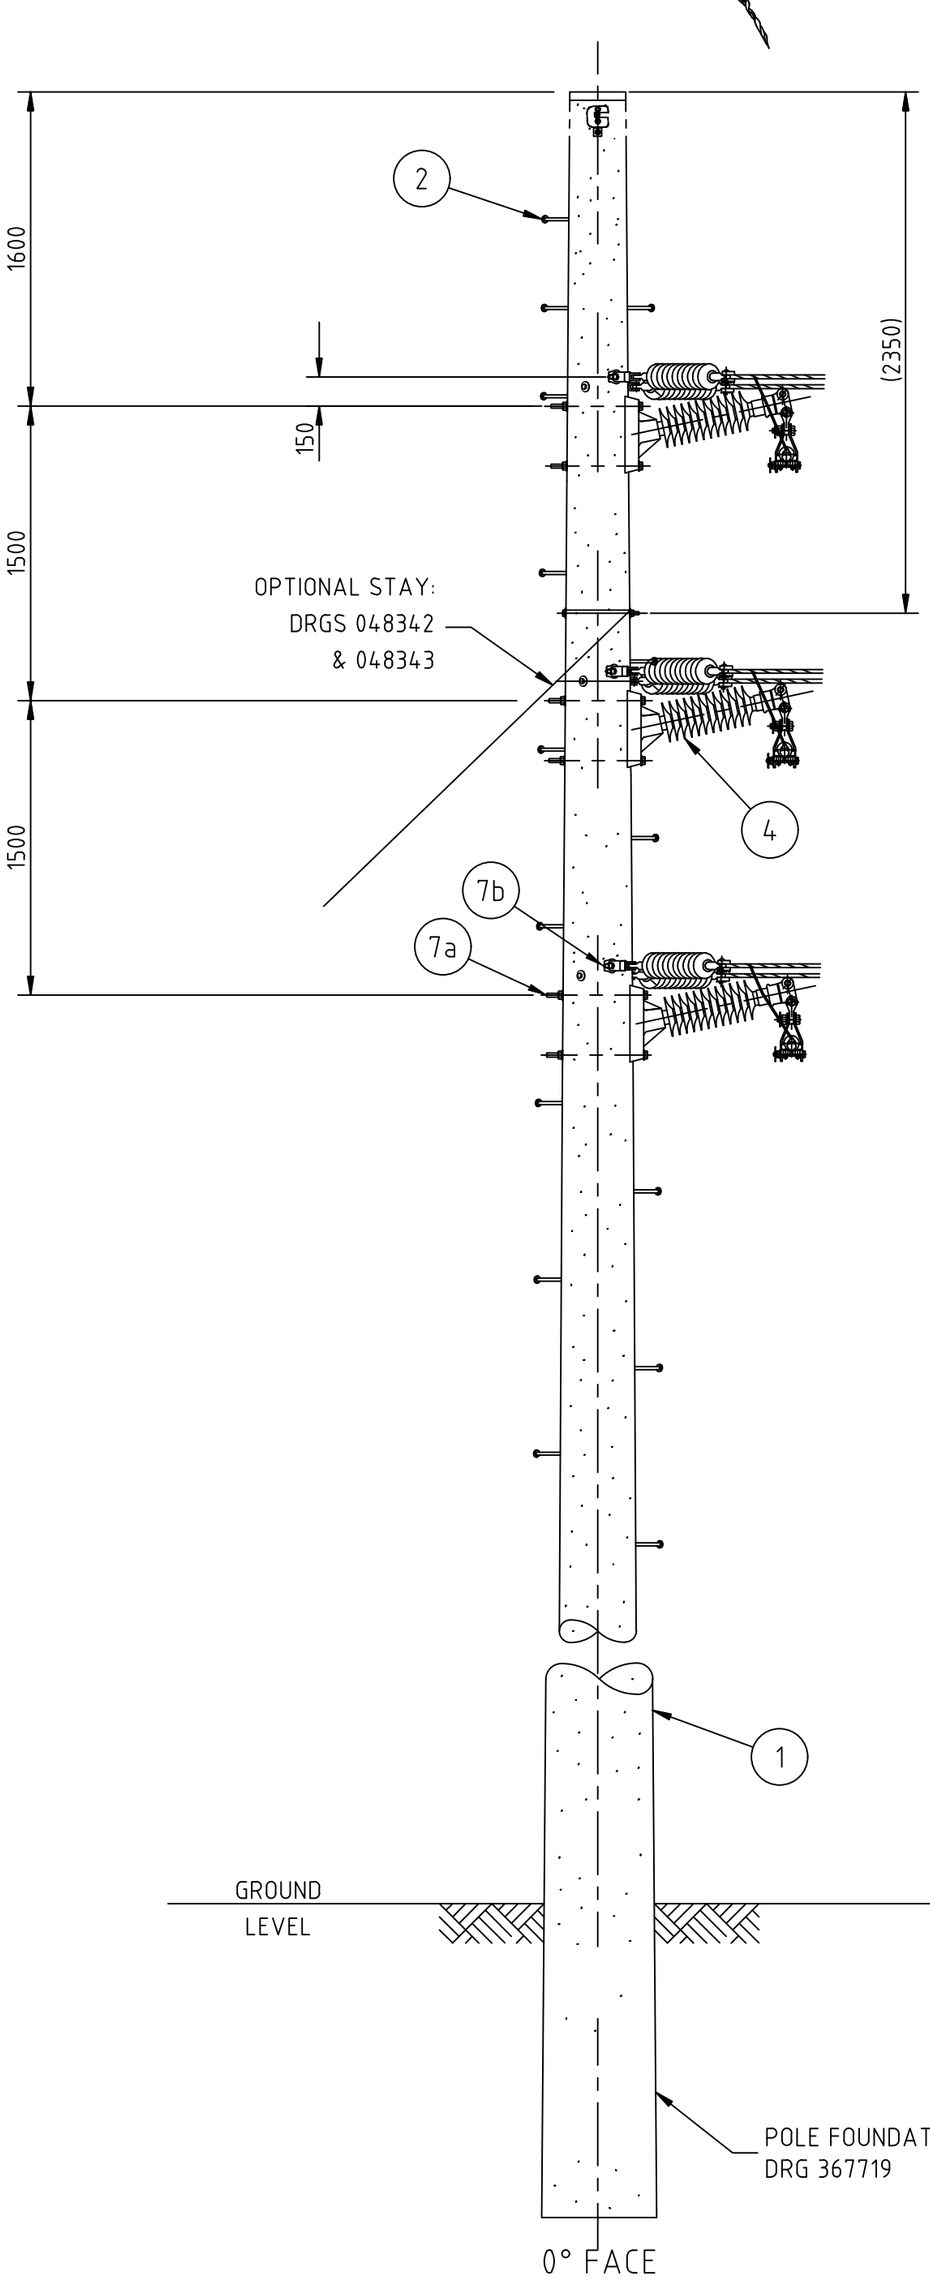

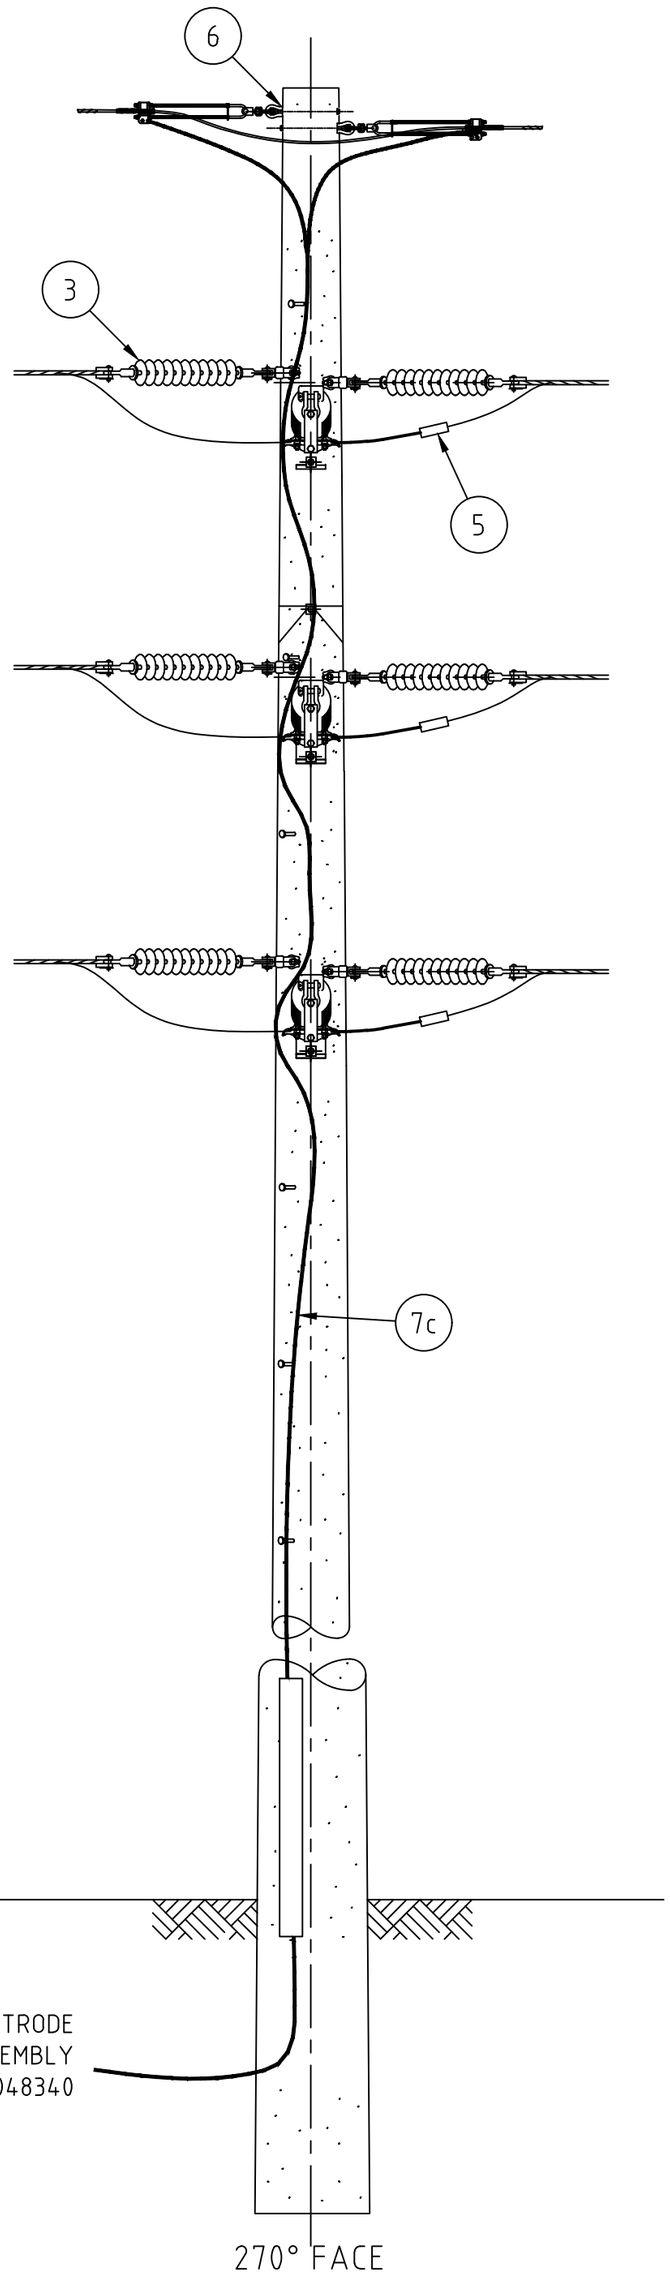

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

Endeavour Energy

REFERENCE DRAWINGS

ORIGINAL SCALE	APPROVED	DO NOT SCALE	AUTHORISED
NTS	S.F.Williams	DIMENSIONS IN MILLIMETRES	D.Mate

DRAWN	CP		
DATE	2/09/2014		
CH'D	J.B./R.L.		

OVERHEAD TRANSMISSION
33/66kV CONSTRUCTION No.63T
VERTICAL THROUGH STRAIN
DEVIATION 0-60 DEGREES

NETWORK MAINS MANAGER 31.10.14

A2P 398025 Rev. B

SHEET No 1 OF 1 SHEETS