AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	
B	DESIGN: N/A
	DR'N: NK
	CH'D: MA/MB
	DATE: 15.10.25
A.E.M.	S.P.
STOCK CODES UPDATED	

NOTES

1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL.

ITEM	PART/ASSEMBLY NUMBER	DRG Nos.	DESCRIPTION	QTY
1	-	REFER PROJECT	POLE TIMBER	1
2	1000000477	015357	STEP,POLE,WOOD,M16x260MM(L),GALV	A/R
3	ALR002	398035	INSULATOR LONG ROD ASSEMBLY	6
4	SEE TABLE	399844	SLEEVE NON TENSION TO SUIT CONDUCTOR	3
5	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
6a	ATP006	054798	M20 EYEBOLT ASSEMBLY	6
6b	ATP012	054798	INSULATED DOWN LEAD ASSEMBLY	1

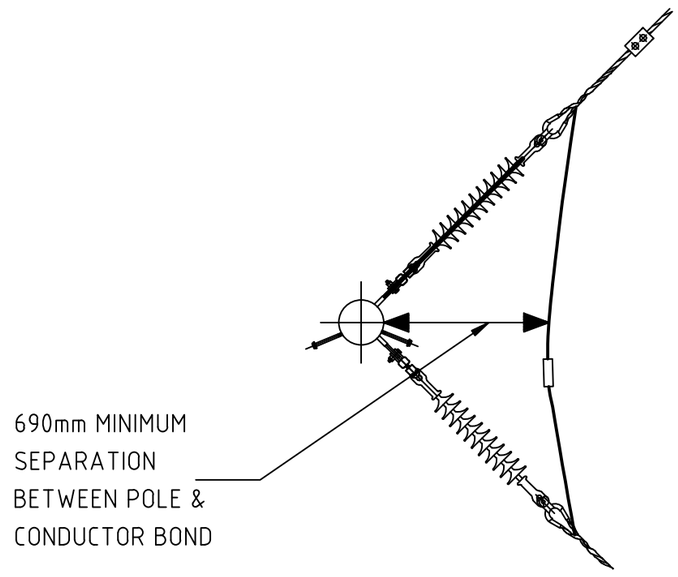

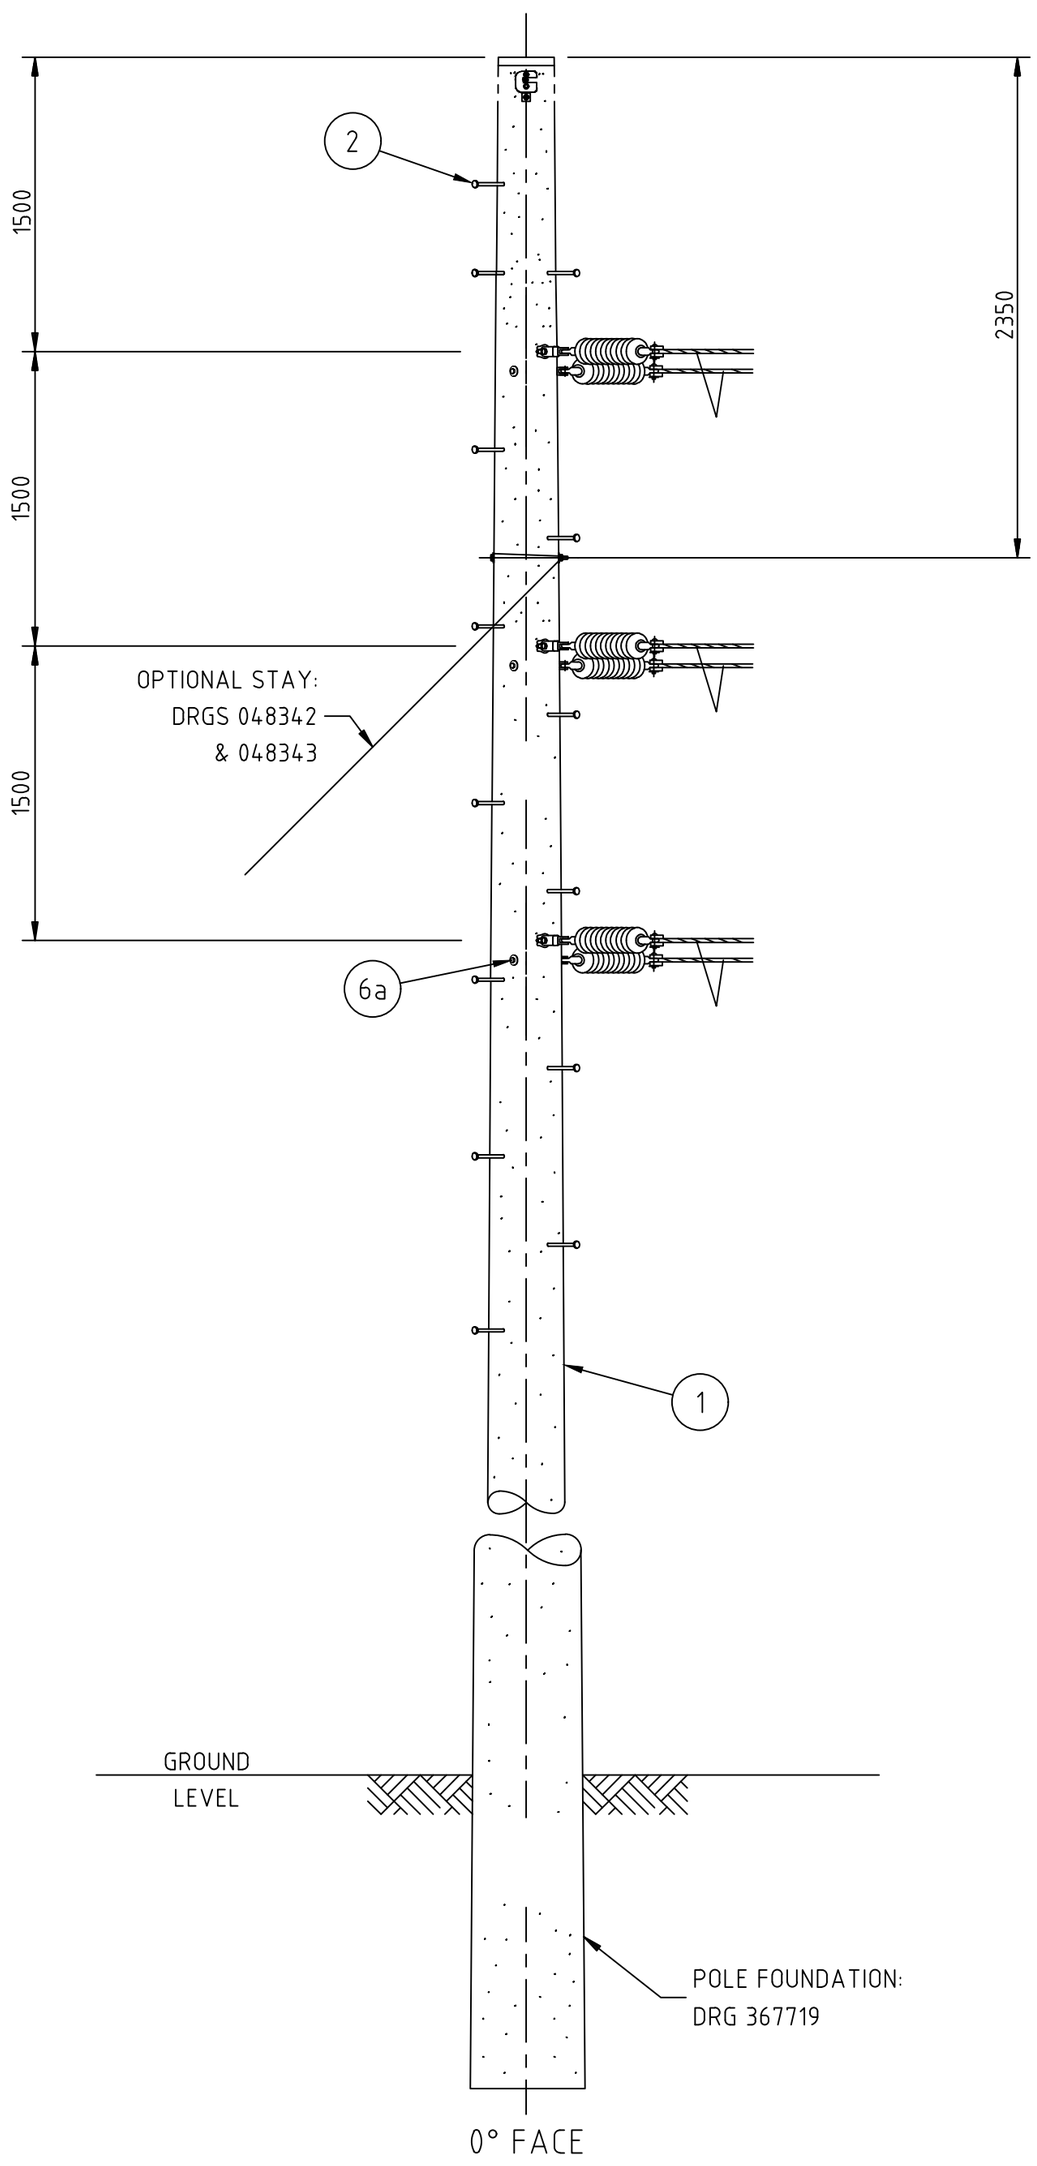

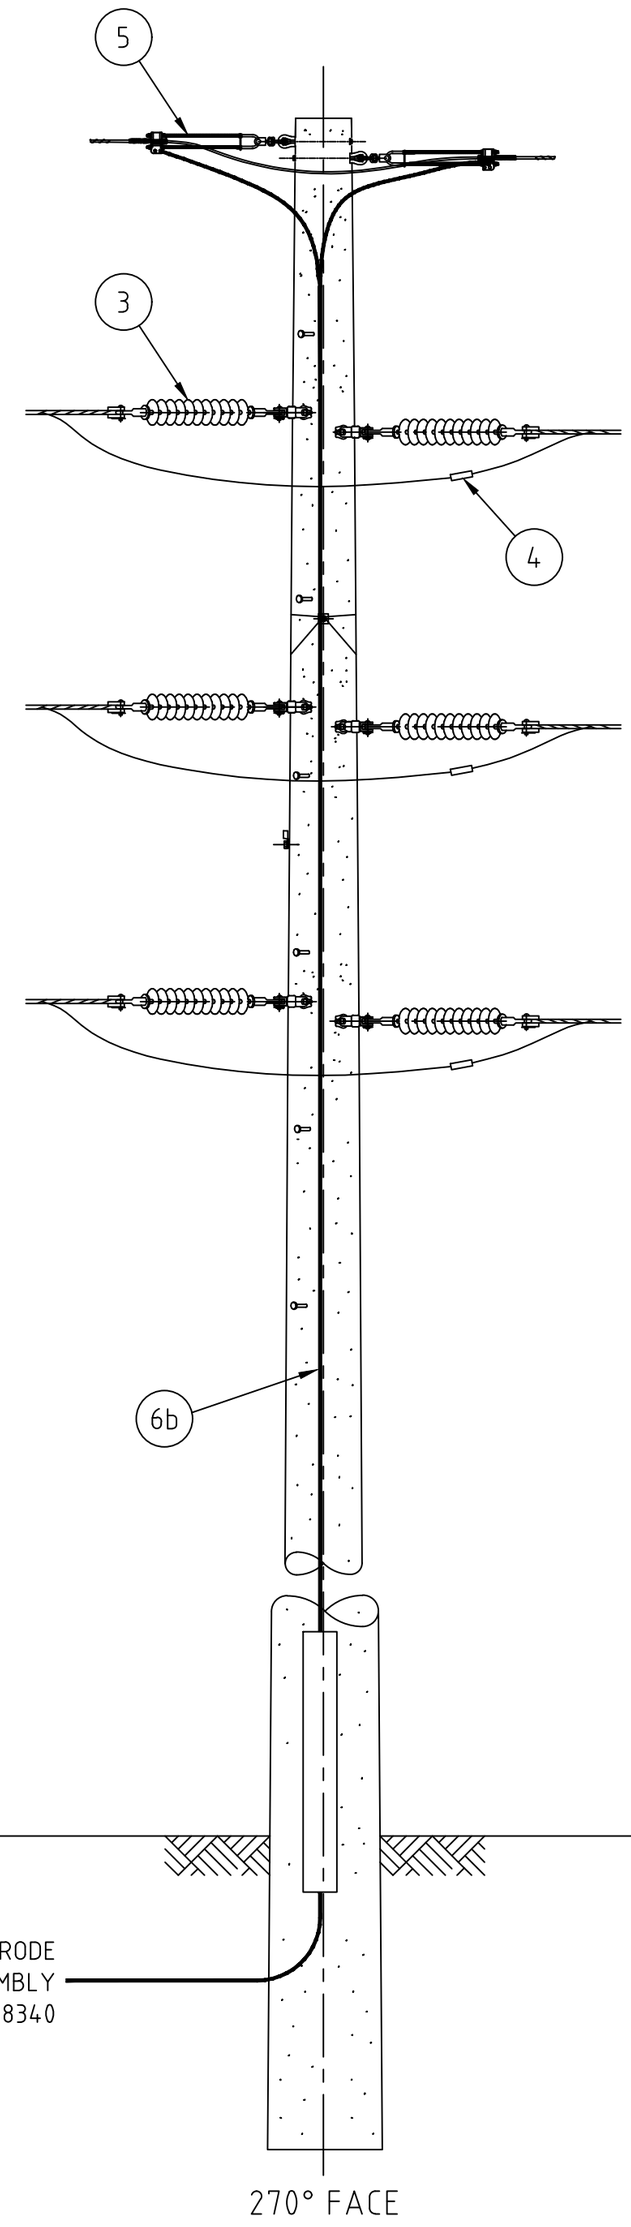

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE NTS		APPROVED S.F.Williams	
DRAWN	CP		
DATE	2/09/2014		
CH'D	J.B./R.L.		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
D.Mate

NETWORK MAINS MANAGER 31.10.14

OVERHEAD TRANSMISSION 33/66kV CONSTRUCTION No.64T VERTICAL THROUGH STRAIN DEVIATION 60-90 DEGREES

A2P 398026 Rev. B

SHEET No 1 OF 1 SHEETS