


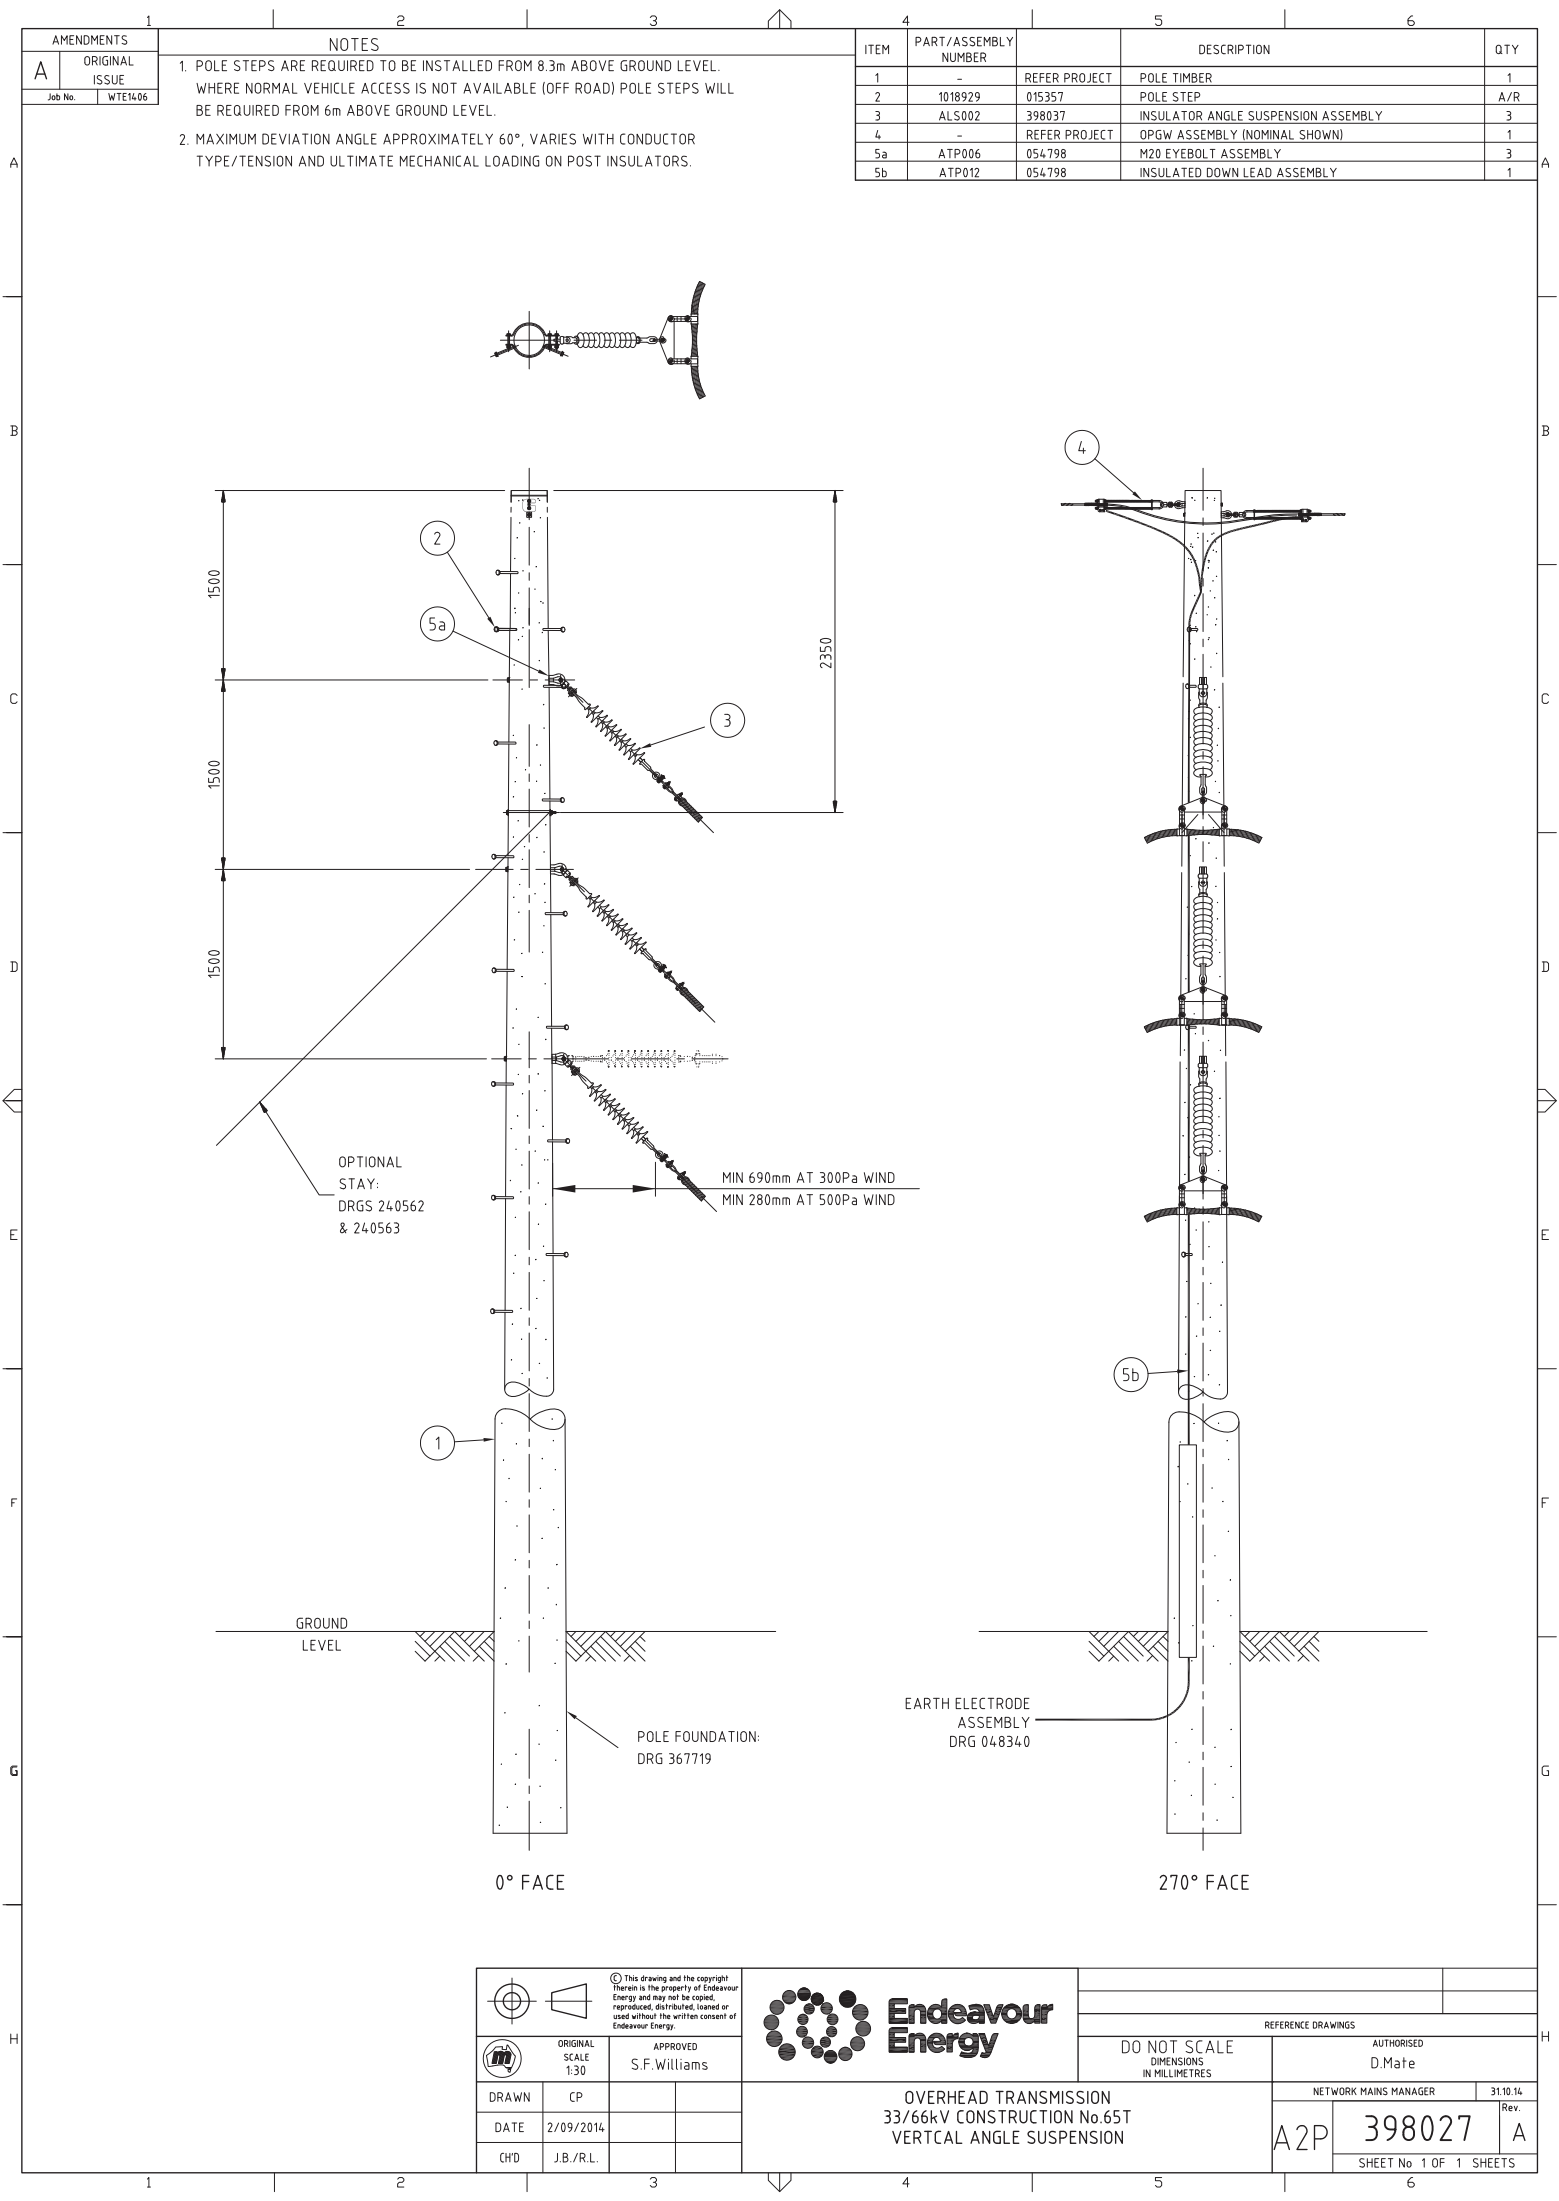

AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	WTETL06

NOTES

- POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL.
- MAXIMUM DEVIATION ANGLE APPROXIMATELY 60°, VARIES WITH CONDUCTOR TYPE/TENSION AND ULTIMATE MECHANICAL LOADING ON POST INSULATORS.

ITEM	PART/ASSEMBLY NUMBER	REFER PROJECT	DESCRIPTION	QTY
1	-	REFER PROJECT	POLE TIMBER	1
2	1018929	015357	POLE STEP	A/R
3	ALS002	398037	INSULATOR ANGLE SUSPENSION ASSEMBLY	3
4	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
5a	ATP006	054798	M20 EYEBOLT ASSEMBLY	3
5b	ATP012	054798	INSULATED DOWN LEAD ASSEMBLY	1

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
ORIGINAL SCALE 1:30		APPROVED S.F.Williams	
DRAWN	CP		
DATE	2/09/2014		
GHD	J.B./R.L.		



OVERHEAD TRANSMISSION
33/66kV CONSTRUCTION No.65T
VERTICAL ANGLE SUSPENSION

REFERENCE DRAWINGS			
DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED D.Mate	
S ION No.65T NSION		NETWORK MAINS MANAGER	
		31.10.14	
		Rev.	
A2P		398027	
		A	
		SHEET No. 1 OF 1 SHEETS	