

AMENDMENTS		
A	ORIGINAL ISSUE	
Job No.		WTE14.06
B	DESIGN	N/A
	DR'N	K.T.
	CH'D	RL/YB
	DATE	22.10.15
TMDM	S.F.W.	
DATE 9/4/18		
ITEM 20 PART NUMBER ADDED.		
C	DESIGN	N/A
	DR'N	TV
	CH'D	MA/MB
	DATE	15.12.25
A.E.M.		S.P.
STOCK CODES UPDATED		

NOTES	
1.	POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL.
2.	VISIBLE LOCATION 95mm ² INSULATED EARTH ABOVE INSULATED COVER.
3.	FIT POLE INSULATING COVER OVER CABLE GUARD & FIX STAINLESS STEEL STRAP. IF REQUIRED IN EARTHING REPORT.
4.	CHECK CABLE SCREEN EARTHING REQUIREMENT.
5.	IF AREA SURROUNDING POLE IS EXCAVATED FOR INSTALLATION OF CABLE: -POLE MAY REQUIRE TEMPORARY SUPPORT/STABILISATION -BACKFILL TO BE COMPACTED

ITEM	PART	DRG	DESCRIPTION	QTY
1	-	-	POLE TIMBER	1
2	1000000477	015367	STEP,POLE,WOOD,M16x260MM(L),GALV	A/R
3	1000007527	052796	XARM,METAL,3000x152x152MM,6.3MM(T)	1
4	1000000468	054790	BRACE,XARM,ANG,TYPE 3H,GALV,2 X M18	2
5	ALR002	398038	INSULATOR LONG ROD ASSEMBLY	3
6	-	-	OHEW ASSEMBLY TYPE AS PER PROJECT.	1
7	1000006090	259304	PROTECTOR,CABLE_COVER, LONG TPR,3300x1228	1
8	1000005436	-	CLAMP,CABLE,UNIV,50-200MM(ID) CABLE	18
9	1000006092	077162	BRACKET,MTG,SUP,GALV,33/66KV POLYMERIC,S	3
10	1000006091	078931	BRACKET,MTG,SUP,GALV,6KV POLYMERIC SURGE	3
11	1000005413	-	ARRESTER,SURGE,30KV,GND SIDE PED MTG,EFF	3
12	SEE TABLE 1	-	33kV CABLE TERMINATION XLPE OUTDOOR	1
13	SEE TABLE 2	-	LUG CABLE	3
14	SEE TABLE	399844	LUG CONDUCTOR TO SUIT CONDUCTOR	3
15	SEE TABLE 3	-	CLAMP CABLE TO SUIT CABLE DIA	3
16a	ATP012	054798	INSULATED DOWN LEAD ASSEMBLY	1
16b	ATP009	054798	M20 BOLT ASSEMBLY FOR POLE	1
16c	ATP010	054798	M16 BOLT ASSEMBLY FOR CROSSARM	2
16d	ATP006	054798	M20 EYEBOLT ASSEMBLY FOR POLE	3
16e	ATP011	054798	COACHSCREW ASSEMBLY	13
16f	ACP006	240600	M20 EYEBOLT ASSEMBLY FOR CROSSARM	2
17	1000005412	-	ARRESTER,SURGE DIVERTER,6KV,10KA,100KVA	3
18	1000006220	380808	PROTECTOR,CABLE_COVER,720MM(W),460MM(D)	4
19	1000007437	-	STRAPPING,BAND--IT,19MM(W),30M(L),SSTEEL	A/R
20	1000006472	-	WASHER,BEVEL,SQ,WEDGE SHAPE,D TPR,M12,40	A/R

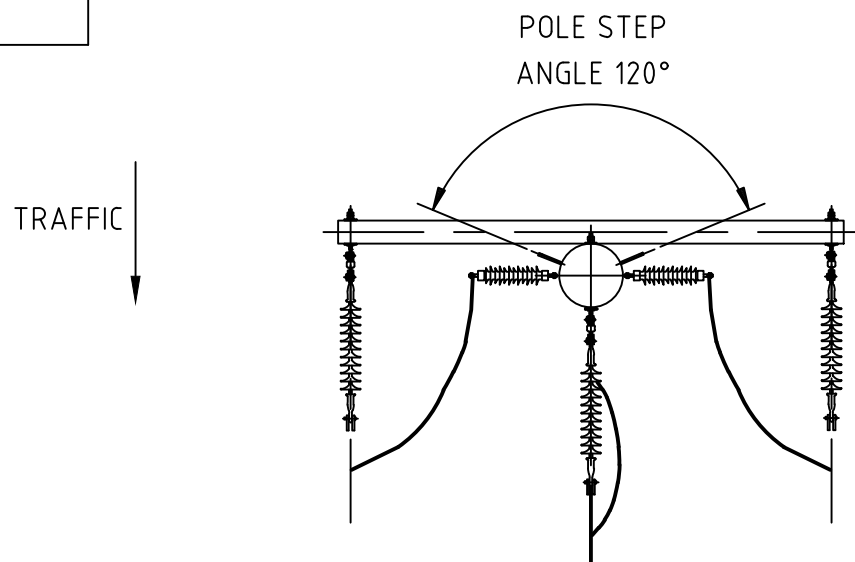


TABLE 1



CABLE	STOCK NUMBER
630mm 33kV CABLE TERMINATION	1000005407
800mm 33kV CABLE TERMINATION	1000005407
1200mm 33kV CABLE TERMINATION	1000005408


TABLE 2


CABLE	STOCK NUMBER
630mm 33kV CABLE LUG	1000005669
800mm 33kV CABLE LUG	1000001905
1200mm 33kV CABLE LUG	1000003250

TABLE 3

CABLE DIA RANGE	STOCK NUMBER
55mm - 60mm	1000007539
63mm - 70mm	1000007536
70mm - 75mm	-
80mm - 85mm	1000001893
0mm - 84mm	1000008089

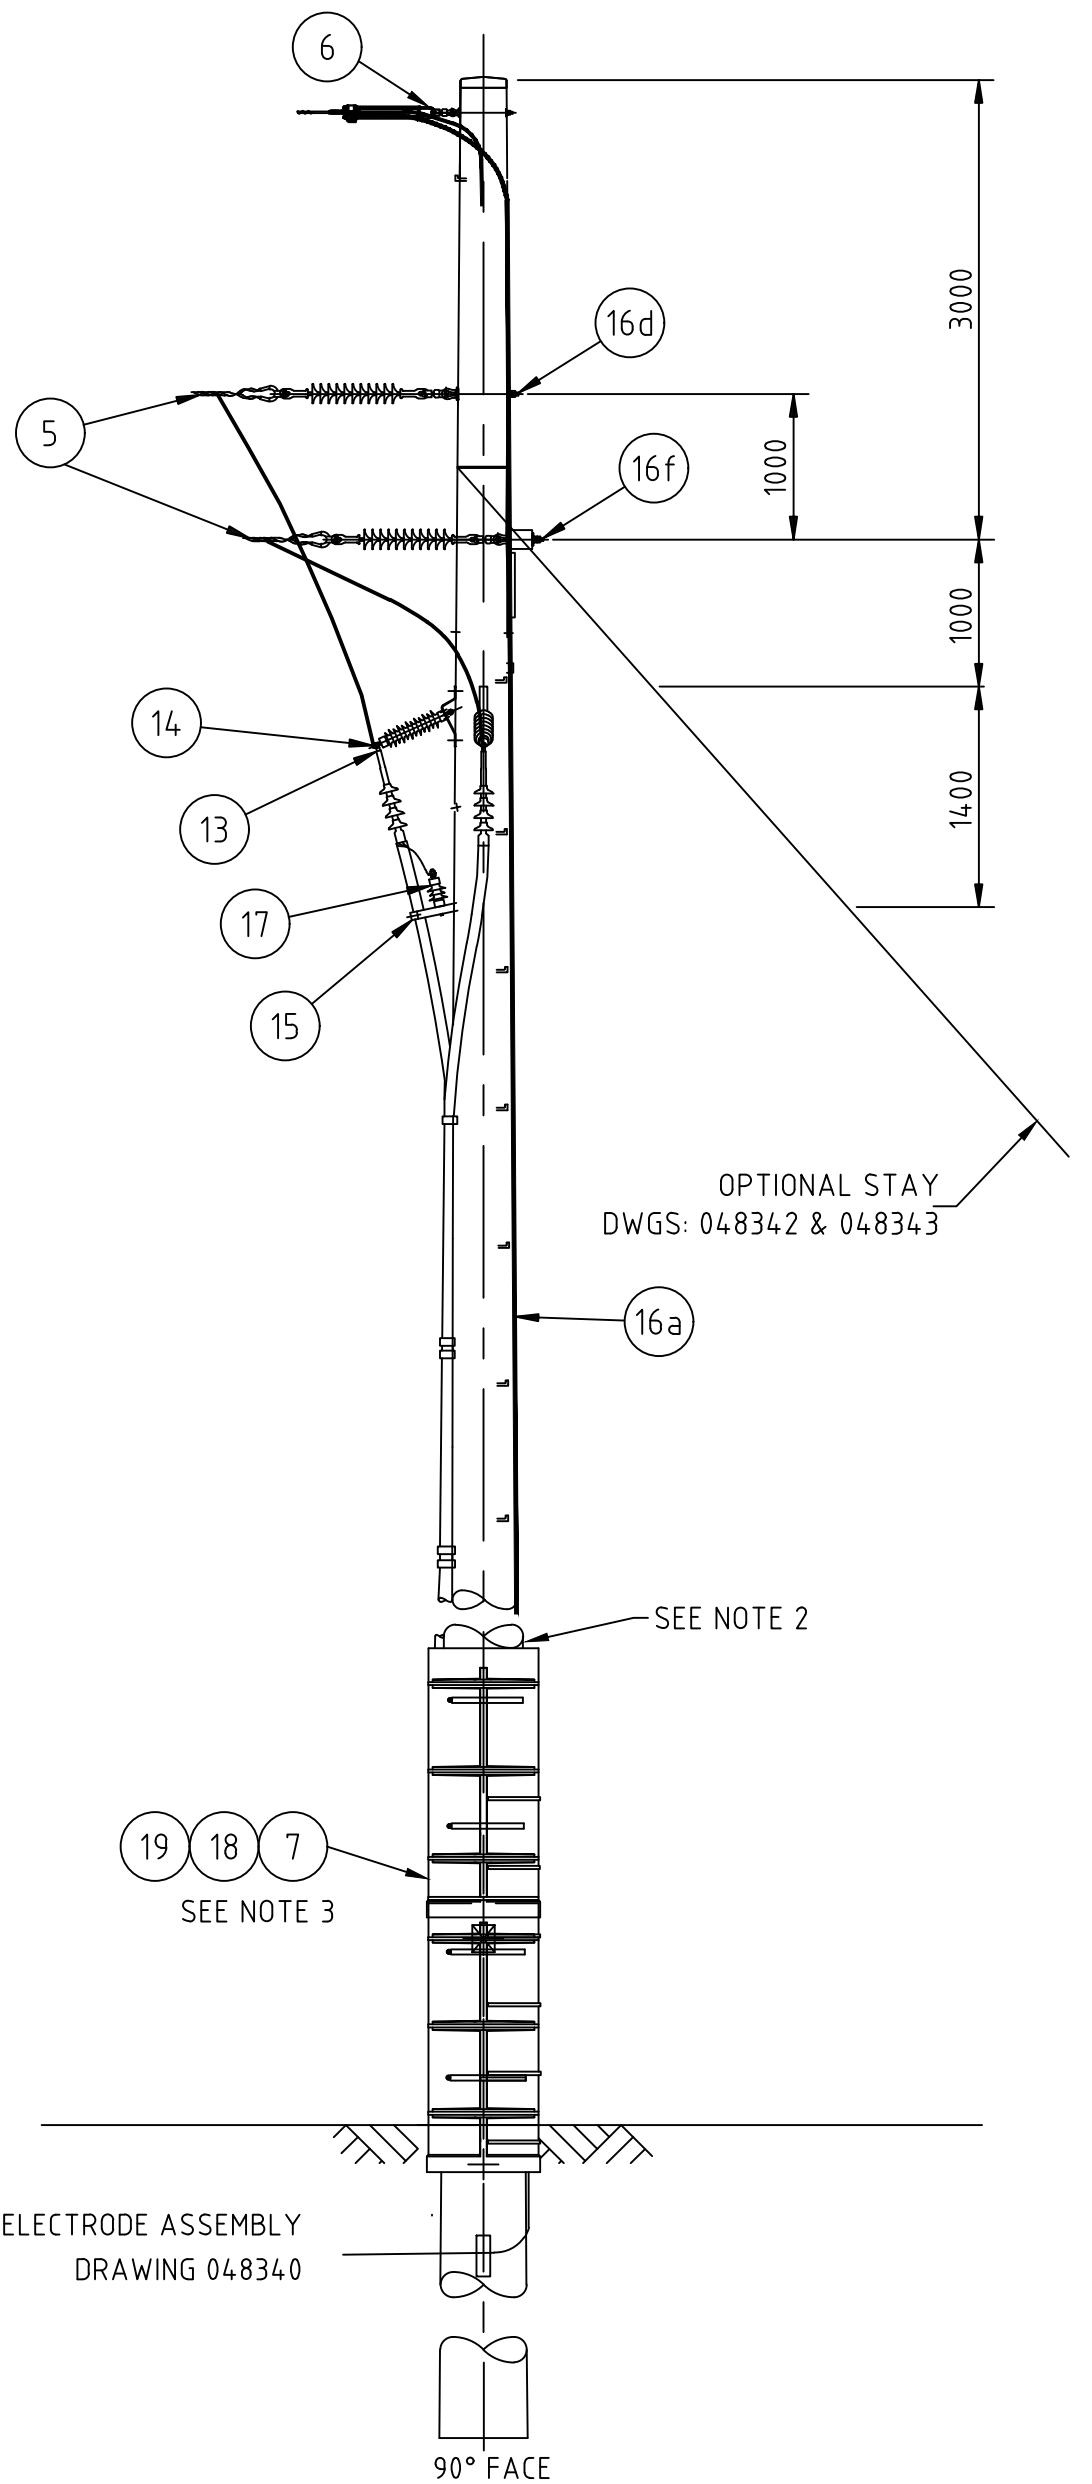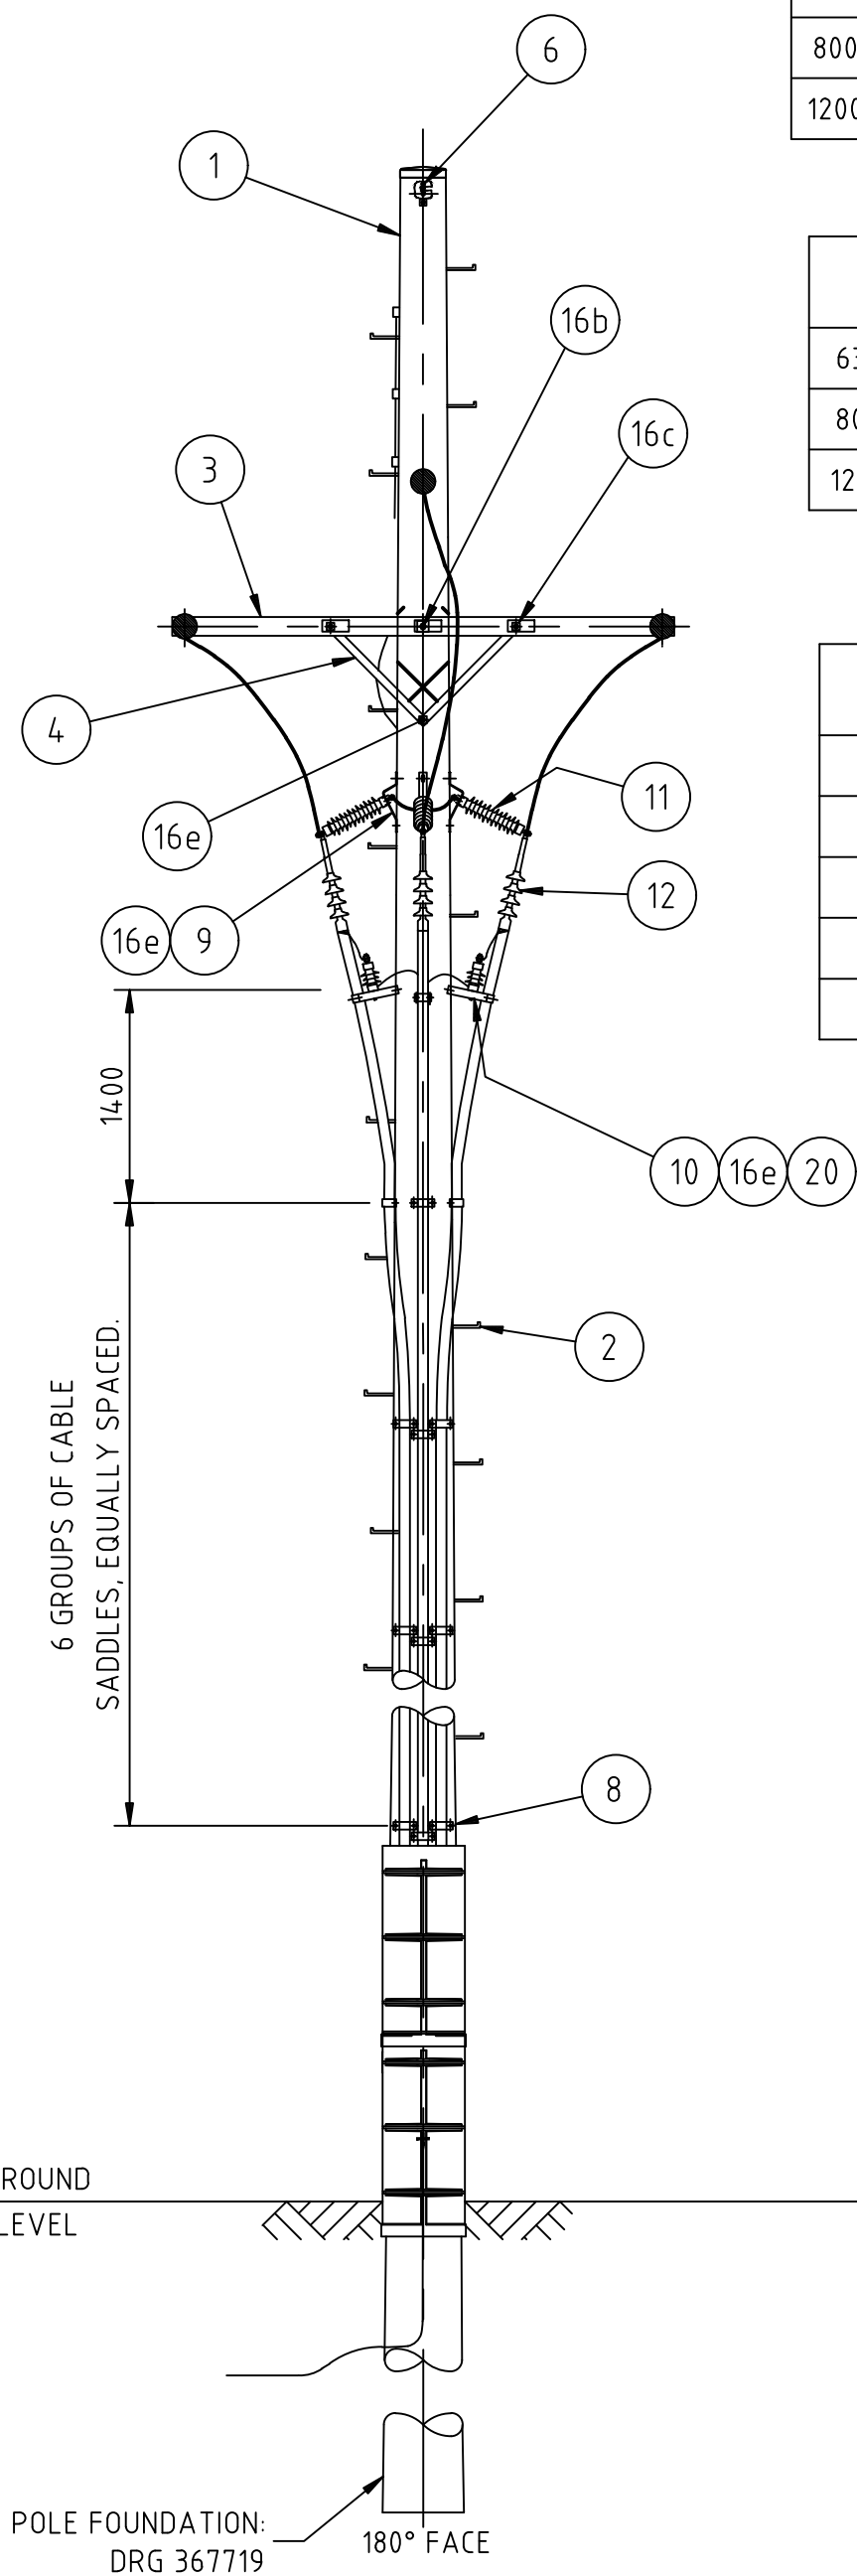

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
		ORIGINAL SCALE NIL	
		APPROVED S.F.Williams	
DRAWN	CP		
DATE	5/09/2014		
CH'D	J.B./R.L.		

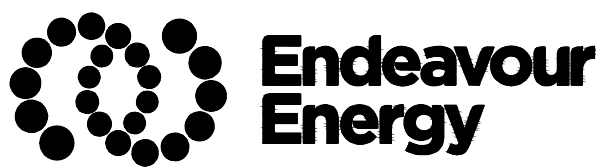

REFERENCE DRAWINGS			
DO NOT SCALE DIMENSIONS IN MILLIMETRES		AUTHORISED D.Mate	
SION OT UG/OH ON		NETWORK MAINS MANAGER	
		31.10.14	
		Rev.	
A2P		398031	
		SHEET No 1 OF 1 SHEETS	