AMENDMENTS	
A	ORIGINAL ISSUE

Job No.	
DESIGN	N/A
DR'N	TV
CH'D	MA/MB
DATE	23.12.25
A.E.M	SP

NOTES

1. POLE STEPS ARE REQUIRED TO BE INSTALLED FROM 8.3m ABOVE GROUND LEVEL. WHERE NORMAL VEHICLE ACCESS IS NOT AVAILABLE (OFF ROAD) POLE STEPS WILL BE REQUIRED FROM 6m ABOVE GROUND LEVEL. ALL CONCRETE AND STEEL POLES SHOULD HAVE FERRULES FROM 6m REGARDLESS.
2. MAXIMUM DEVIATION ANGLE APPROXIMATELY 15°, VARIES WITH CONDUCTOR TYPE/TENSION AND ULTIMATE MECHANICAL LOADING ON POST INSULATORS.

ITEM	PART/ASSEMBLY NUMBER	DRG Nos.	DESCRIPTION	QTY
1	-	295702	POLE PRESTRESED CONCRETE	1
2	1561802	370399	POLE STEP	A/R
3	-	315468	INSULATOR LINE POST ASSEMBLY	3
4	-	REFER PROJECT	OPGW ASSEMBLY (NOMINAL SHOWN)	1
5b	AEC-B	051125	EARTH CONNECTION AEC-B	4
5e	AEC-E	051125	EARTH CONNECTION AEC-E	1
6a	ACP001	240600	M20 BOLT ASSEMBLY FOR LINE POST INSULATOR	3
6b	ACP002	240600	M20 BOLT ASSEMBLY FOR LINE POST INSULATOR	3

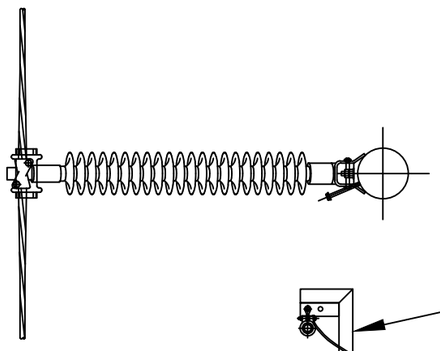

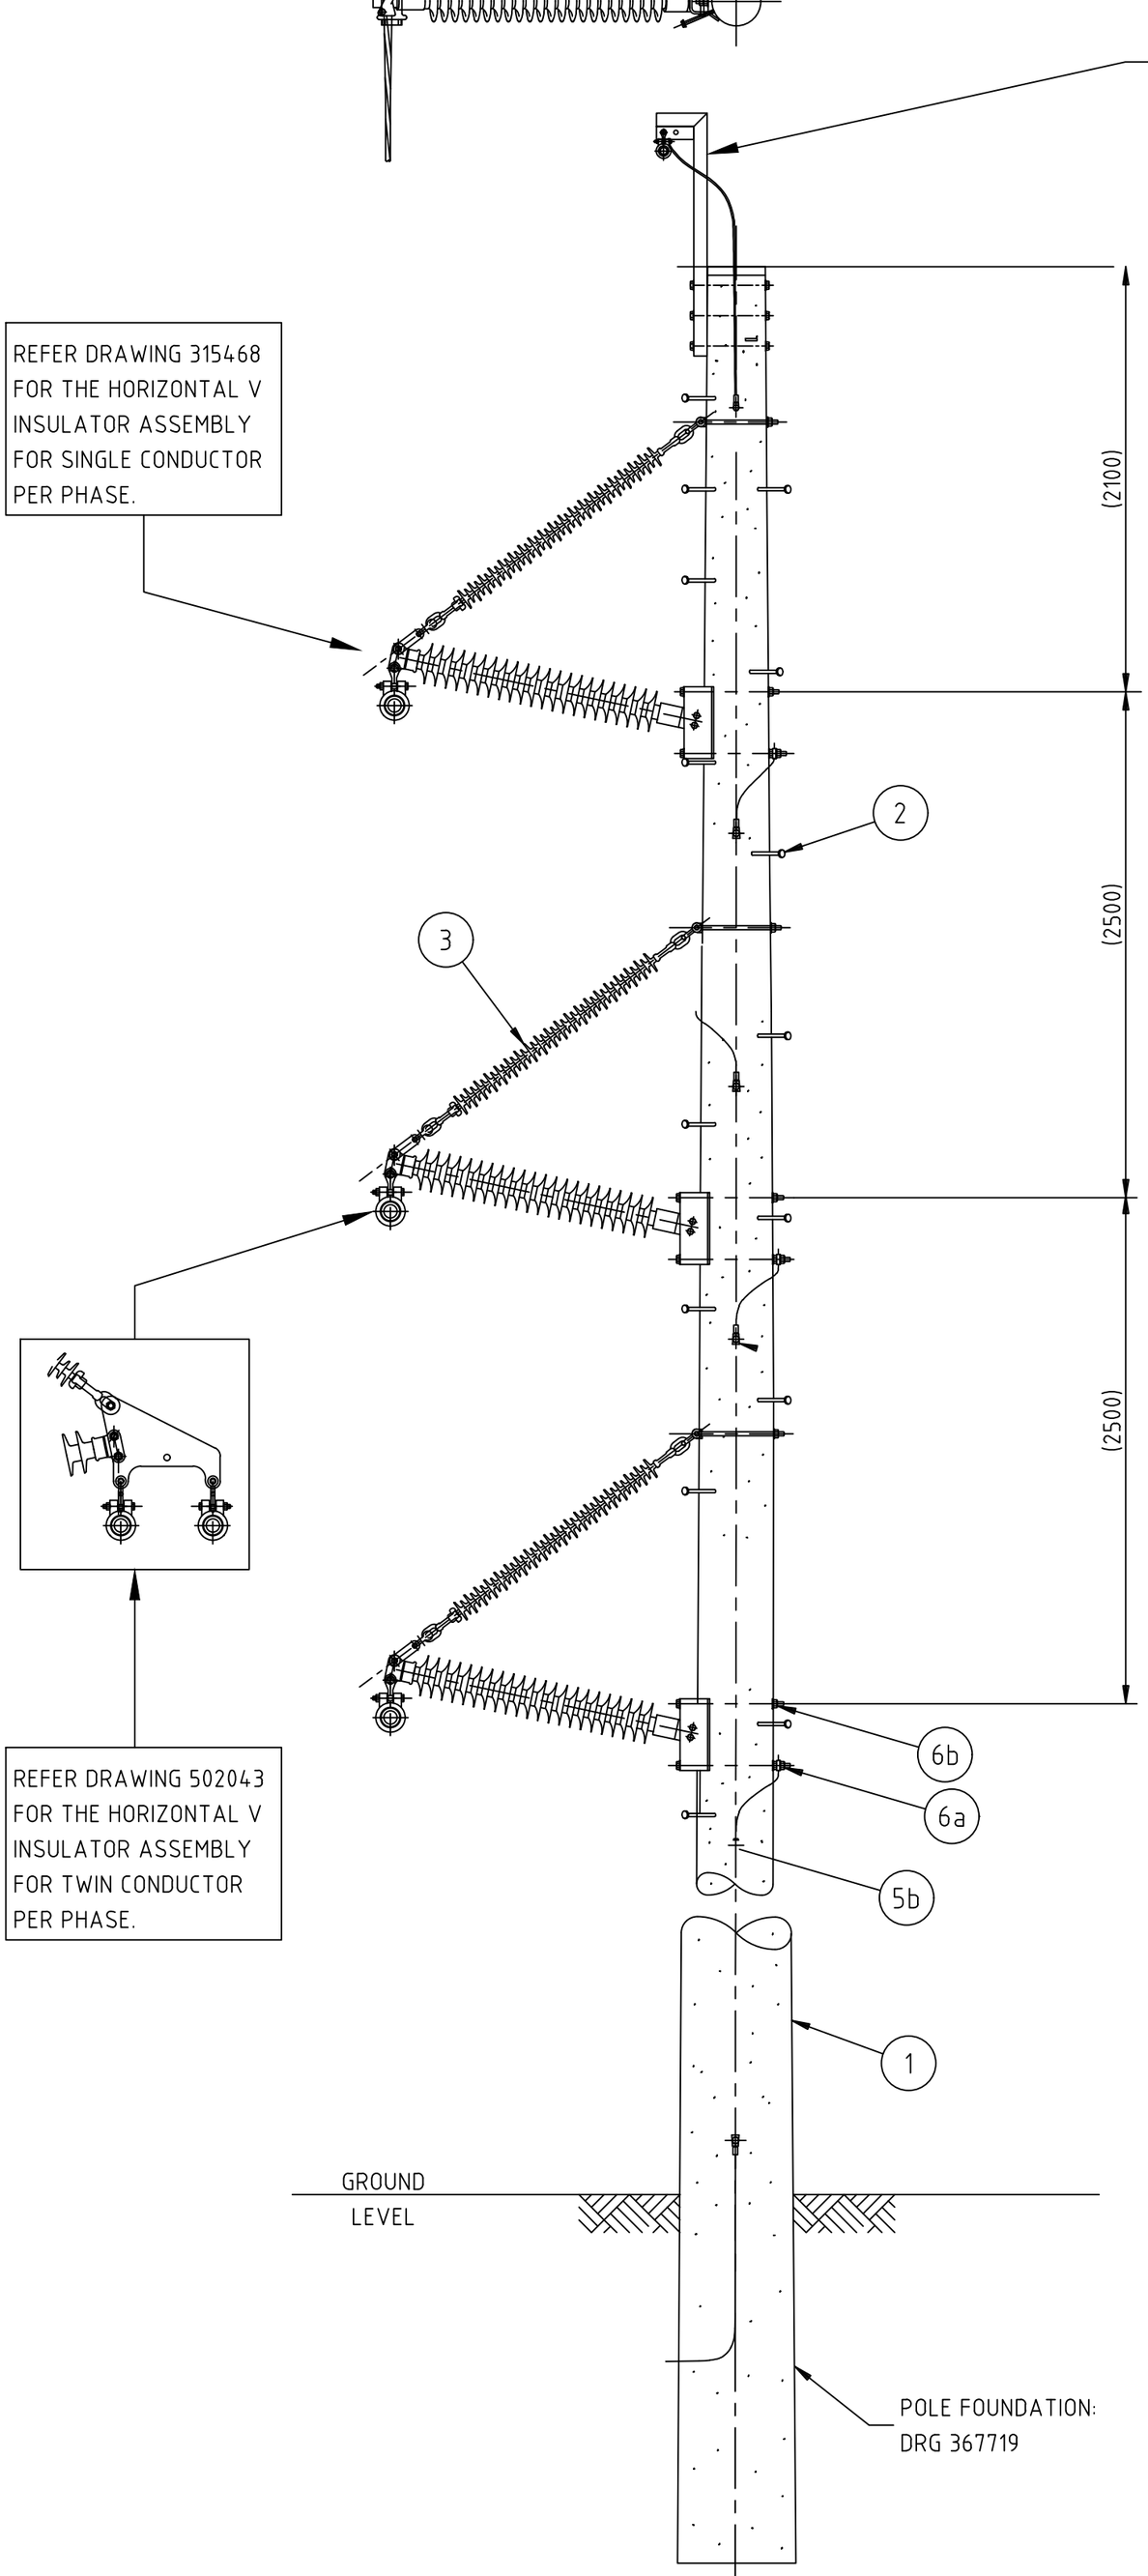

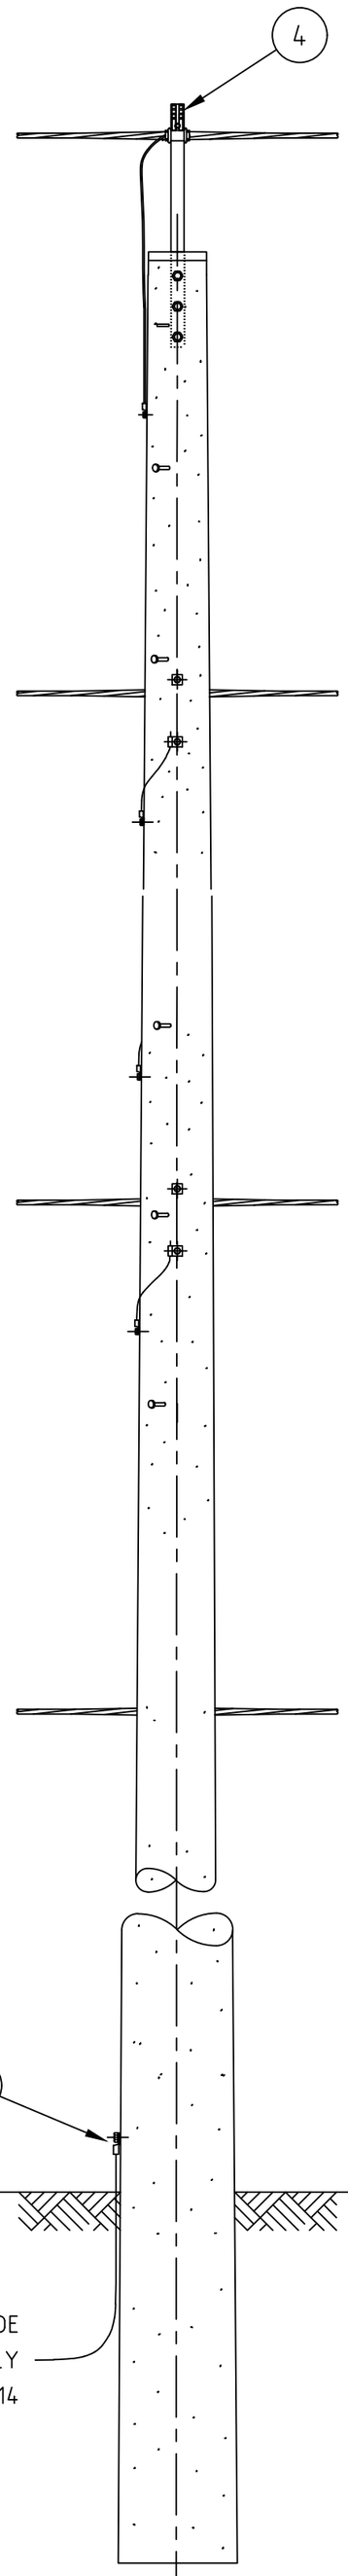

© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE	APPROVED
NTS	A.WICKRAMASINGHE

DRAWN	J.P.		
DATE	11.3.26		
CH'D	M.A./M.B.		

Endeavour Energy

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
S. PATON
ASSET ENGINEERING MANAGER 11.03.26

OVERHEAD TRANSMISSION
132kV CONSTRUCTION No.TBA
VERTICAL HORIZONTAL BRACED POST

A2P 537449 Rev. A

SHEET No 1 OF 1 SHEETS