
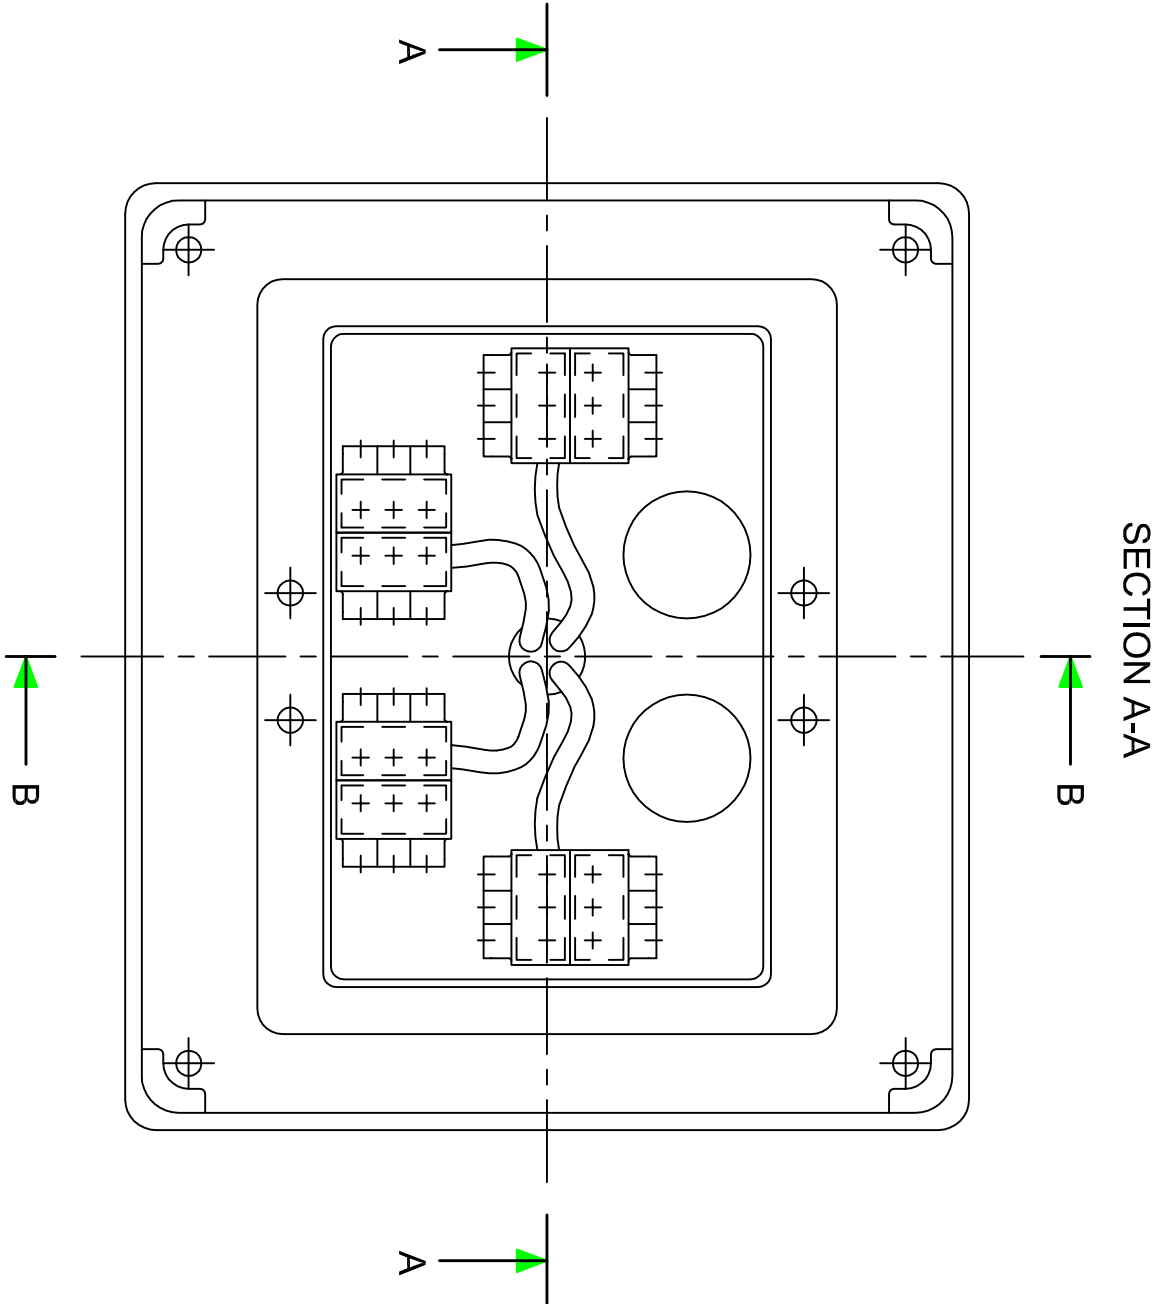


NOTES

1. THE ARRANGEMENT SHOWN ALLOWS FOR UP TO FOUR CUSTOMERS. IT IS NECESSARY TO PROVIDE A SIX HOLE SERVICE CABLE TERMINAL BLOCK (PART No SB10509) ON EACH CABLE TAIL.
2. IF A STREETLIGHT SUPPLY IS REQUIRED FROM THE PILLAR THEN IT SHALL BE INSTALLED AS INDICATED IN THE STREETLIGHT CONNECTION DETAILS DRAWING.

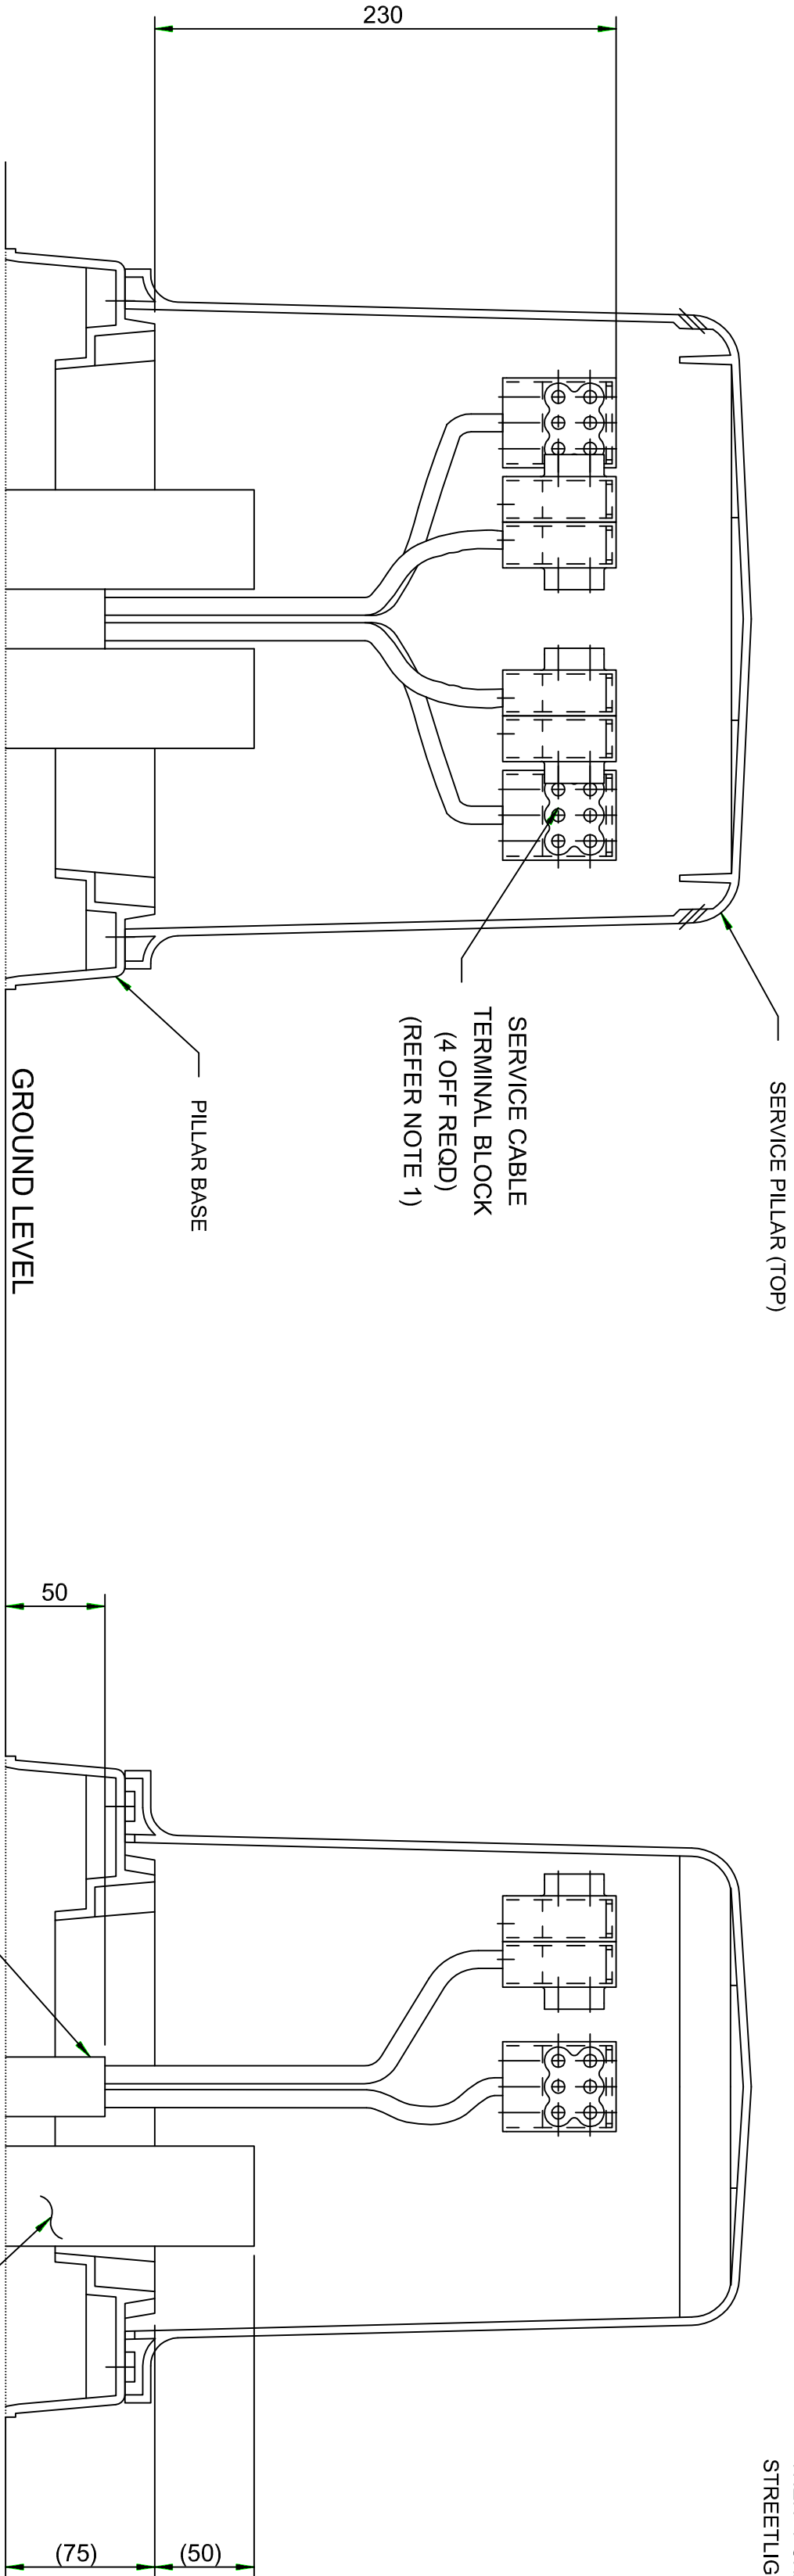

PLAN VIEW
(PILLAR TOP OMITTED FOR CLARITY)

AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	960076
DR'N	D.J.Z.
CH'D	D.J.Z.
DATE	22-7-97
JR No	970055
B	
M.N.M.A.	G.V.H.
DR'N	G.F.
CH'D	G.F.
DATE	24-8-05
JR No	-
C	
5 HOLE SERVICE BLOCKS REPLACED WITH 6X HOLE BLOCKS. NOTE 2 ADDED.	
M.A.E.	G.F.
DR'N	M.C.
CH'D	A.G.
DATE	11-02-2015
JR No	-
D	
TITLE CHANGE FROM 'RECTANGLE' TO 'SQUARE'	
M.A.E.	

		ORIGINAL SCALE 1:3	APPROVED	D. SHEPHERD
DRAWN	D.J.Z.			
DATE	14-10-96			
CH'D	D.J.Z.			

© This drawing and the copyright therein are the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



URD
SQUARE SERVICE PILLAR
ARRANGEMENT

RECTANGULAR SERVICE PILLAR INSTLN		241058
SERVICE CABLE TERMINAL BLOCK 6 HOLE		241053
STREETLIGHT CONNECTION DETAILS		280143
DO NOT SCALE DIMENSIONS IN MILLIMETRES		
REFERENCE DRAWINGS		
AUTHORISED		
MANAGER PRIMARY SYSTEMS		
J. PERERA		
A2		
241055		
D		
SHEET No. 1 OF 1 SHEETS		