




A	ORIGINAL ISSUE	
	DRN	R.J.H.
	CH'D	D.J.2
B	DATE 8-10-82	
	Ø12 HOLE IN ITEM 3 ADDED. AUST. STANDARD N°S UPDATED.	
	SUB. ENG. C.G.	
C	DRN	W.C.H.
	CH'D	SGP
	DATE	19.12.84
	CH N°	242.
VOCAB N° ADDED.		
SUBS ENG. <i>Am</i>		
D	DRN	J.H.
	CH'D	FM
	DATE	27-7-05
	JOB N°	
DSM FMYGAP		
DRG. FRAME WAS PPC		

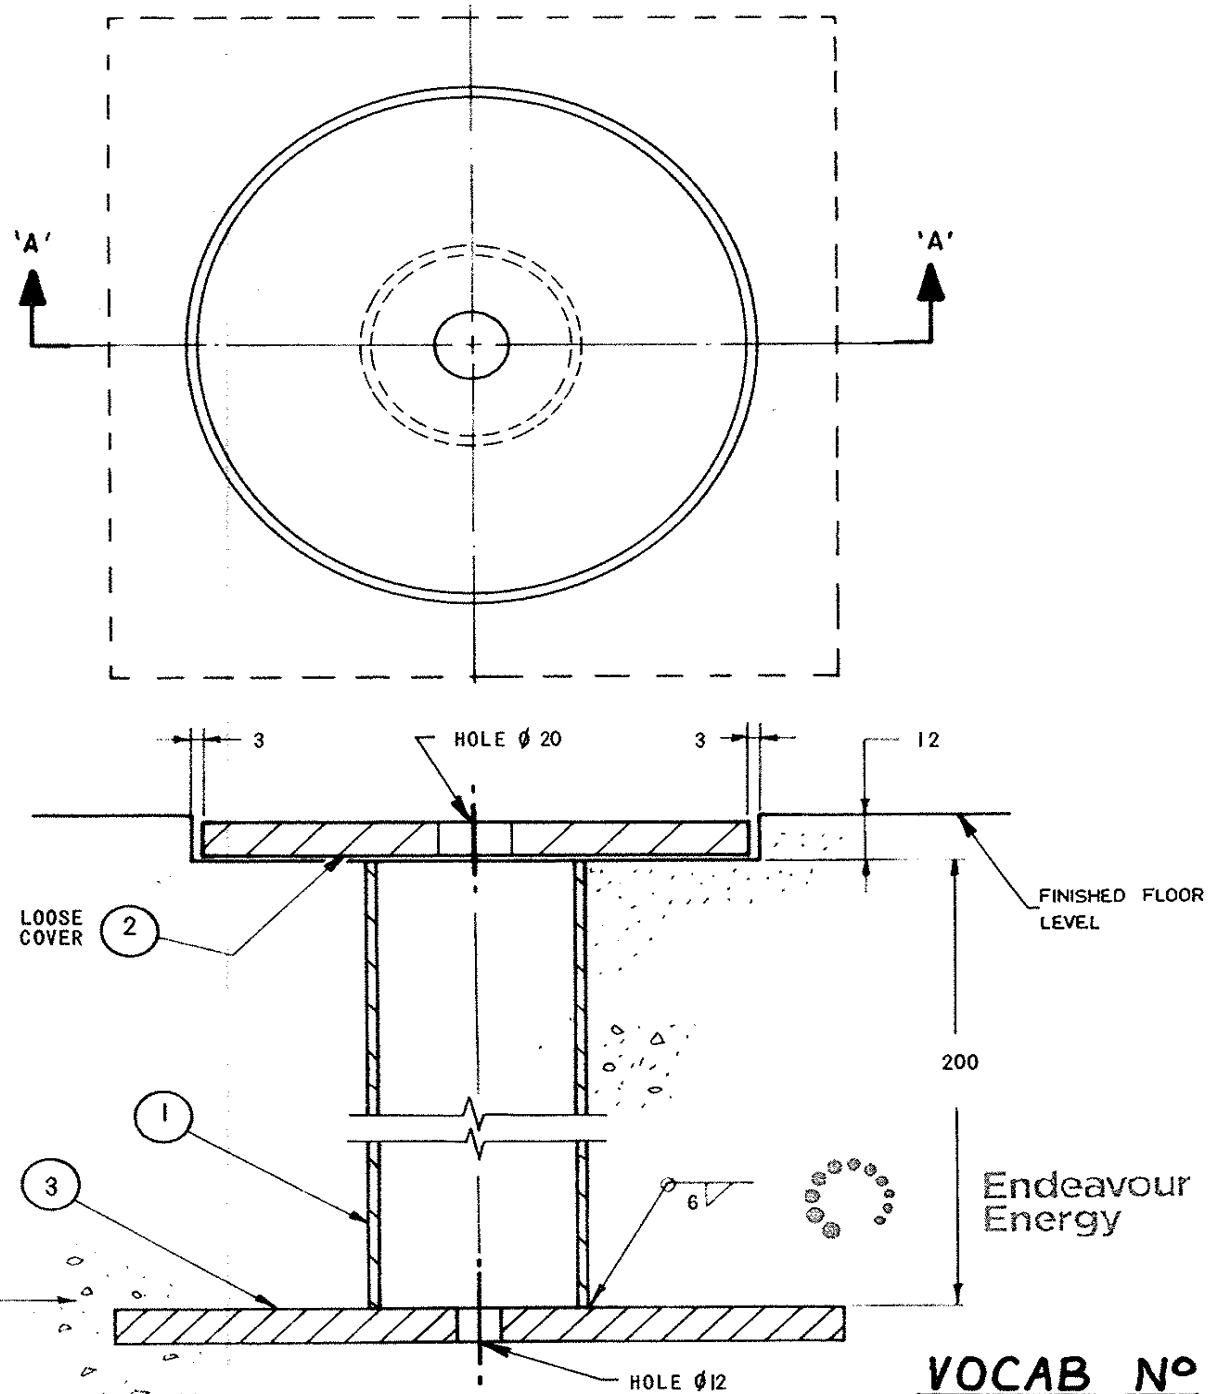

VOCAB N°
SS 14474.

SOCKET

- NOTES:-**
1. FINISH: AFTER FABRICATION HOT DIP GALV. TO AS1650.
 2. ALL WELDING TO BE IN ACCORDANCE WITH AS 1554. SYMBOLS TO AS1101 PT. 3.
 3. MINIMUM OF 75mm OF CONCRETE AROUND ITEM 3

3	STEEL PLATE 10 x 200 x 200	1
2	STEEL PLATE 10 x 150 DIA	1
1	PIPE STEEL MED 50 NB x 200 LG (ID 53.1)	1
ITEM	DESCRIPTION	QTY

DO NOT SCALE

SHEET 2 OF 2 SHEETS

ALL DIMENSIONS ARE IN MILLIMETRES

CONCRETE WALL ANCHOR	F40879
REMOVABLE PULLING RING	SHEET 1
REFERENCE DRAWINGS	

APPROVED <i>L. Engel</i>			
JOB N°		DRN	A.P.A.
PLAN ENG	DIST ENG	CH'D	<i>PP</i>
CONS ENG	MAINS ENG	SUPV	<i>HP</i>
REF A4 (h)		D'MAN	

DISTRIBUTION SUBSTATIONS
REMOVABLE PULLING RING & SOCKET FABRICATION DETAILS

<i>A. C. Moorhead</i>	
CHIEF ELEC ENG	DATE 30-7-75
ORIGINAL SCALE 1:2	
F	40877
B	D