


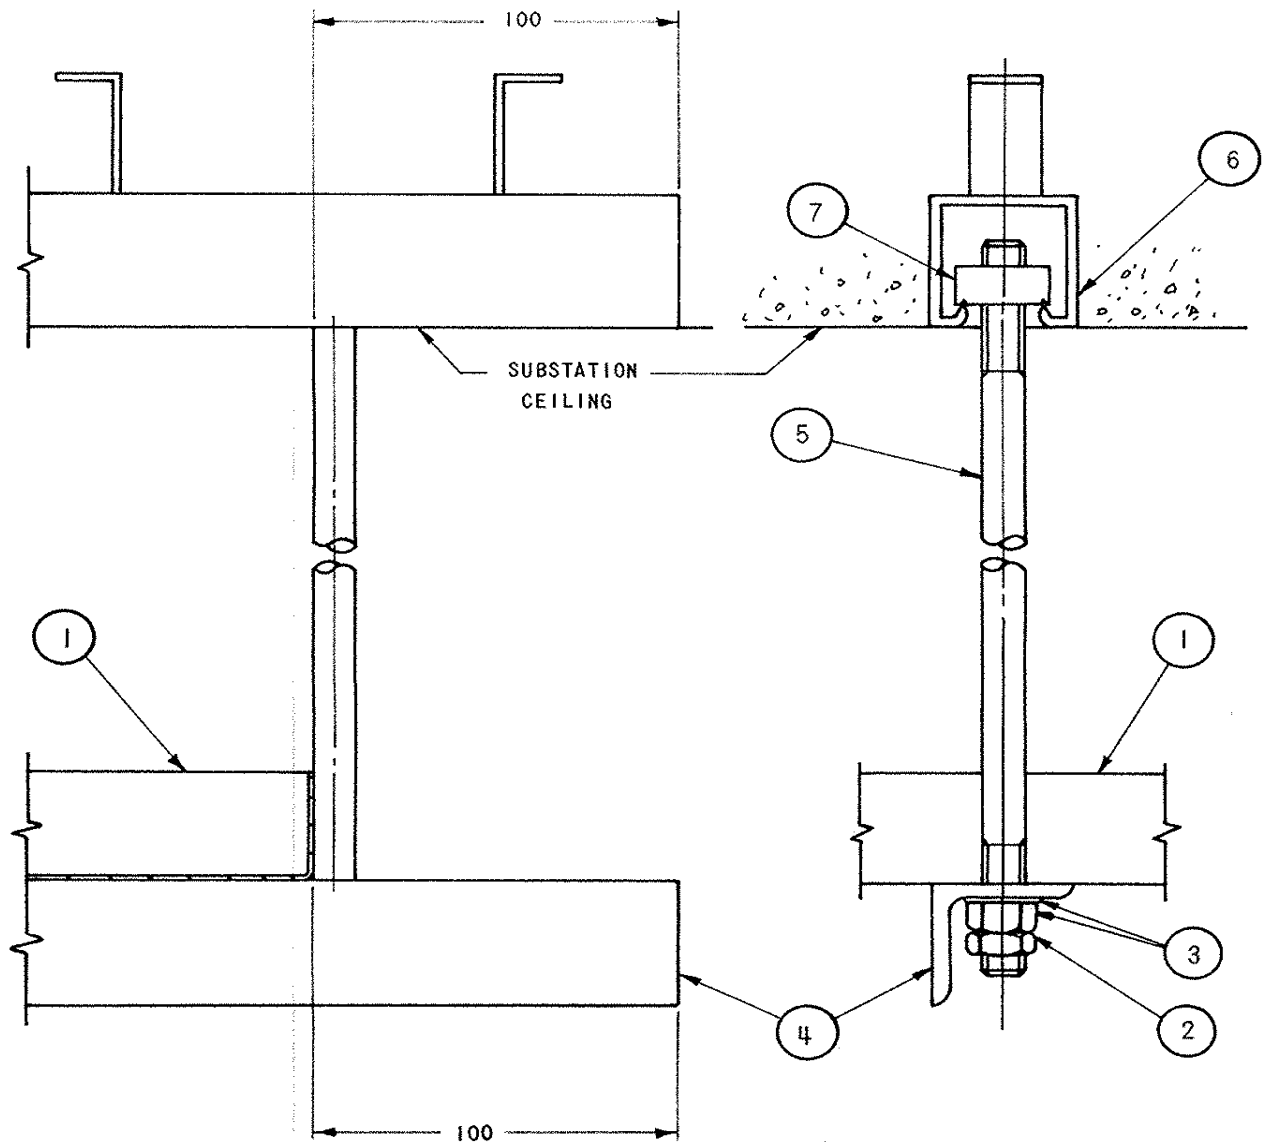


SHOWN FOR ONE SIDE ONLY

ALL DIMENSIONS ARE IN MILLIMETRES

7	UNISTRUT M12 NUT AS REQ'D GALV
6	UNISTRUT TYPE M 1000 CI (LENGTH TO SUIT) GALV
5	STEEL ROD MS Ø12 LENGTH TO SUIT (40 mm OF THREAD BOTH ENDS)
4	STEEL ANGLE 38 x 38 x 5 (LENGTH TO SUIT)
3	NUT STEEL HEX GALV M12 & WASHER
2	NUT STEEL LOCK HEX GALV M12 AS REQ'D
1	CABLE TRAY (SIZE & LENGTH TO SUIT)
ITEM	DESCRIPTION

NOTE: ITEMS 1, 4 & 5
TO BE HOT
DIPPED
GALVANISED AFTER
FABRICATION



Endeavour
Energy

REFERENCE DRAWINGS

DRAWING FRAME
WAS PCC.

DRN J.H.
CH'D FM/GF
DATE 27-7-05
DSM FM/GAD
B

APPROVED	<i>L. Engel</i>	DR'N	A.P.A.
S O ENG	SUB ENG	CH'D	<i>PP</i>
PLAN ENG	DIST ENG	SUPV D'MAN	<i>HD</i>
CONS ENG	MAINS ENG		
M & P ENG	REF A4(h)		

DISTRIBUTION SUBSTATIONS
SUSPENDED CABLE TRAY
SUPPORT DETAILS

CHIEF ELEC ENG	DATE 6-8-75
SCALE	1 : 2
F	40882
B	A