
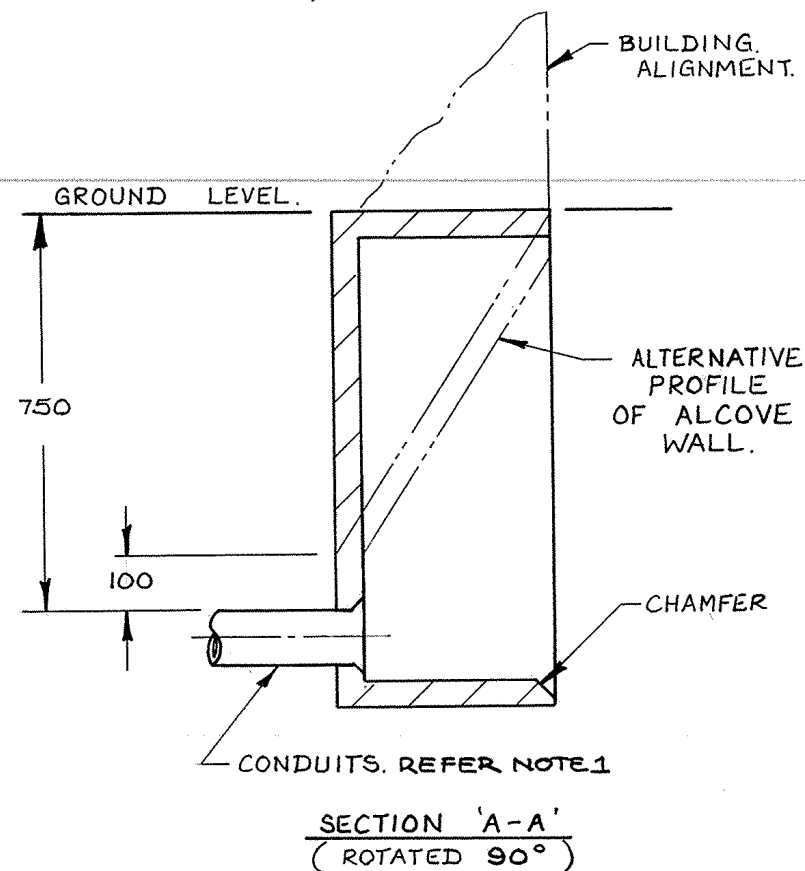


1. 125mm DIA CONDUIT ENDS TO BE BELLMOUTHED.

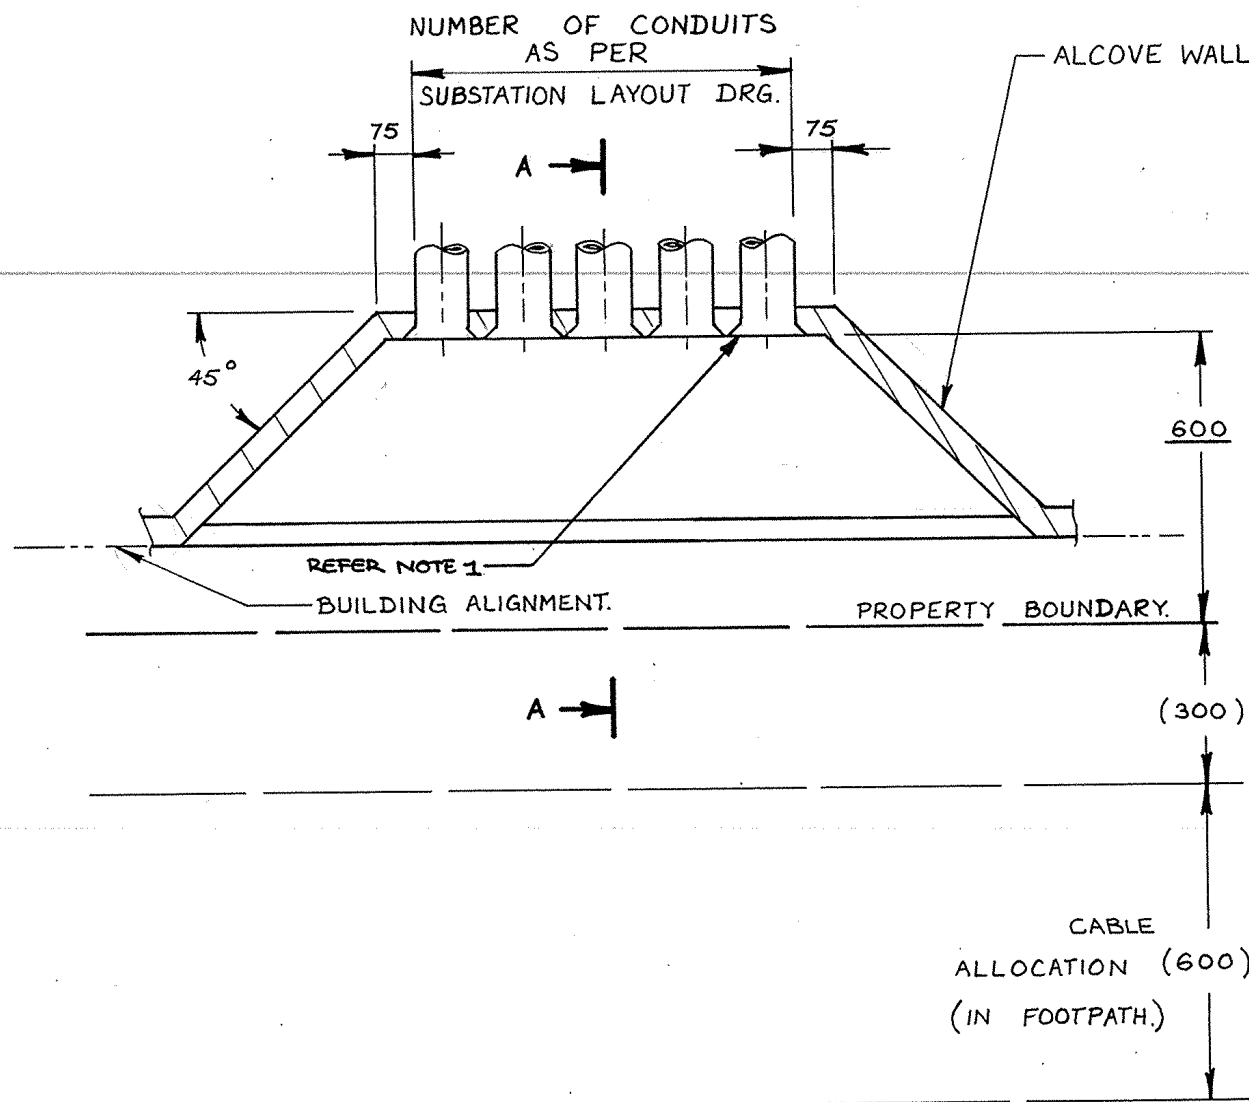

**Endeavour
Energy**

AMENDMENTS		ORIGINAL SCALE 1:10		APPROVED <i>Engel</i>		P. Thomson DIRECTOR ENG. DATE 20-8-85	
A	ORIGINAL ISSUE	DRAWN	W.C.H.	SUBSTN DEVELT	KM	E	54738
B	CH N° 845. DRN F.M. CHD JK DATE 16-1-85 JRN 040208	CH'KD	P.J.B.			SHEET No	OF SHEETS
NOTE 1 ADDED		CO-ORD	F. B.			B	C
SDM JK DRN J.H. CH'D F.M./CF DATE 27-1-85 JOB N°		D'SERV				INDEX REF 5008A	
DSM F.M./CAR DRG. FRAME WAS P.C.C.		DISTRIBUTION SUBSTATION TYPICAL CABLE ALCOVE DETAIL.					