

AMENDMENTS		
A	ORIGINAL ISSUE	
J R No.	900035	

NOTES

1.

MATERIAL: BAR STEEL ROUND

8.

FINISH: HOT DIP GALVANISED AFTER FABRICATION.

OR

MATERIAL: BAR ALUMINIUM ROUND

8.

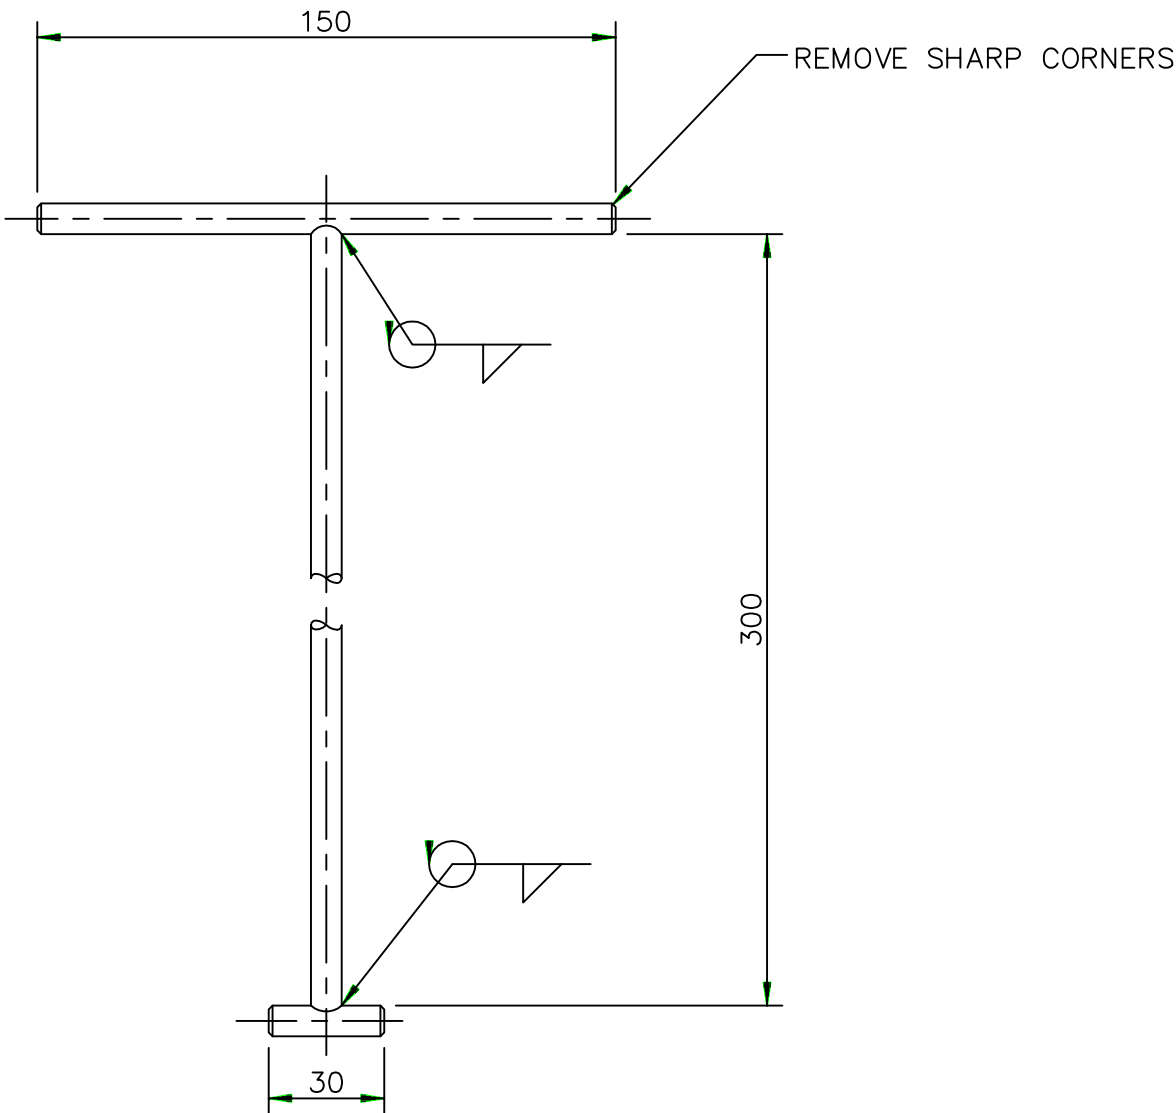
FINISH: NATURAL.
2.
- QUANTITY: 2 OFF REQUIRED PER INSTALLATION
3.
- A SUITABLE CONDUIT SADDLE 38mm (OR SIMILAR)



TO BE FITTED TO WALL IN CLOSE PROXIMITY TO

MANHOLE OR TRENCH COVER PLATES AT A HEIGHT

1350mm ABOVE FLOOR LEVEL FOR STORAGE OF

LIFTING HANDLES.



		 Endeavour Energy	D.B.Britten/CH				
			ASSIST. G.M. ENG.		06-12-90		
DRAWN	GR	INDOOR DISTRIBUTION SUBSTATION TRENCH & FLOOR COVER PLATE LIFTING HANDLE DETAIL	ORIGINAL SCALE	1: 2	APPROVED C.Howat		
DATE	06-12-90		A 4	069526		A	
CH'D	D.J.Z			SHEET No 1 OF 1 SHEETS			