


AMENDMENTS	
A	ORIGINAL ISSUE
B	DRN GSF CH'D GSF DATE 24-10-14 DR No NOTE 1 & 2 WAS SD1104 NOW REFER TO RELEVANT STANDARDS NSM C. Cnsafulli

NOTES

- EXCEPT AS NOTED IN THE RELEVANT EARTHING AND CONSTRUCTION STANDARDS ANY METAL FENCING BETWEEN THE AREA DEFINED BY A LINE 4000mm FROM THE FOOTING EXTREMITIES & THE EASEMENT BOUNDARY SHOULD BY CONSTRUCTED SO THAT THE POSTS INSULATE ADJACENT PANELS FROM EACH OTHER & THE GROUND.
- EXCEPT AS NOTED IN THE RELEVANT EARTHING AND CONSTRUCTION STANDARDS ANY METAL CLAD BUILDING SHOULD NOT ENCROACH WITHIN THE AREA DEFINED BY A LINE 4000mm FROM THE FOOTING EXTREMITIES.

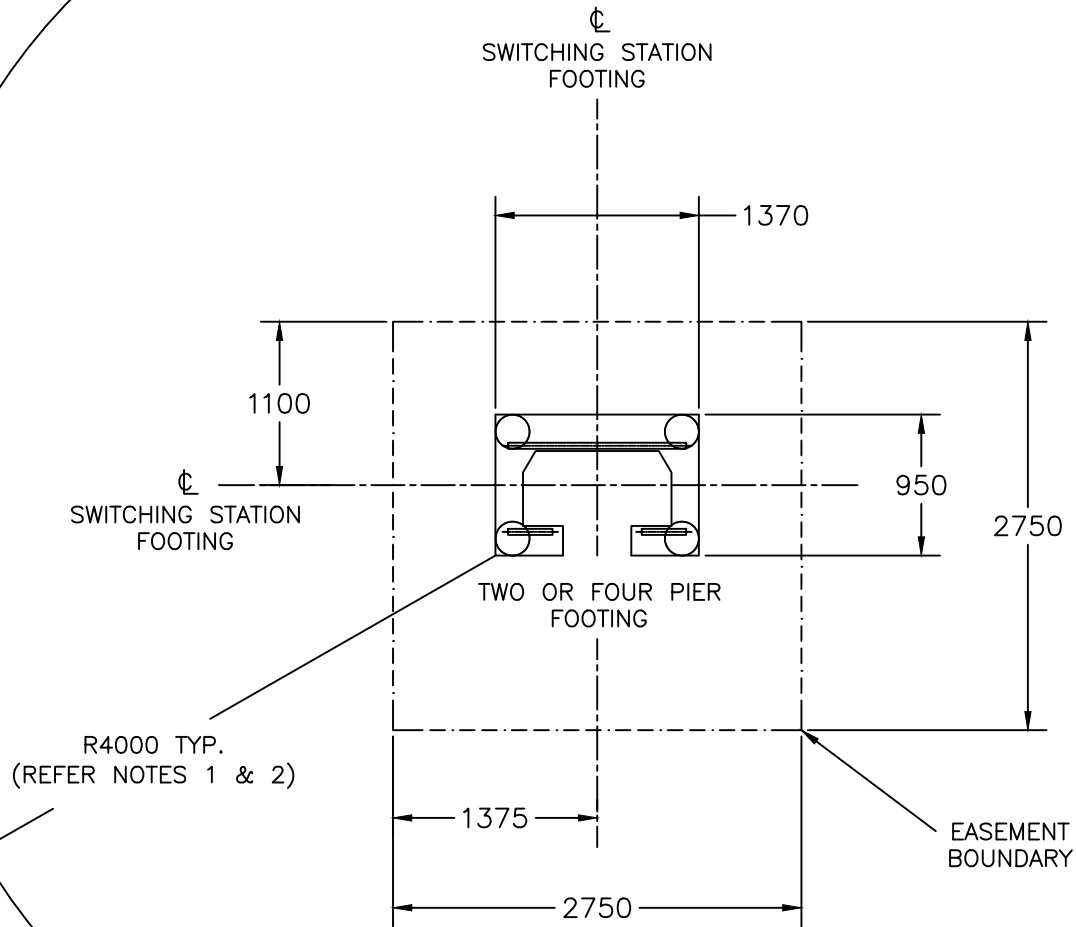

		11 & 22KV HV SW / STN 2 & 4 PIER FTG		282539
		REFERENCE DRAWINGS		
		DO NOT SCALE		AUTHORISED
		DIMENSIONS IN MILLIMETRES		W. Isley
DRAWN G. Ford	DATE 15/09/2003	MANAGER ASSET ENGINEERING		15/09/2003
CH'D G. Ford	INDEX REF S002A	A3		282551
SIZE 16 SWITCHING STATION EASEMENT LAYOUT		SHEET No 1 OF 1 SHEETS		B