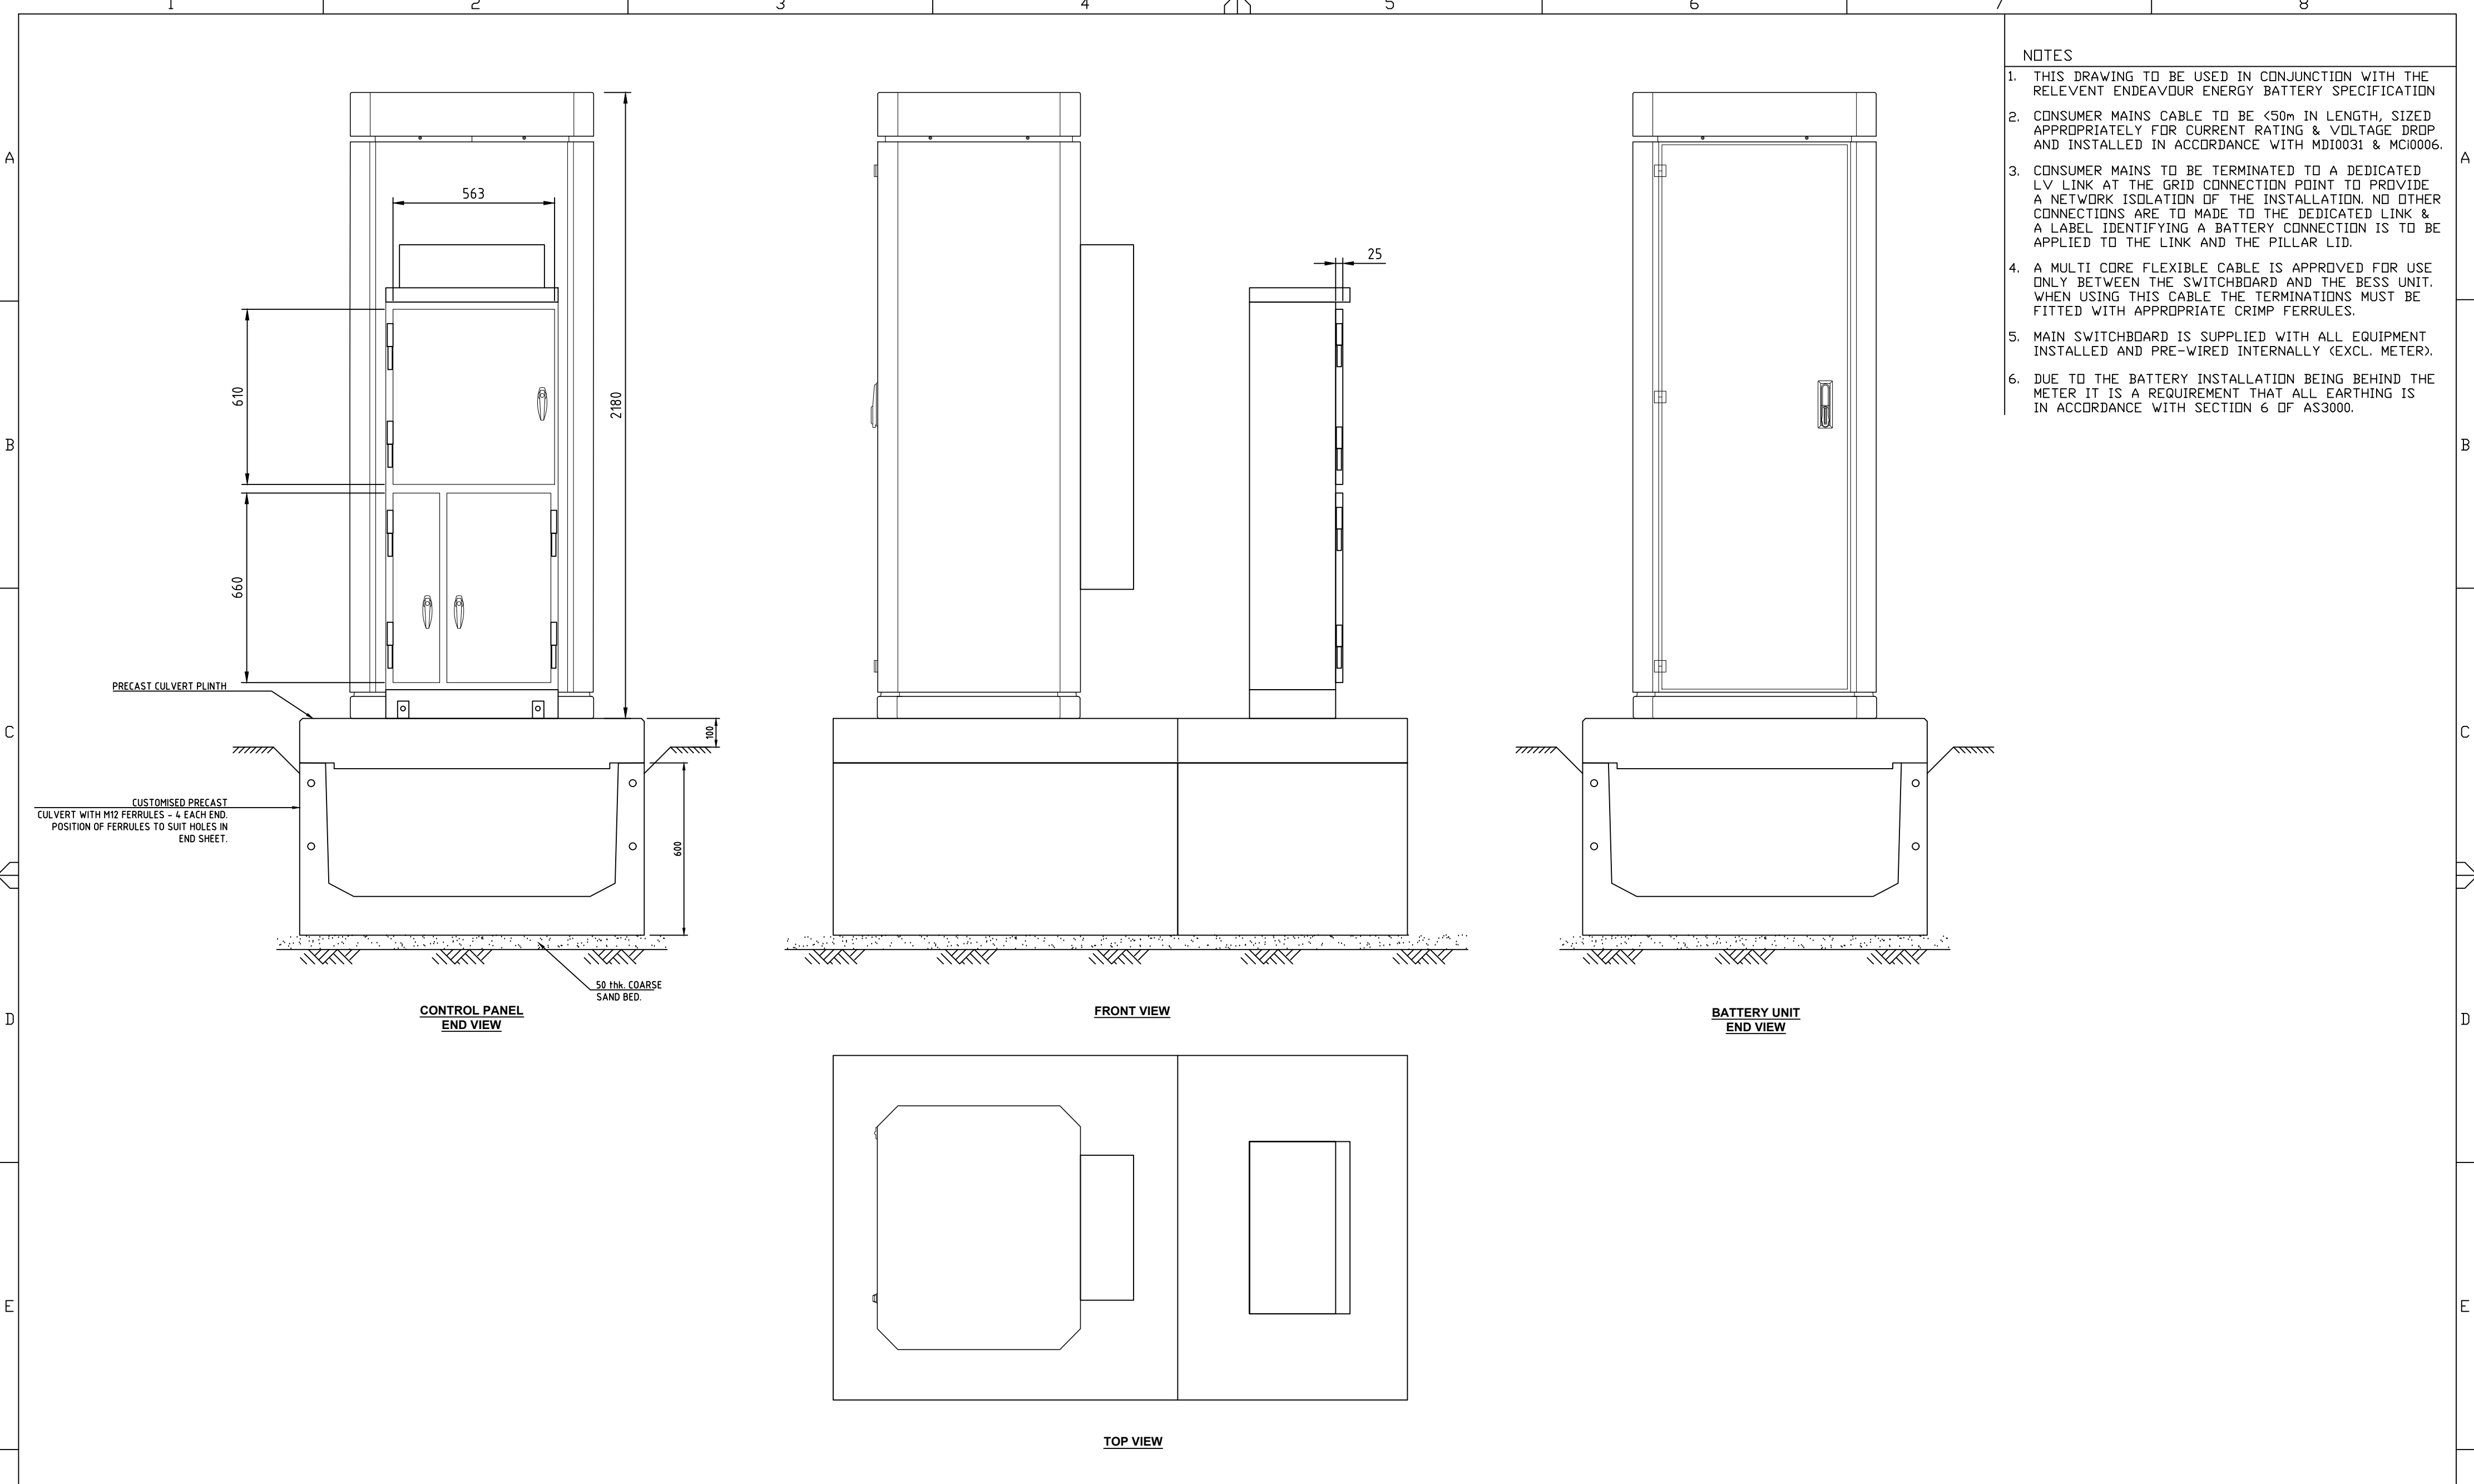
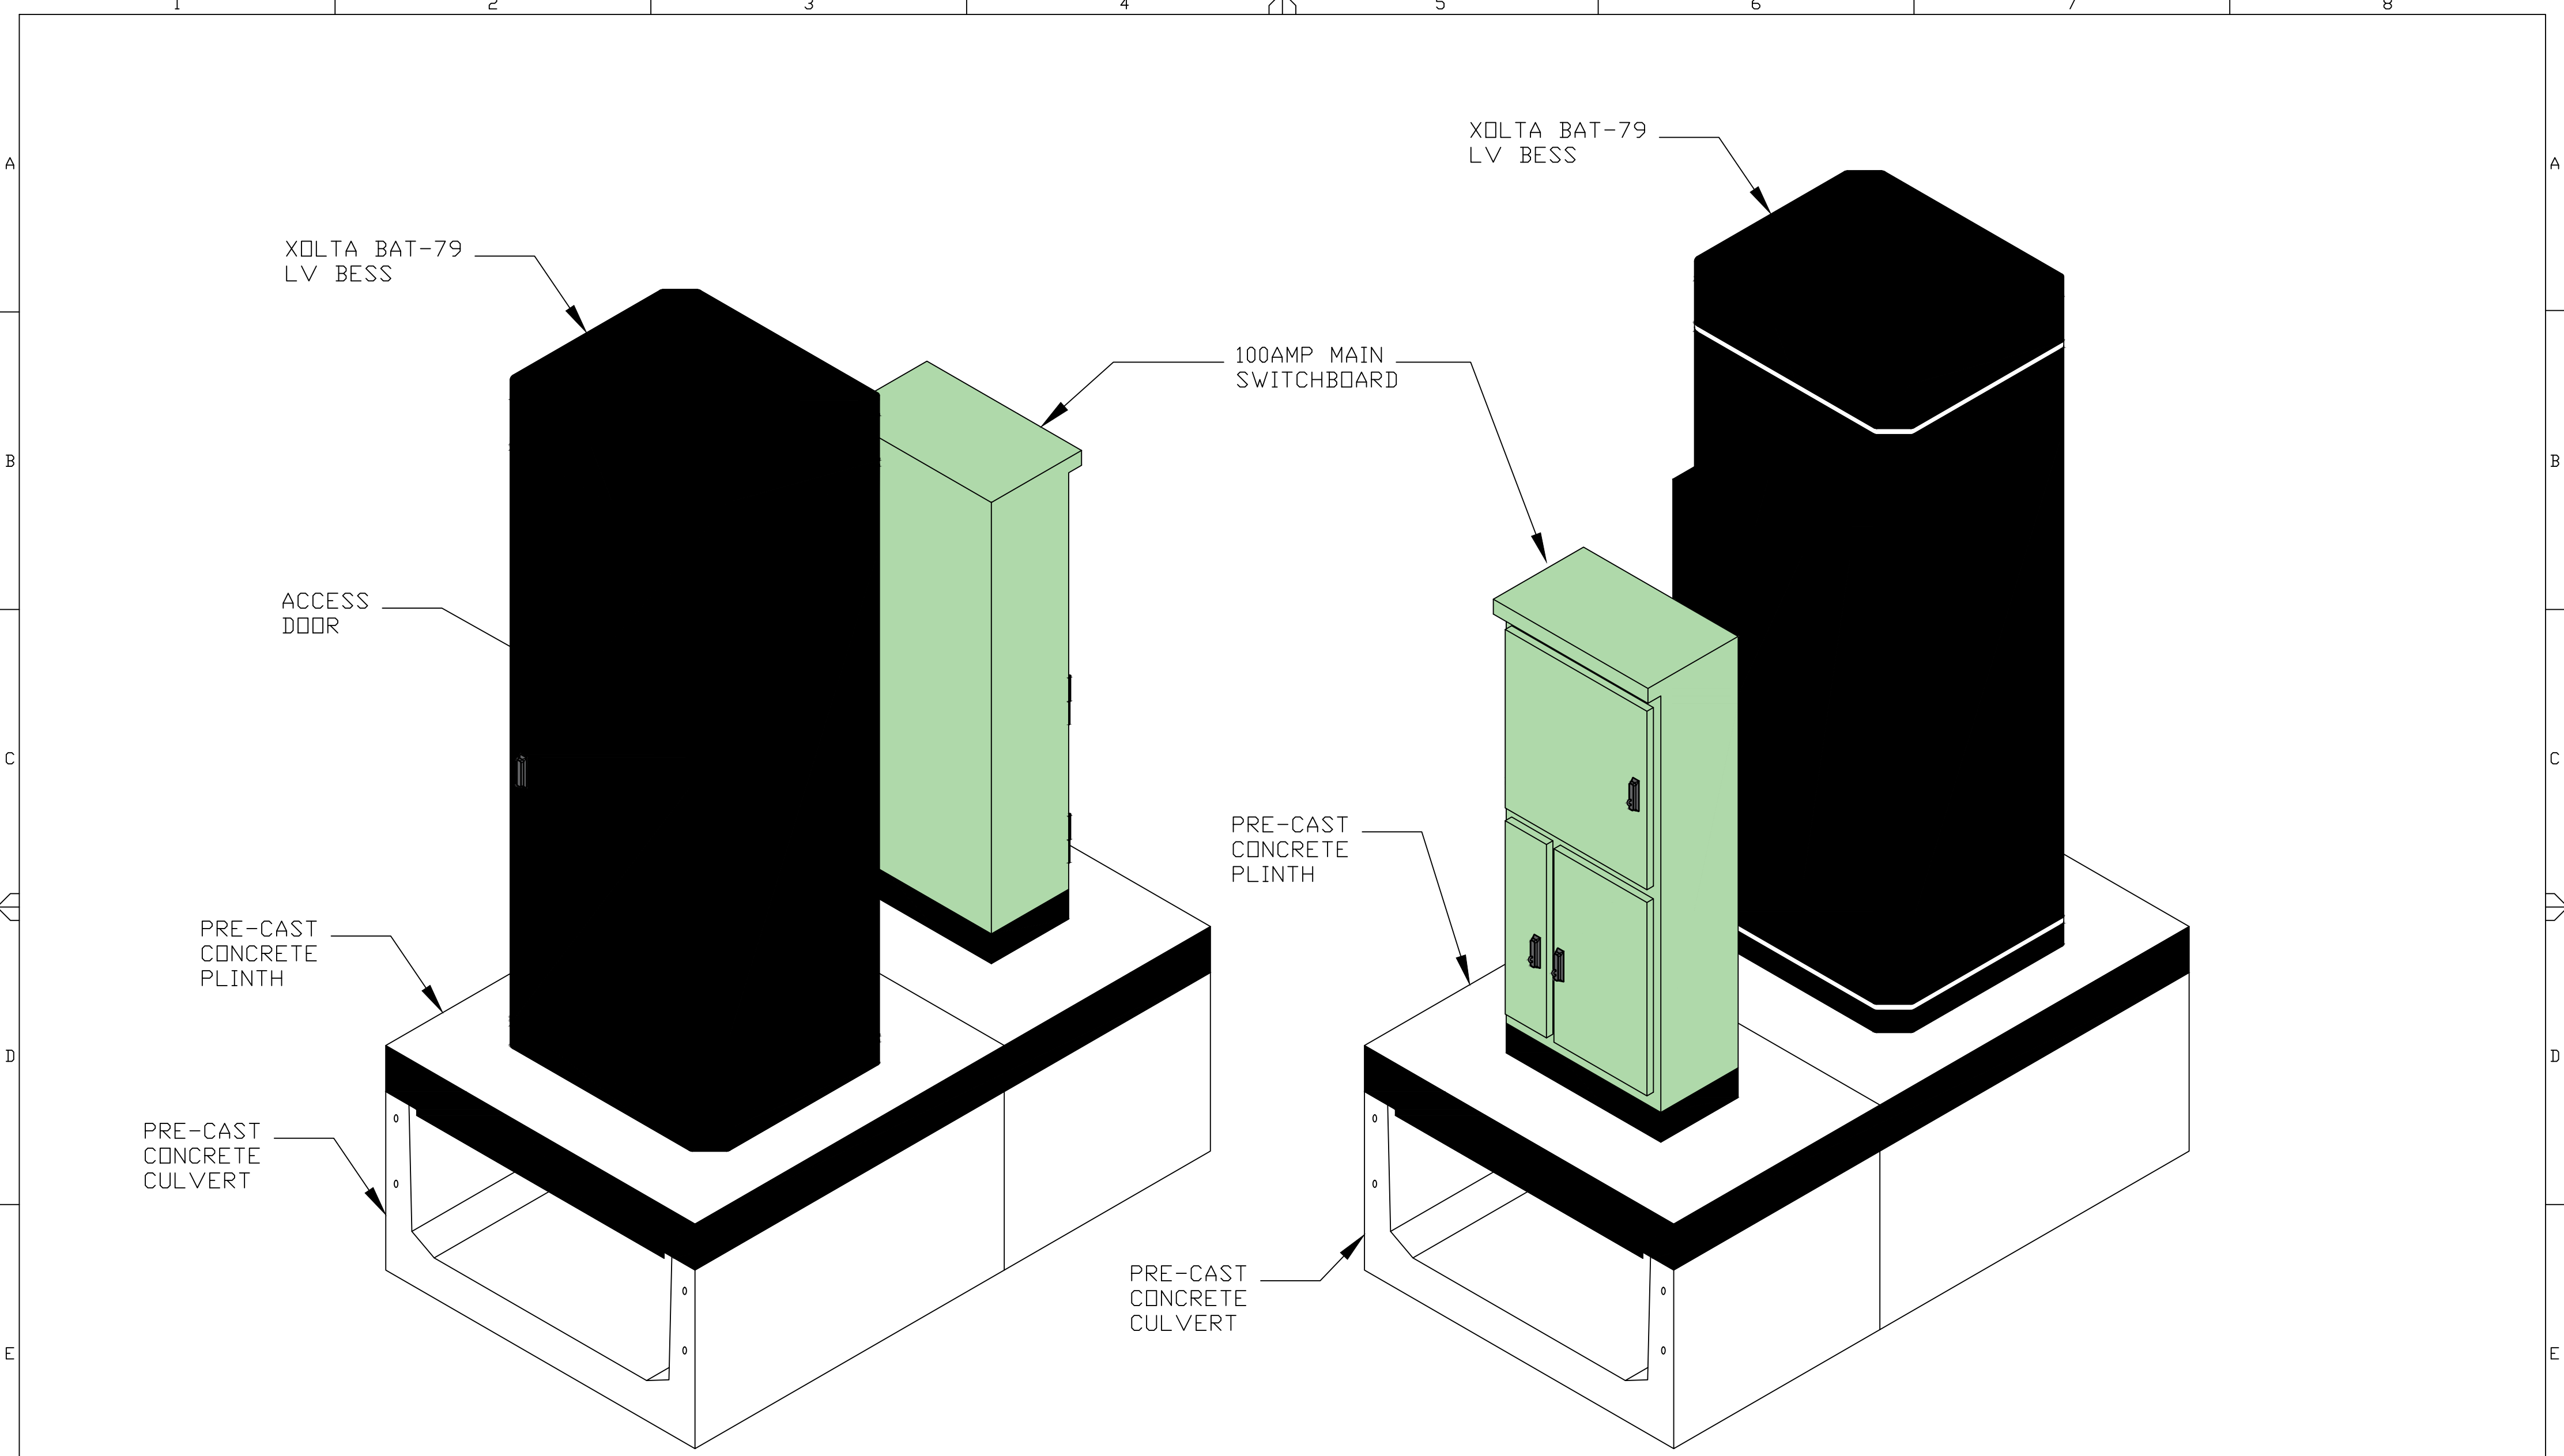




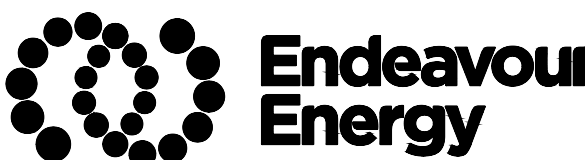


- NOTES
1. THIS DRAWING TO BE USED IN CONJUNCTION WITH THE RELEVANT ENDEAVOUR ENERGY BATTERY SPECIFICATION
 2. CONSUMER MAINS CABLE TO BE <50m IN LENGTH, SIZED APPROPRIATELY FOR CURRENT RATING & VOLTAGE DROP AND INSTALLED IN ACCORDANCE WITH MDI0031 & MCi0006.
 3. CONSUMER MAINS TO BE TERMINATED TO A DEDICATED LV LINK AT THE GRID CONNECTION POINT TO PROVIDE A NETWORK ISOLATION OF THE INSTALLATION. NO OTHER CONNECTIONS ARE TO MADE TO THE DEDICATED LINK & A LABEL IDENTIFYING A BATTERY CONNECTION IS TO BE APPLIED TO THE LINK AND THE PILLAR LID.
 4. A MULTI CORE FLEXIBLE CABLE IS APPROVED FOR USE ONLY BETWEEN THE SWITCHBOARD AND THE BESS UNIT. WHEN USING THIS CABLE THE TERMINATIONS MUST BE FITTED WITH APPROPRIATE CRIMP FERRULES.
 5. MAIN SWITCHBOARD IS SUPPLIED WITH ALL EQUIPMENT INSTALLED AND PRE-WIRED INTERNALLY (EXCL. METER).
 6. DUE TO THE BATTERY INSTALLATION BEING BEHIND THE METER IT IS A REQUIREMENT THAT ALL EARTHING IS IN ACCORDANCE WITH SECTION 6 OF AS3000.

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.				XOLTA BATTERY CABINET FOOTING DETAIL		527285	
		ORIGINAL SCALE NTS		APPROVED A. W		CABINET 80KW BATTERY A			
DESIGNED D.Giles		DATE 27.05.2024		XOLTA BAT-79 COMMUNITY BATTERY AND CONTROL PANEL GENERAL ARRANGEMENT, ELECTRICAL AND EARTHING		DO NOT SCALE DIMENSIONS IN MILLIMITRES		REFERENCE DRAWINGS	
DRAWN 27.05.2024								AUTHORISED/CERTIFIED K. SHANAHAN	
CHECKED R.D								ENGINEERING DELIVERY MANAGER 27.05.2024	
								A2	
								532938	
								SHEET No 1 OF 3 SHEETS	

T	AMENDMENTS							HISTORY
	JOB No -		DESIGN	DR'N	CH'D	DATE	APP'D	
	A							
REVISION A								
ORIGINAL ISSUE								



AMENDMENTS	JOB No -	DESIGN	DRN	CHD	DATE	APP'D	HISTORY	REVISION A ORIGINAL ISSUE	
	A								
 © This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy. DESIGNED D.Giles DATE 27.05.2024 DRAWN 27.05.2024 CHECKED R.D  XOLTA BAT-79 COMMUNITY BATTERY AND CONTROL PANEL GENERAL ARRANGEMENT, ELECTRICAL AND EARTHING XOLTA BATTERY CABINET FOOTING DETAIL CABINET 80KW BATTERY A REFERENCE DRAWINGS DO NOT SCALE DIMENSIONS IN MILLIMITRES AUTHORISED/CERTIFIED K .SHANAHAN ENGINEERING DELIVERY MANAGER 27.05.2024 A2 532938 SHEET No 2 OF 3 SHEETS Civil version 3.0 1 2 3 4 5 6 7 8									

