
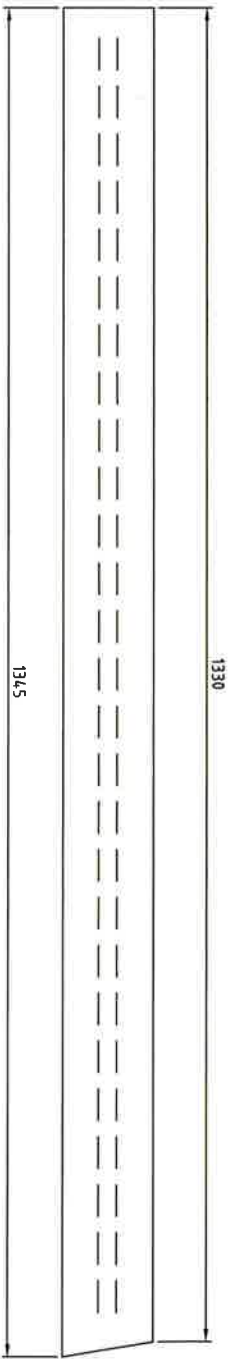


NOTES

1. REINFORCEMENT:-
- 2 x N12 - COVER MIN 30mm.
2. CONCRETE QUALITY SHALL COMPLY WITH AS3600 & THE FOLLOWING:-
- SLUMP.....80mm
- MAX. AGG. SIZE.....10mm
- CEMENT.....TYPE GP TO AS3972
- GRADE OF CONCRETE.....25MPa @ 28 DAYS
- COLOUR.....SANDSTONE COLOUR OXIDE TO BE ADDED TO CONCRETE MIX IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.

END EAVOUR ENERGY
CABLES IN THIS AREA
FOR LOCATIONS
PHONE 131081

THIS NOTE TO BE CAST INTO SURFACE

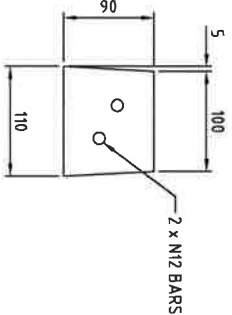

UNDERGROUND HV CABLE ROUTE
MARKER POST
INSTALLED IN OPEN AREAS
DETAIL

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED
D.Asvestas/GST

MGR TRANSMISSION CAPITAL PROJECTS 28/2/06

A3

303319

A

SHEET No 1 OF 1 SHEETS

AMENDMENTS	
ORIGINAL	ISSUE
J R No.	N/A



ORIGINAL
SCALE
15

APPROVED
Glen Perry



This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



DRAWN
BF



DATE
14.02.06



CHKD
RJH