


AMENDMENTS		
A	ORIGINAL ISSUE	
J R No.		DA
B	DR'N	R.V
	CH'D	A.W
	DATE	8-5-24
	JR No	
CHANGED LABELLING INCLUDED 63mm DIA CENTRE DUCT FOR 132kV CIRCUITS.		
EDM		K.S
C	DR'N	S.F
	CH'D	B.G
	DATE	07-11-24
	JR No	N/A
UPDATED NOTES.		
EDM		K.S

NOTES	
1.	225mm HDPE DUCTS FOR 132kV, 180mm HDPE DUCTS FOR 33kV & 66kV.
2.	63mm DIA CENTRE DUCT REQUIRED FOR 132kV CIRCUITS ONLY.
3.	BORE DIAMETER 700mm FOR 132kV AND 600mm FOR 33kV & 66kV CIRCUITS.

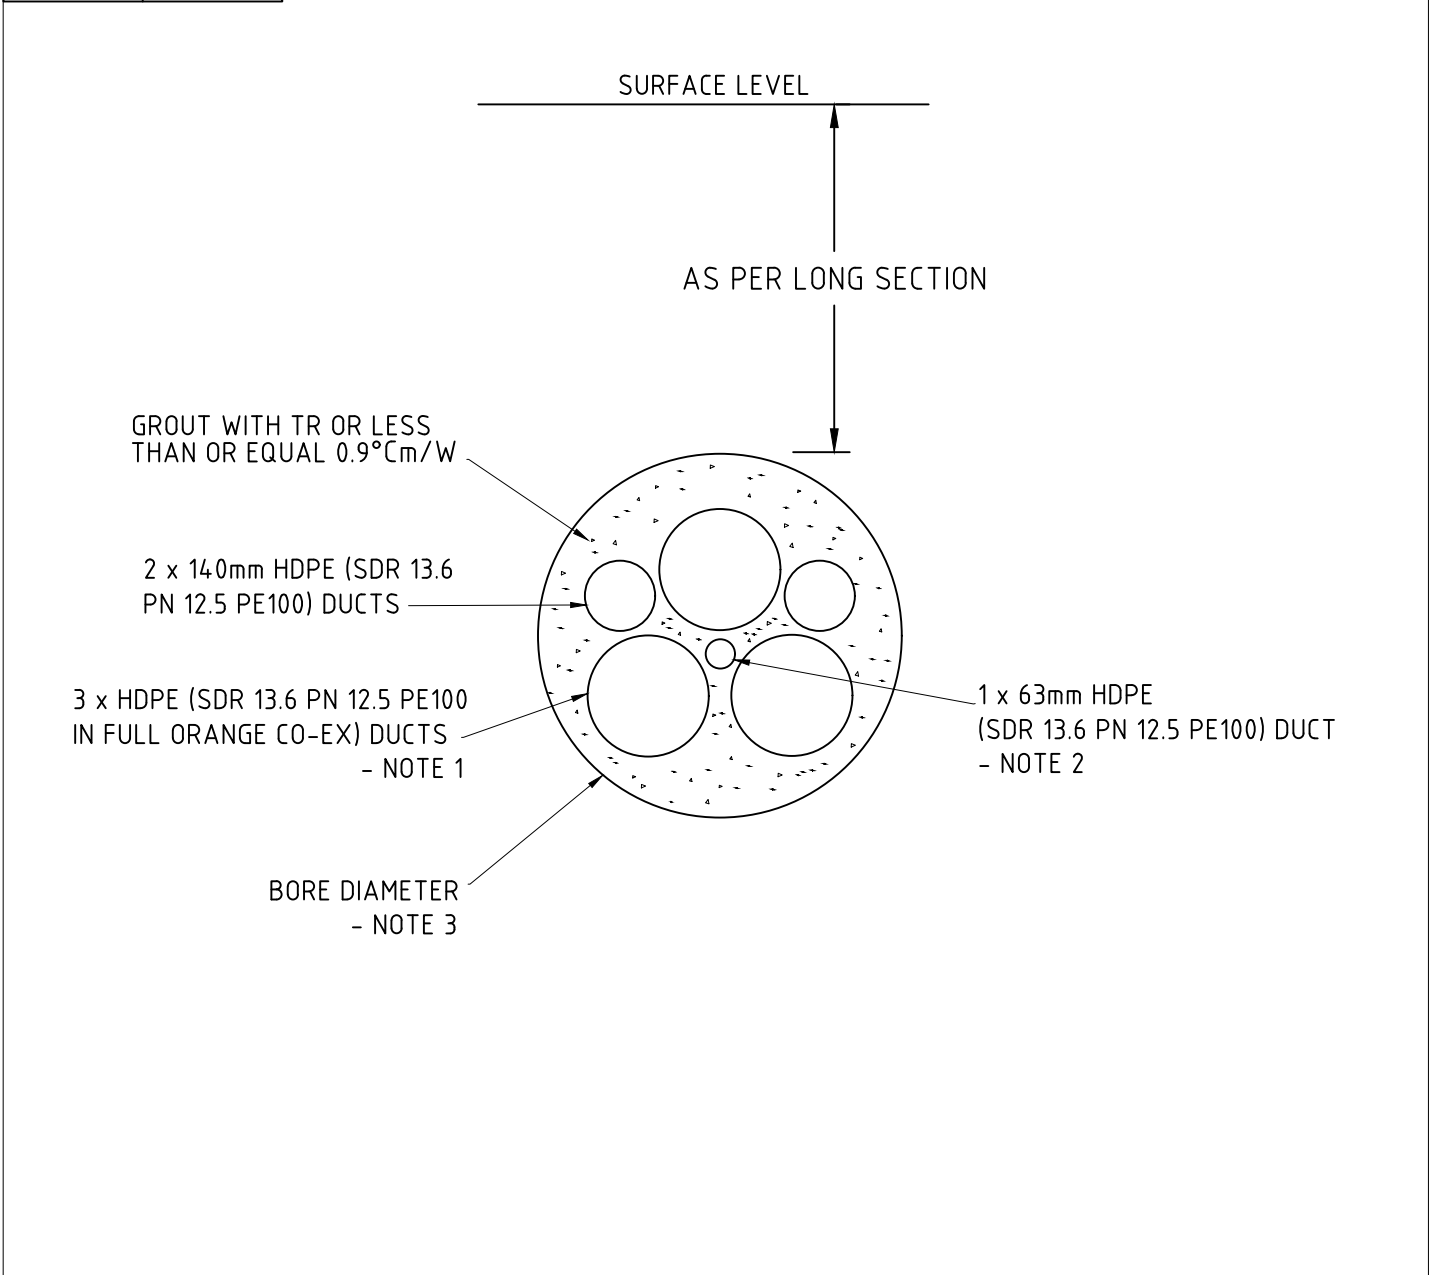

DRAWN	S.M	ORIGINAL SCALE	1:10
DATE	23.10.17	APPROVED	D. MATE
CH'D	D.M	A4 507646 c	
CROSS SECTION DRAWING FOR UNDERBORE CONSTRUCTIONS (TREFOIL FORMATION)		SHEET No 1 OF 1 SHEETS	