



NOTES

1. LINK BOX PIT DEPTH SHALL NOT EXCEED 150CM. AS MEASURED FROM THE PIT LID COVERS.
2. PIT WALLS AND FLOOR TO BE REINFORCED 15 MPa CONCRETE.
3. CONDUITS ENTERING PITs ARE TO BE PROVIDED WITH BELLMOUTH FITTINGS.
4. CONDUITS ENTERING THE LINK BOX PIT SHALL BE 100MM HD PVC ORANGE.
5. INTERNAL PIT WALL SHALL BE PROVIDED WITH CLIMBING SUPPORTS, EMBEDDED INTO WALL.
6. A DRAINAGE PUMP IS TO BE FORCED INTO THE CONCRETE FLOOR OF THE PIT.

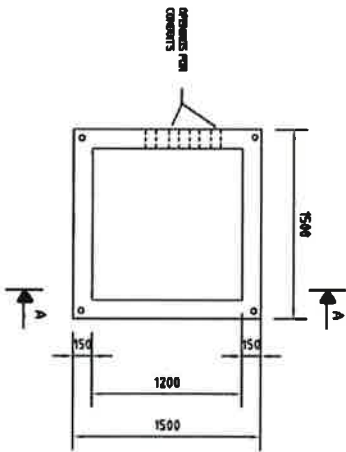

LINK BOX PIT PLAN
SCALE 1:10

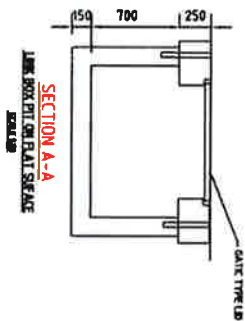

SECTION A-A
LINK BOX PIT ON PLAT SPACE
SCALE 1:10

23/11/17



LINK BOX CROSS SECTION

DO NOT SCALE
DIMENSIONS
IN MILLIMETRES

REFERENCE DRAWINGS
AUTHORISED/CERTIFIED
DASVESTAS

MANAGER ASSET STANDARDS AND DESIGN 23.10.17

A4

507647

SHEET No 1 OF 1 SHEETS

JOB No	N/A
DESIGN	S.M
DR'N	S.M
CH'D	D.M
DATE	27.10.17
APP'D	D.M

	DESIGNED	S.M	DATE	23.10.17
	DRAWN	S.M		
	CHECKED	D.M		

① This drawing and the copyright therein are the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.