


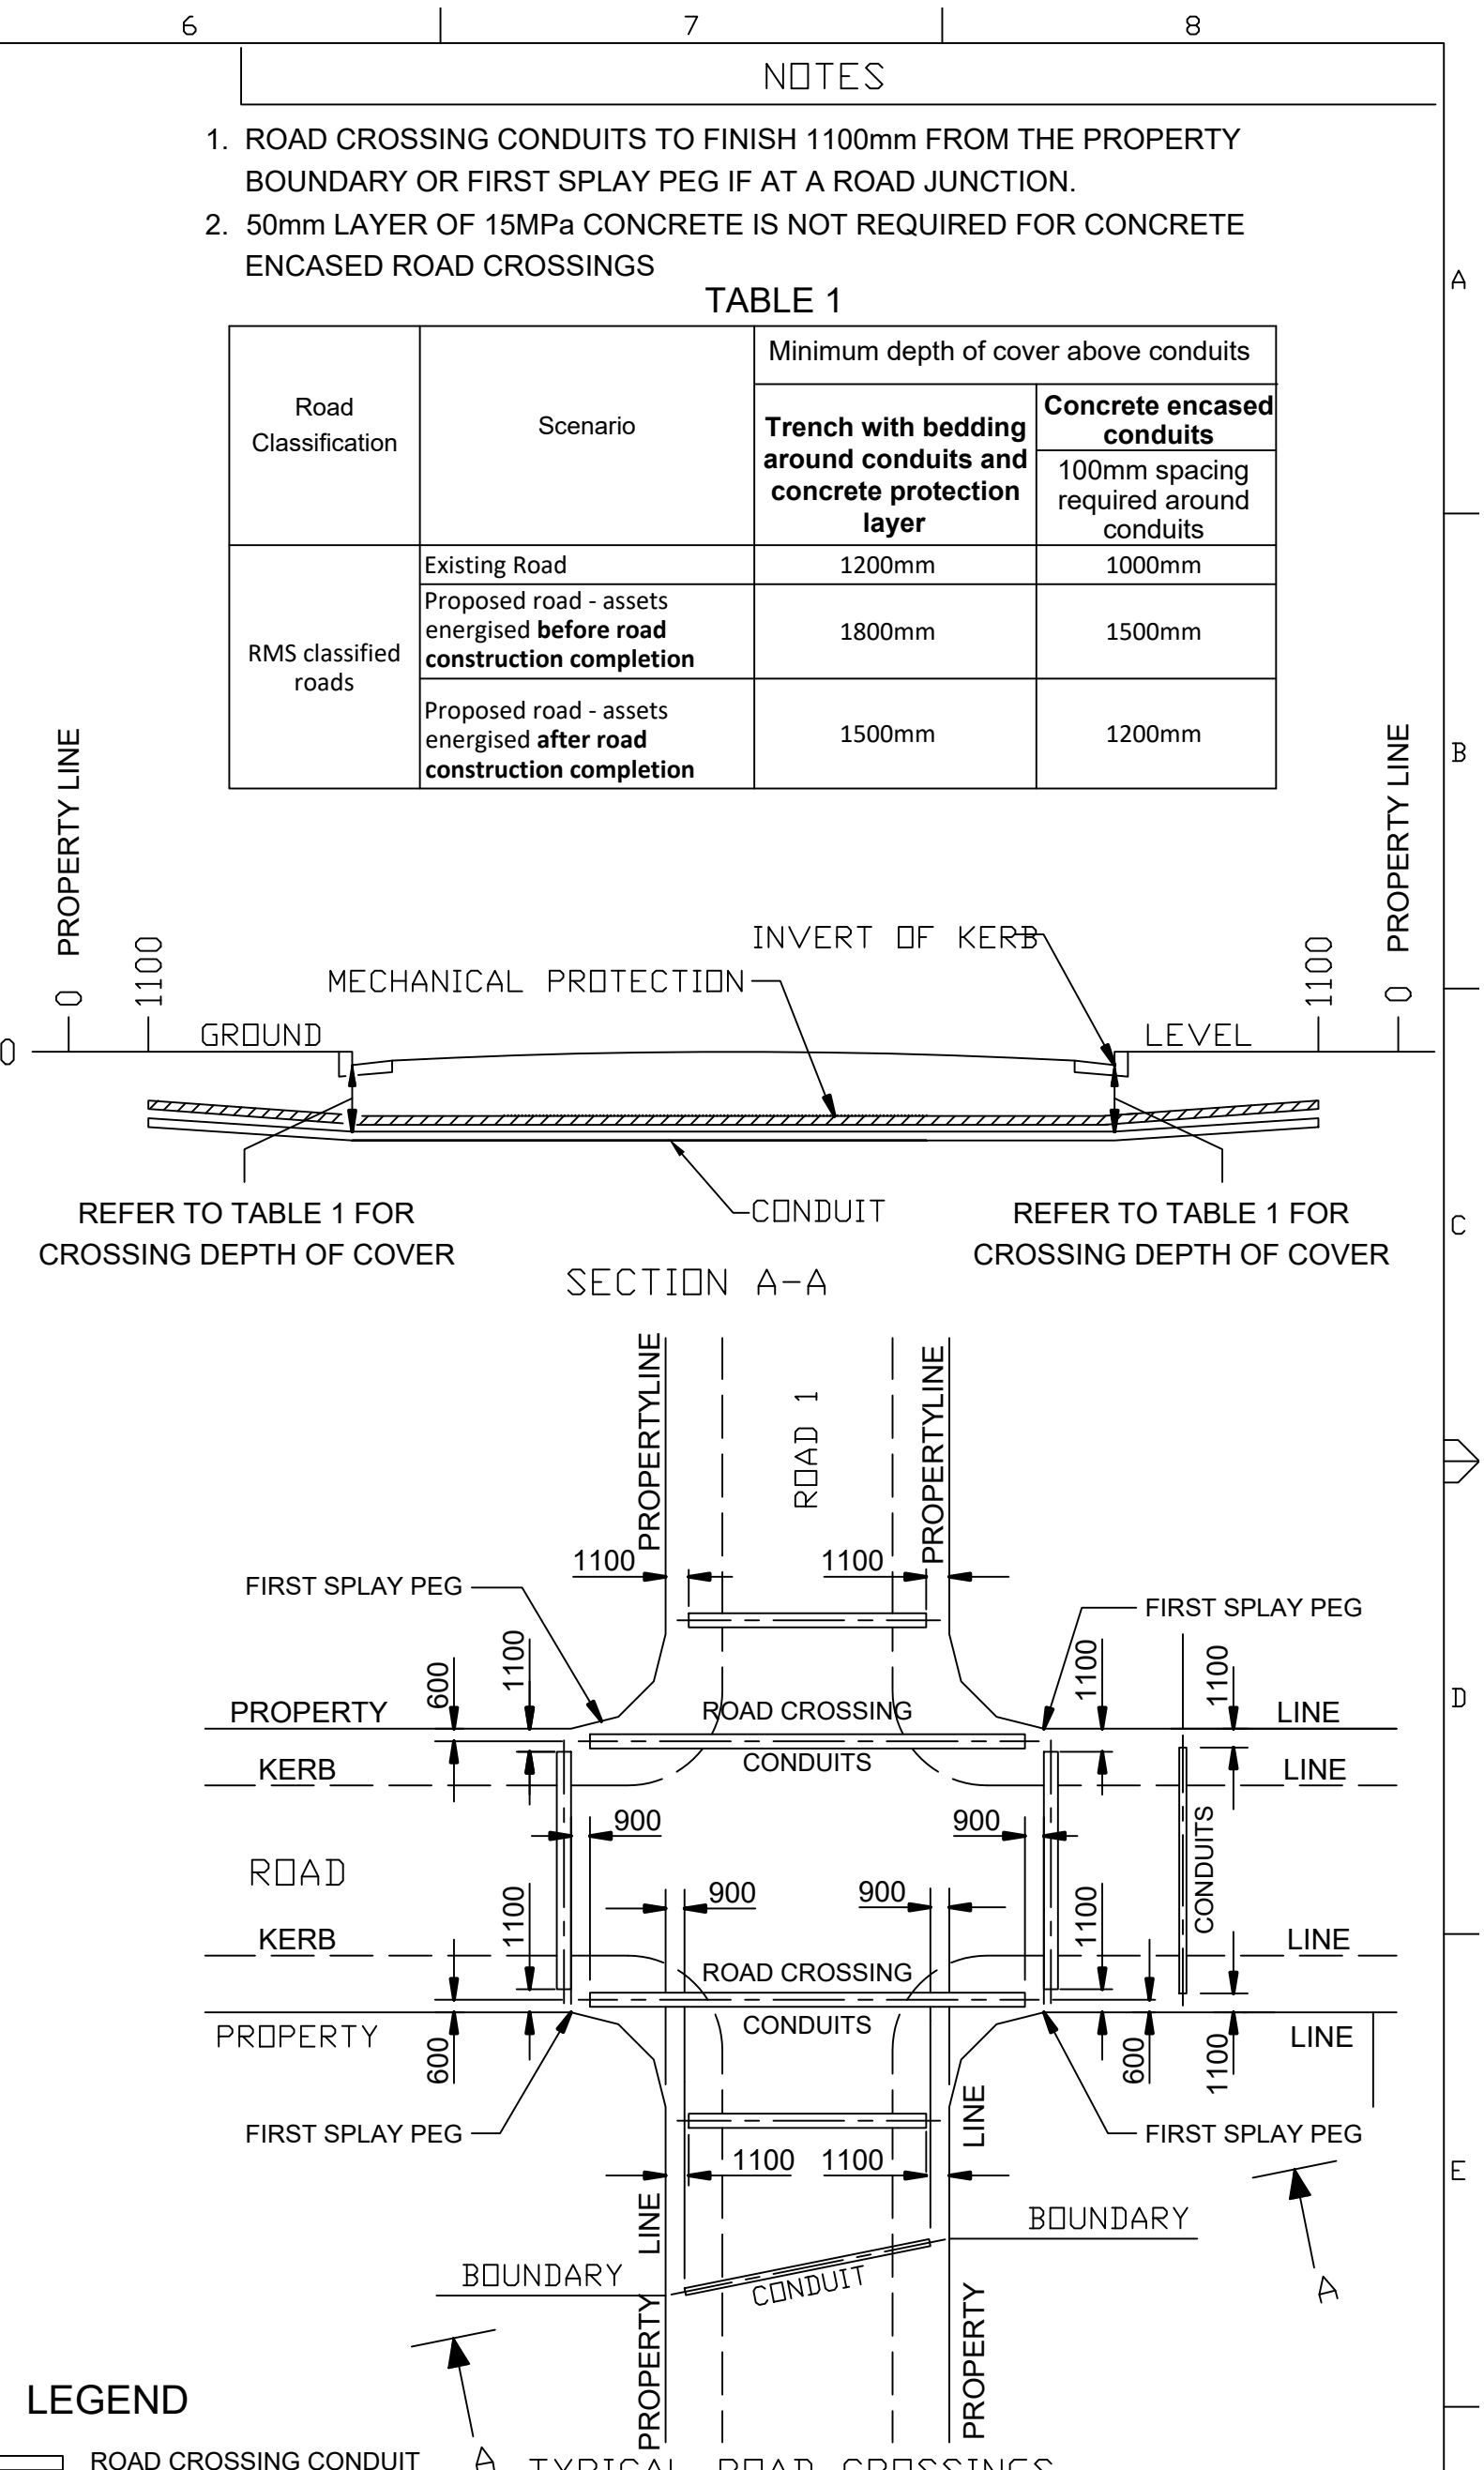

	J R No.	NA	D/RN D.J.Z. DATE 07-9-90 JR NO 900136 C DUCT CONFIGURATION ID NOS DELETED TO CONFIRM TPID REVISION 'D'.	M.S.D. J.W. M.S.D.	D/RN D.J.Z. DATE 27-8-92 JR NO 920057 D SERVICE DUCT END WAS 600 BELOW GROUND LEVEL.	M.S.D. B.M.C.D. D/RN D.J.Z. DATE 29-9-94 JR NO 940149 E NOTES REVISED: REF TO P.E. TECH. PUB. 10 DELETED.	M.D.M. B.M.C.D. D/RN D.J.Z. DATE 20-11-96 JR NO 960076 F TELSTRA WAS TELECOM 125mm MIN ADDED TO SERVICE DUCT.	M.N.M.A. G.V.H. D/RN D.J.Z. DATE 13-8-97 JR NO 970055 G ROAD CROSSING DUCTS EXTENDED (D-7).	M.N.M.A. G.V.H. D/RN R/H CH/D R/LH DATE 08-12-98 JR NO VVX91144 H NOTE 3 ADDED TELSTRA CONDUITS DELETED.	D.A.S.M. M.O.T. D/RN M.G. CH/D A.G.L. DATE 04-12-2015 JR NO - I 75mm LAYER OF 15MPa CONCRETE PVC WARNING TAPE & 2x50 DUCTS	D.A.S.M. M.O.T. D/RN K/T CH/D C/P DATE 11-08-2021 JR NO - K NEW ROAD 1 & CONDUITS ADDED TO TYPICAL ROAD CROSSINGS DIAGRAM AS MARK UPS.	D.A.S.M. K.S. D/RN P CH/D O/G DATE 15/7/2025 JR NO - L 50mm CONCRETE LAYER WAS 75mm	 ORIGINAL SCALE APPROVED K. SHANAHAN DRAWN D.J.Z. CHECKED D.J.Z. DATE 27-6-89 DATE DATE	Endeavour Energy CROSSINGS FOR RMS CLASSIFIED ROADS TYPICAL CONDUIT AND TRENCH ARRANGEMENTS ROAD CROSSINGS	DO NOT SCALE DIMENSIONS IN MILLIMITRES	AUTHORISED/CERTIFIED J. PERERA	MANAGER PRIMARY SYSTEMS	A2	060786	L	SHEET No 2 OF 2 SHEETS
--	---------	----	---	--------------------------	--	---	---	---	--	--	--	---	---	--	--	--------------------------------	-------------------------	----	--------	---	------------------------