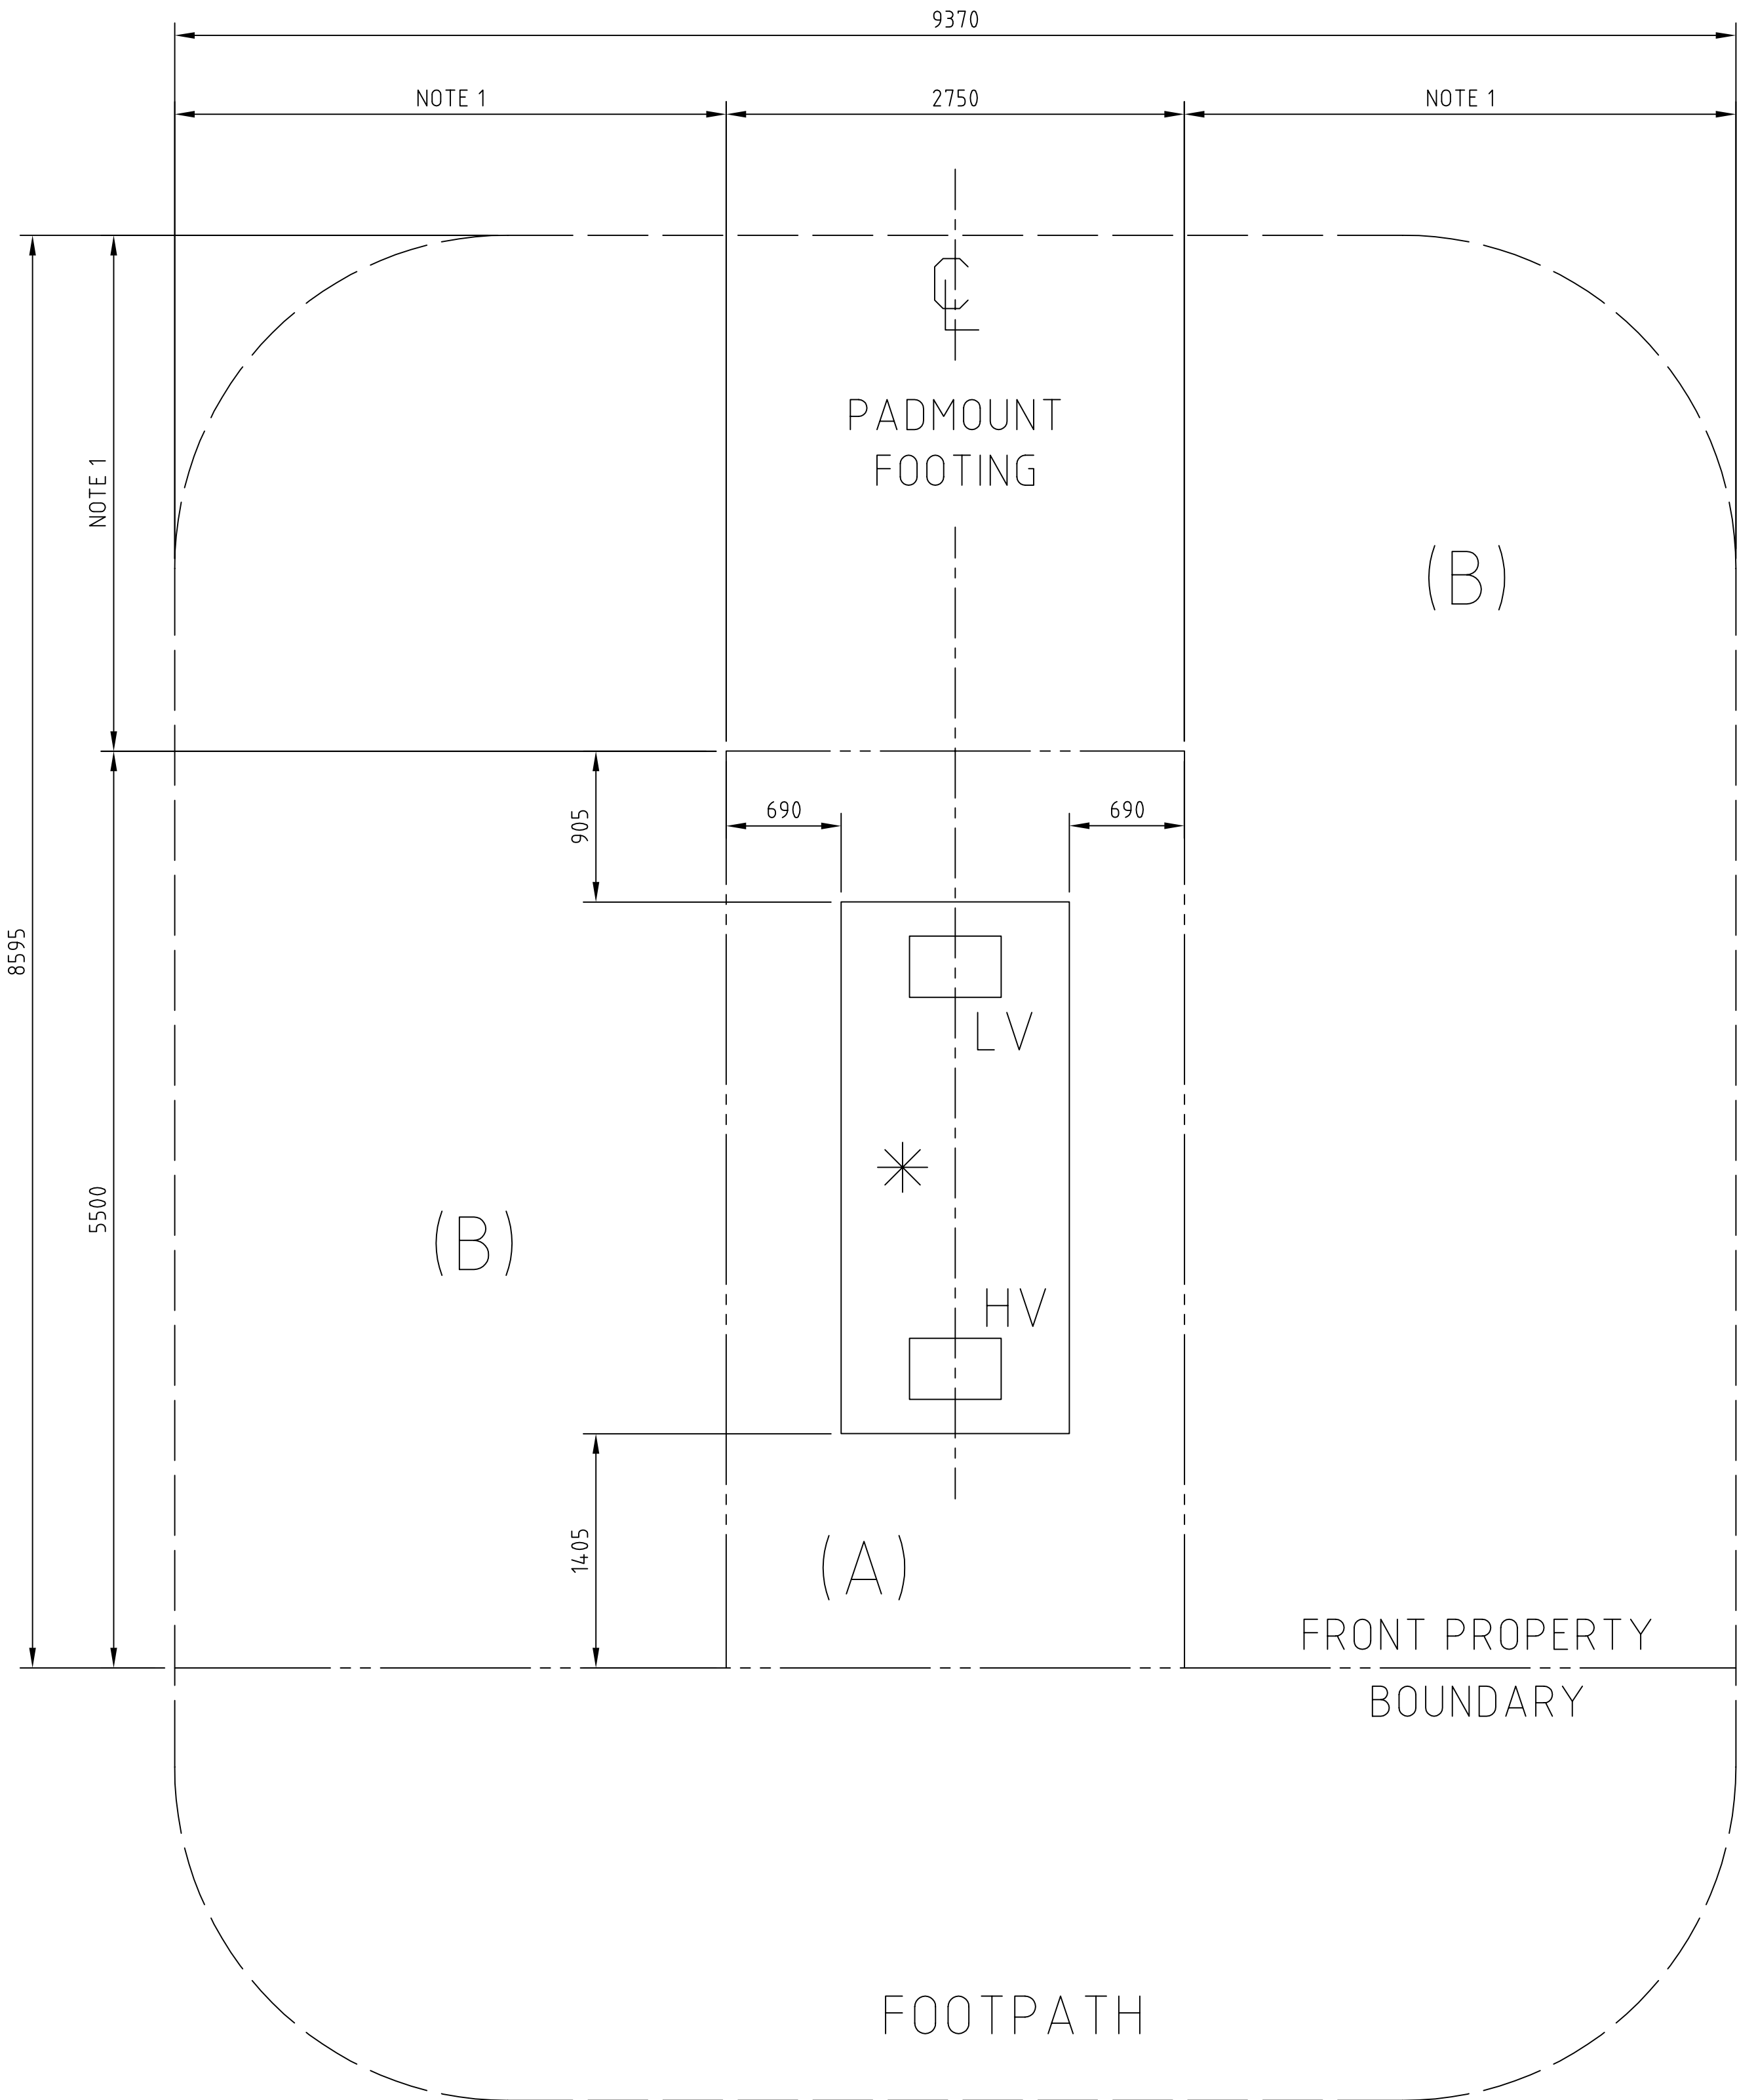


AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	

EASEMENT PROPOSALS FOR PADMOUNT SUBSTATION

GENERAL ARRANGEMENT



NOTE

- COVENANT DIMENSIONS SHOULD BE CHECKED TO ENSURE THEY COMPLY WITH SDI 100 AND SUBSTATION DESIGN STANDARDS.
- UNRESTRICTED 24 HOUR ACCESS TO THE SUBSTATION IS REQUIRED, DIRECTLY FROM A PUBLIC STREET FOR PERSONNEL AND HEAVY VEHICLES.
- EASEMENT TO BE UNENCUMBERED BY FENCING. WHERE FENCING ENCROACHES ON THE EASEMENT THE EASEMENT MUST BE MOVED.

www.dialbeforeyoudig.com.au





DIAL 1100
BEFORE YOU DIG

* PLINTH DIMENSIONS
3.19m x 1.37m

(A) EXISTING EASEMENT
AREA IS 15.1m²

(B) COVENANT

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.					
		ORIGINAL SCALE 1:30		APPROVED D.Marshall		REFERENCE DRAWINGS	
DRAWN J.H.						DO NOT SCALE DIMENSIONS IN MILLIMETRES	
DATE 24-08-05						AUTHORISED W.Isley	
CH'D DM						MANAGER ASSET ENGINEERING	
						26.10.05	
						A2P 289702 A	
						SHEET No 1 OF 7 SHEETS	

FENCING ARRANGEMENT FOR
PADMOUNT SUBSTATION
(EASEMENT DETAILS)