


AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	

SCENARIO No.2

PARTIALLY FENCED

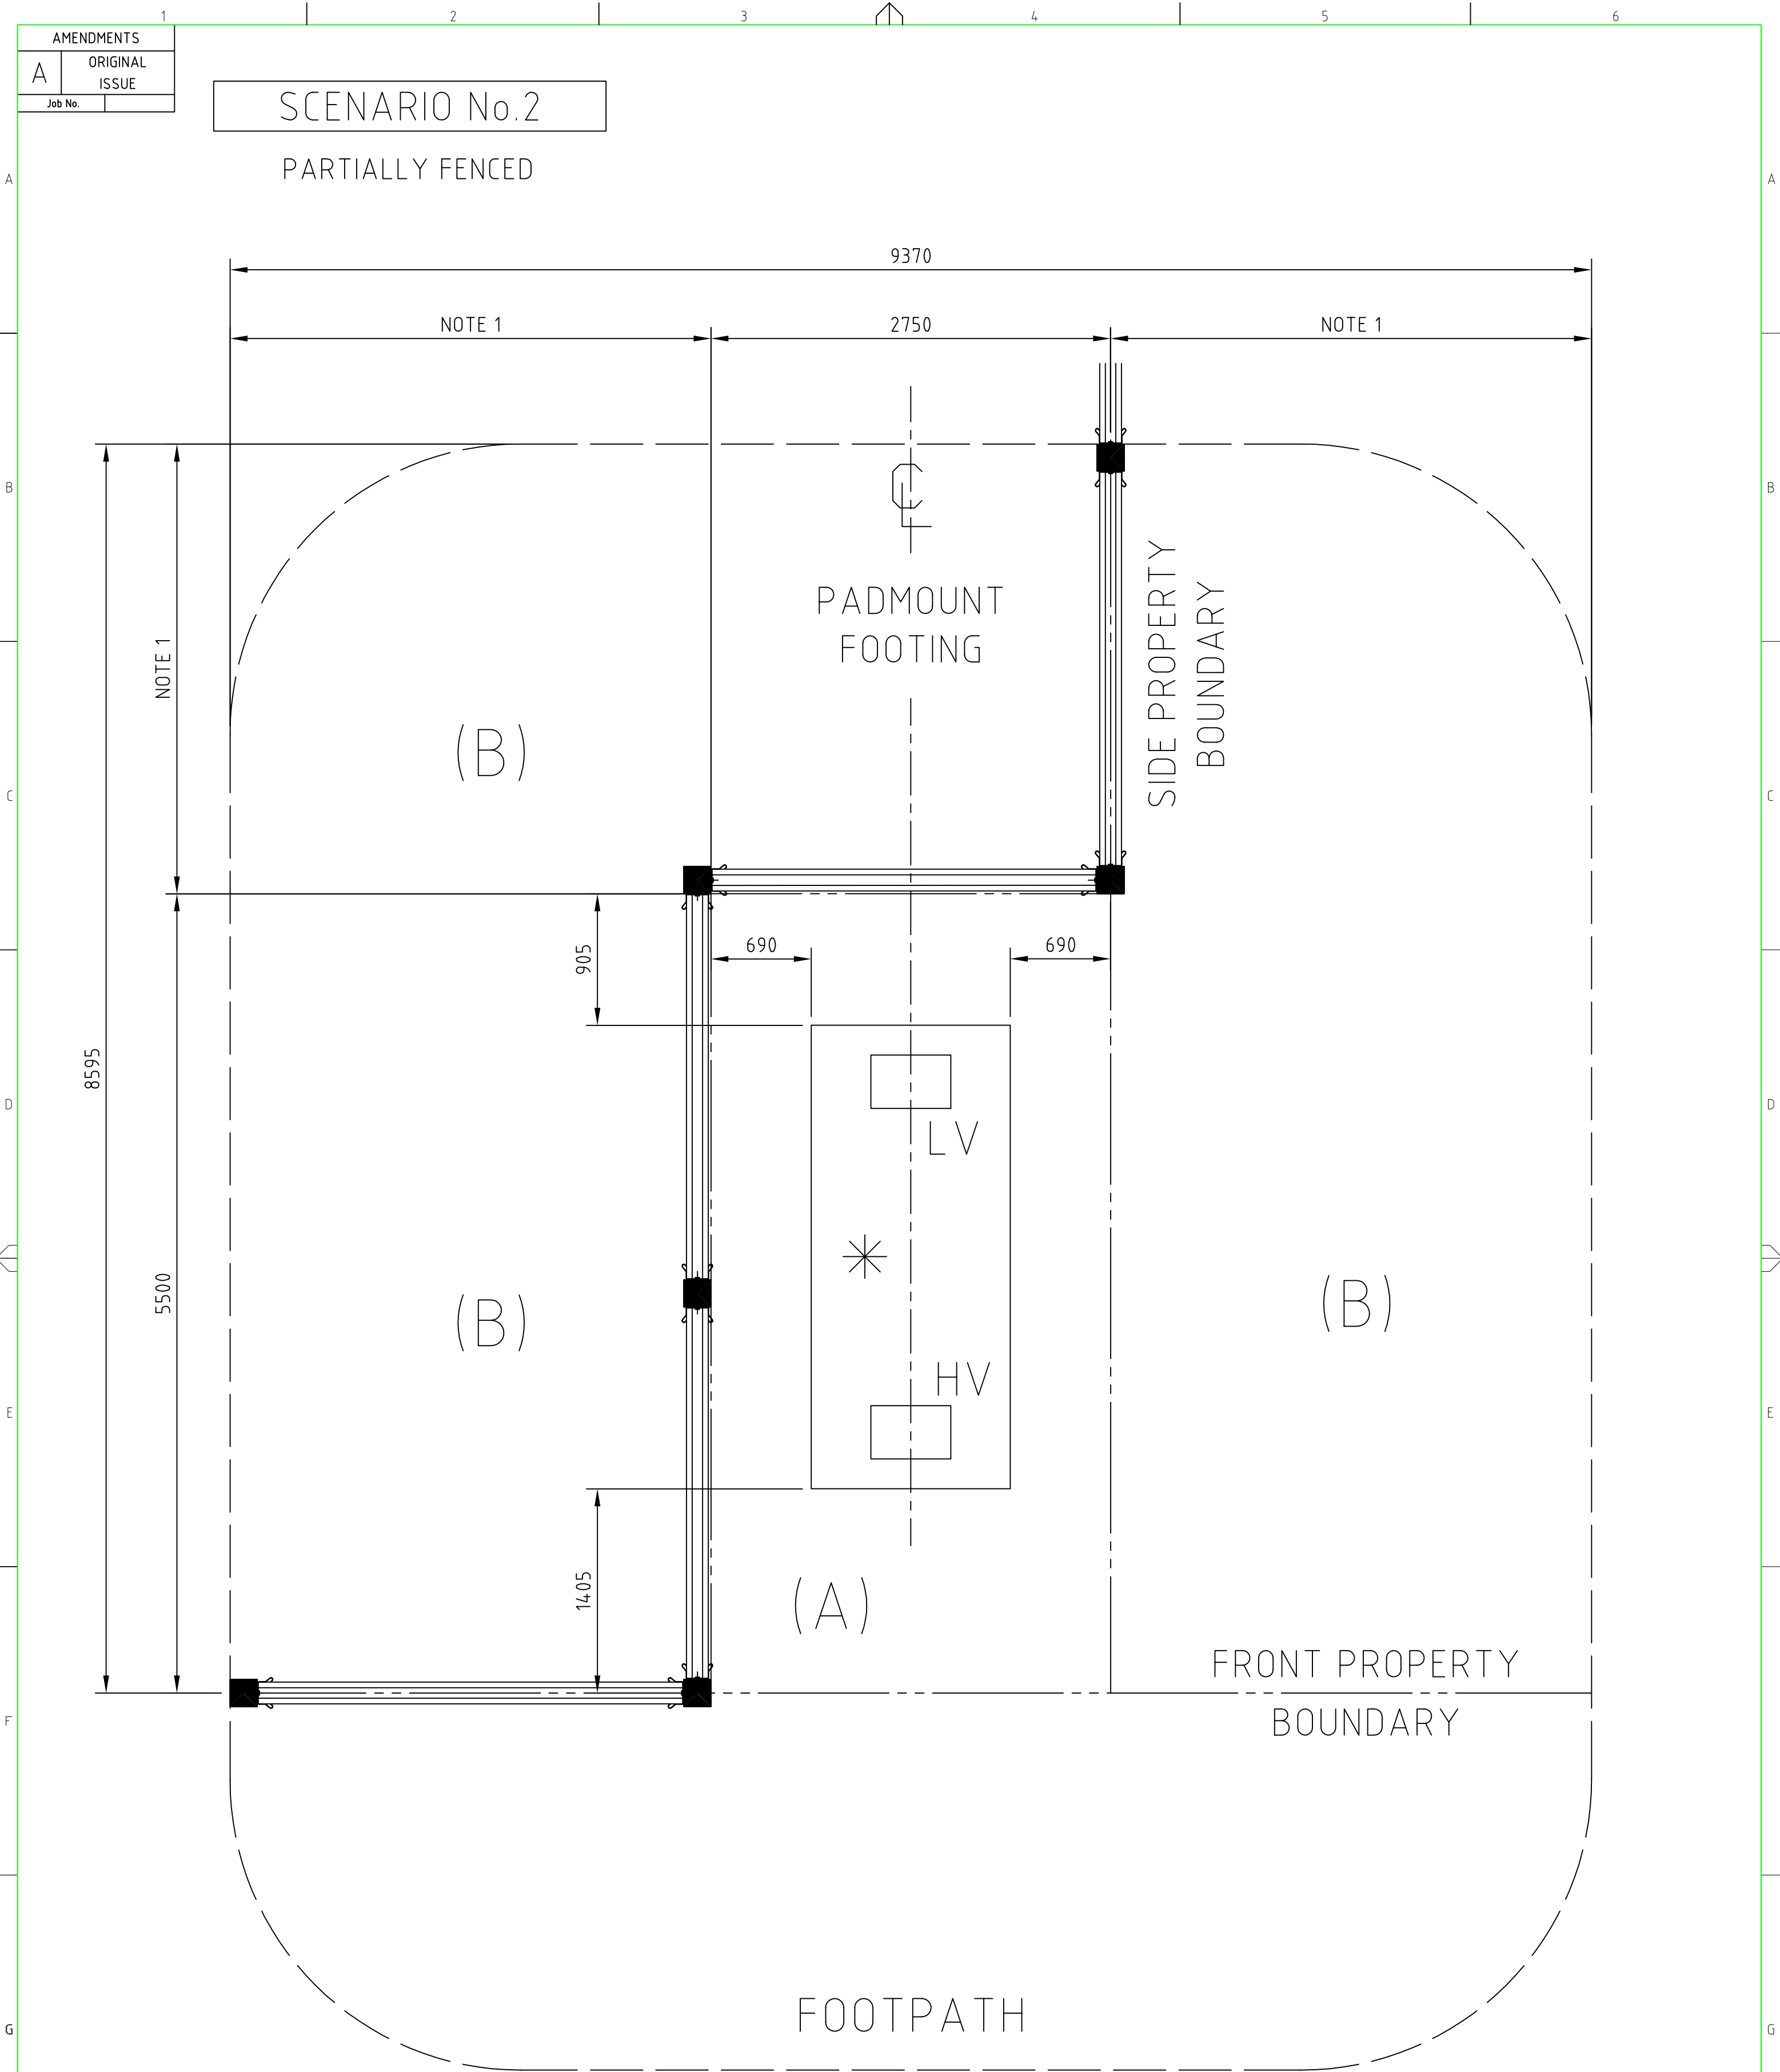

NOTE

1. COVENANT DIMENSIONS SHOULD BE CHECKED TO ENSURE THEY COMPLY WITH SDI 100 AND SUBSTATION DESIGN STANDARDS.
2. UNRESTRICTED 24 HOUR ACCESS TO THE SUBSTATION IS REQUIRED, DIRECTLY FROM A PUBLIC STREET FOR PERSONNEL AND HEAVY VEHICLES.
3. EASEMENT TO BE UNENCUMBERED BY FENCING. WHERE FENCING ENCROACHES ON THE EASEMENT THE EASEMENT MUST BE MOVED.

www.dialbeforeyoudig.com.au

 **DIAL 1100**
BEFORE YOU DIG


■ FOR SEPARATELY EARTHED SUBSTATIONS, INSULATED POSTS ARE REQUIRED ON ALL PANELS UP TO & INCLUDING 4m FROM SUBSTATION.

✱ PLINTH DIMENSIONS
3.19m x 1.37m

▬ FENCE

(A) EXISTING EASEMENT
AREA IS 15.1m²

(B) COVENANT

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.		Endeavour Energy		
	ORIGINAL SCALE 1:30	APPROVED D.Marshall				
DRAWN	J.H.		FENCING ARRANGEMENT FOR PADMOUNT SUBSTATION SCENARIO No.2			
DATE	24-08-05					
CH'D	DM					
					REFERENCE DRAWINGS	
					DO NOT SCALE DIMENSION IN MILLIMETRES	AUTHORISED W.Isley
					MANAGER ASSET ENGINEERING 26.10.05	
					A2P	289702 A
					SHEET No 3 OF 7 SHEETS	