


AMENDMENTS	
A	ORIGINAL ISSUE
Job No.	

SCENARIO No.4

FULLY FENCED OUT PADMOUNT SUBSTATION WITH
OR WITHOUT REMOVABLE FRONT PANEL ON A GATE

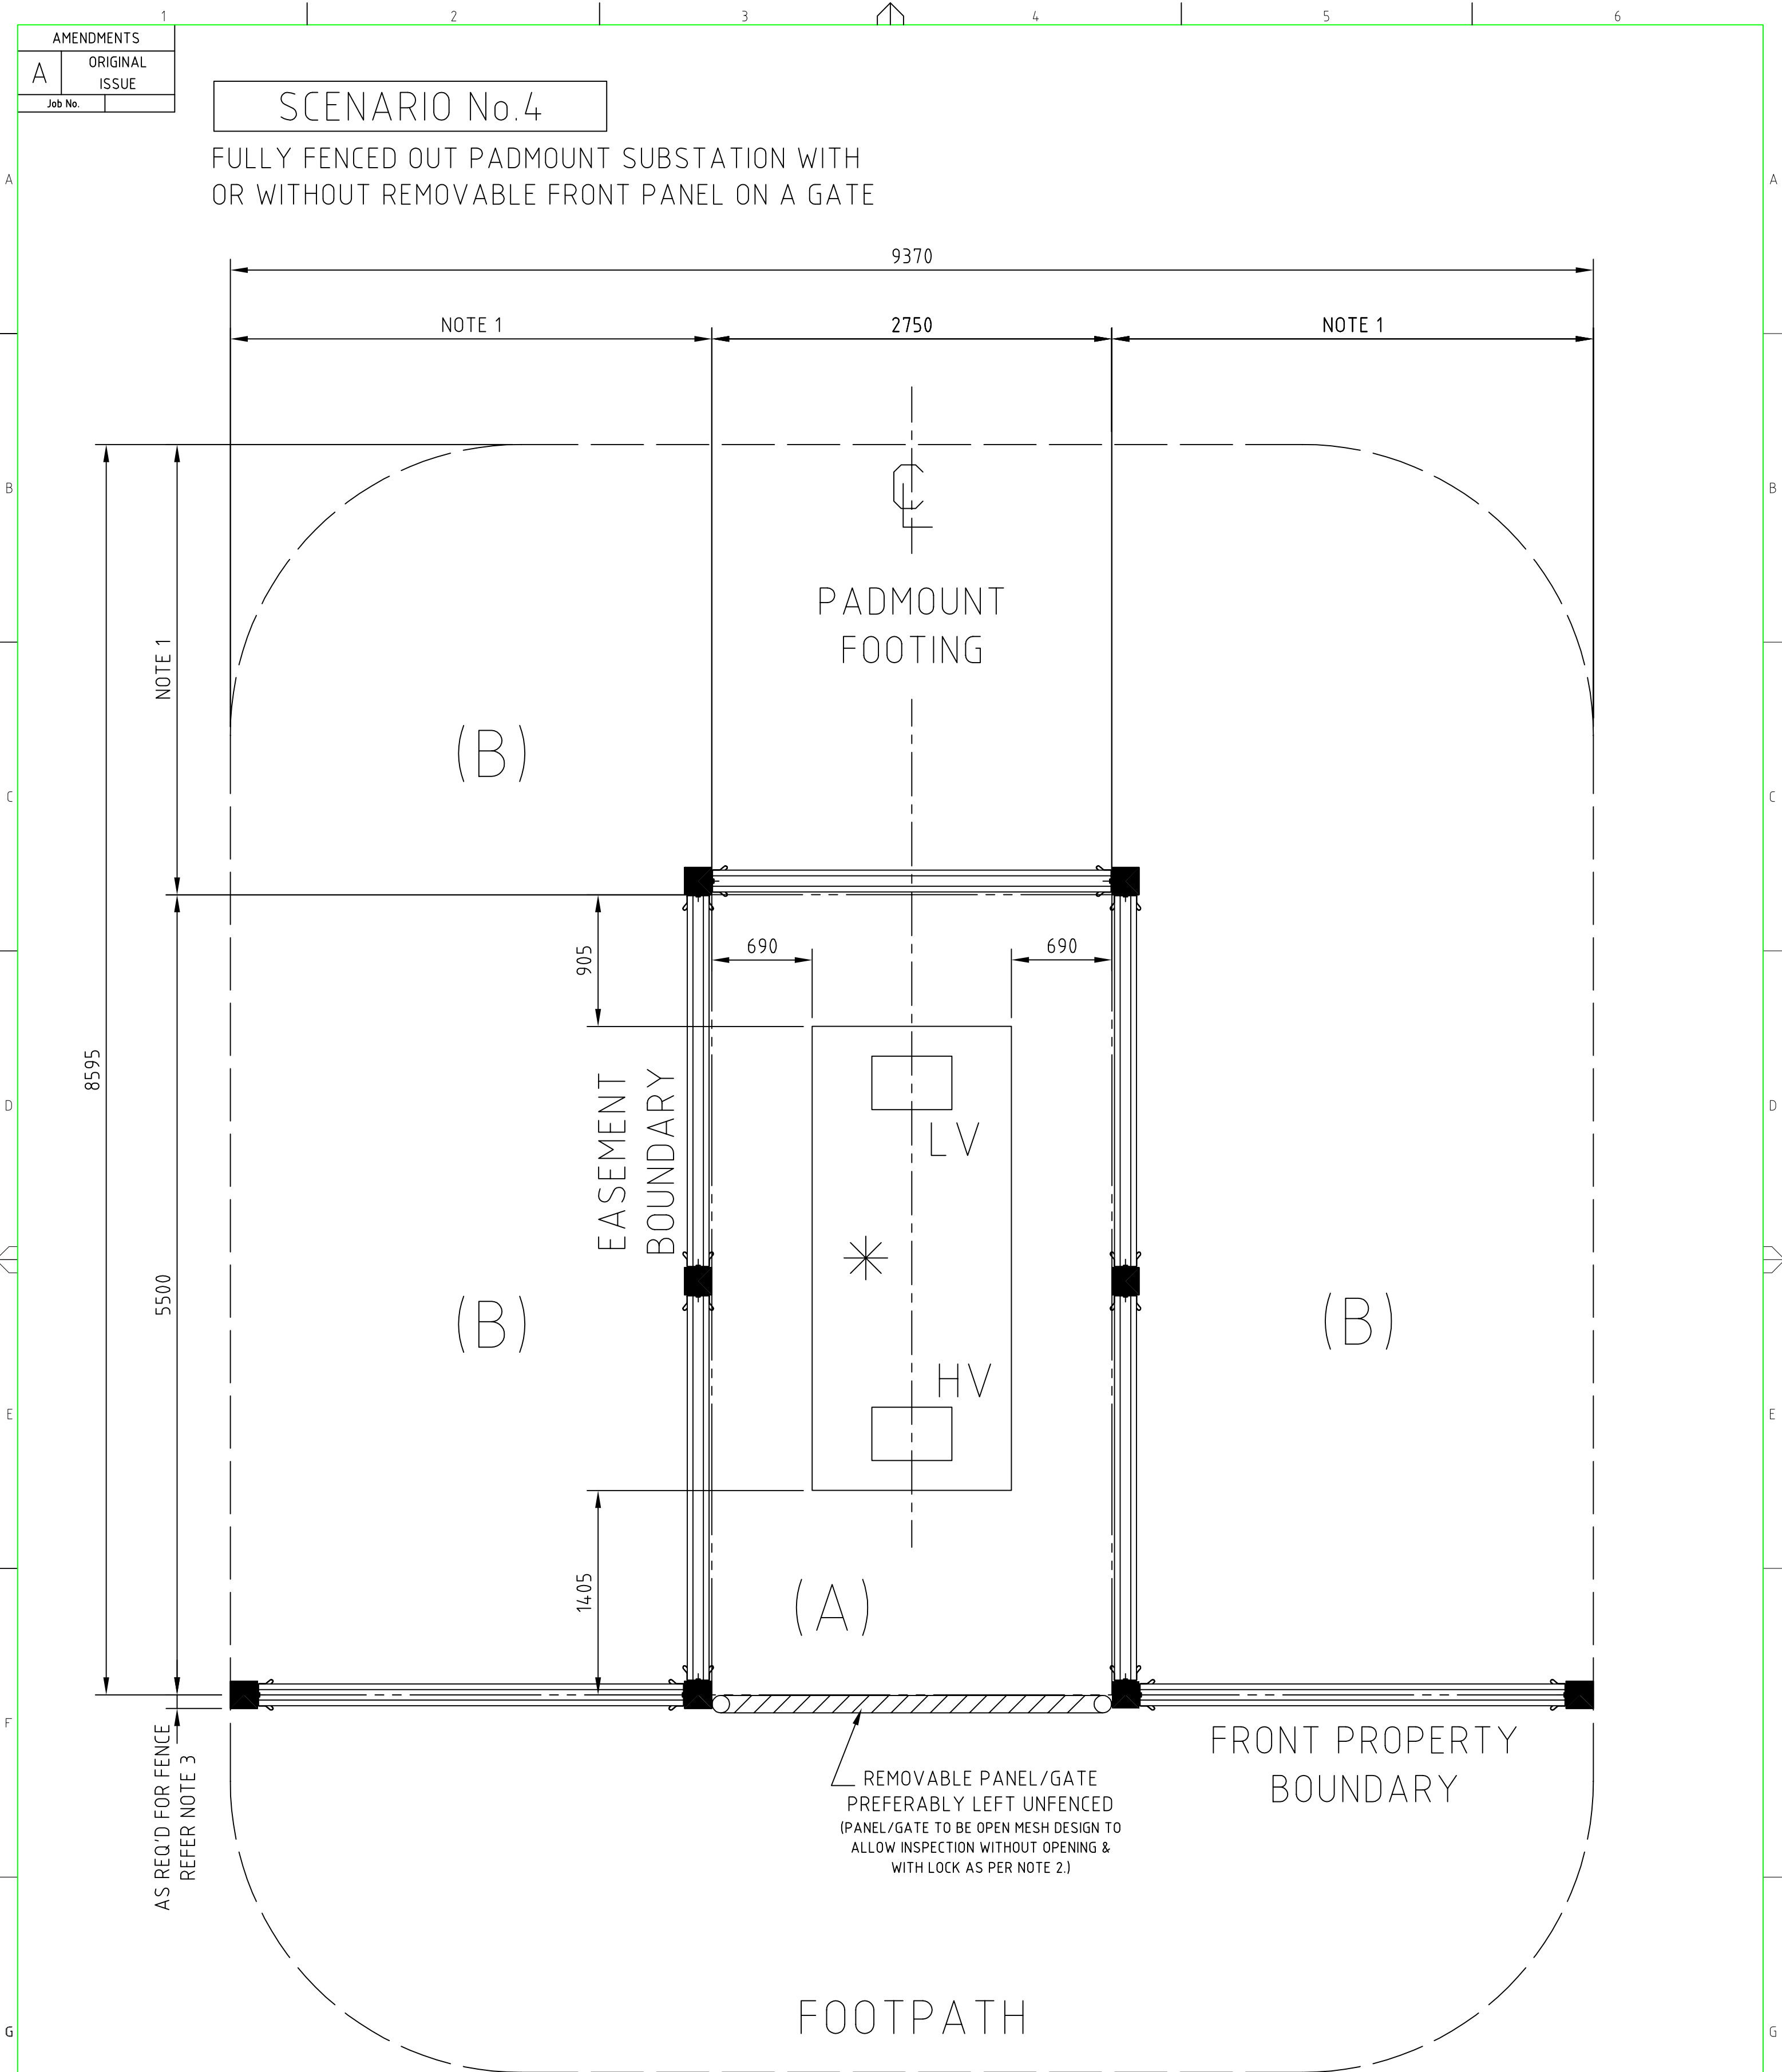

NOTE

1. COVENANT DIMENSIONS SHOULD BE CHECKED TO ENSURE THEY COMPLY WITH SDI 100 AND SUBSTATION DESIGN STANDARDS.
2. UNRESTRICTED 24 HOUR ACCESS TO THE SUBSTATION IS REQUIRED, DIRECTLY FROM A PUBLIC STREET FOR PERSONNEL AND HEAVY VEHICLES. IF LOCKED THEN PANEL/GATE IS TO BE FITTED WITH "IE" SERIES LOCK.
3. EASEMENT TO BE UNENCUMBERED BY FENCING. WHERE FENCING ENCROACHES ON THE EASEMENT THE EASEMENT MUST BE MOVED.

www.dialbeforeyoudig.com.au

 **DIAL 1100**
BEFORE YOU DIG

■ FOR SEPARATELY EARTHED SUBSTATIONS, INSULATED POSTS ARE REQUIRED ON ALL PANELS UP TO & INCLUDING 4m FROM SUBSTATION.

* PLINTH DIMENSIONS
3.19m x 1.37m


(A) EXISTING EASEMENT
AREA IS 15.1m²

(B) COVENANT

▬ FENCE

▨ GATE/REMOVABLE
FENCE PANEL

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
	ORIGINAL SCALE 1:30	APPROVED D.Marshall	
DRAWN	J.H.		
DATE	25-08-05		
CH'D	DM		



**Endeavour
Energy**

FENCING ARRANGEMENT FOR
PADMOUNT SUBSTATION
SCENARIO No.4

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS

AUTHORISED
W.Isley

MANAGER ASSET ENGINEERING

26.10.05

A2P

289702

A

SHEET No 5 OF 7 SHEETS