


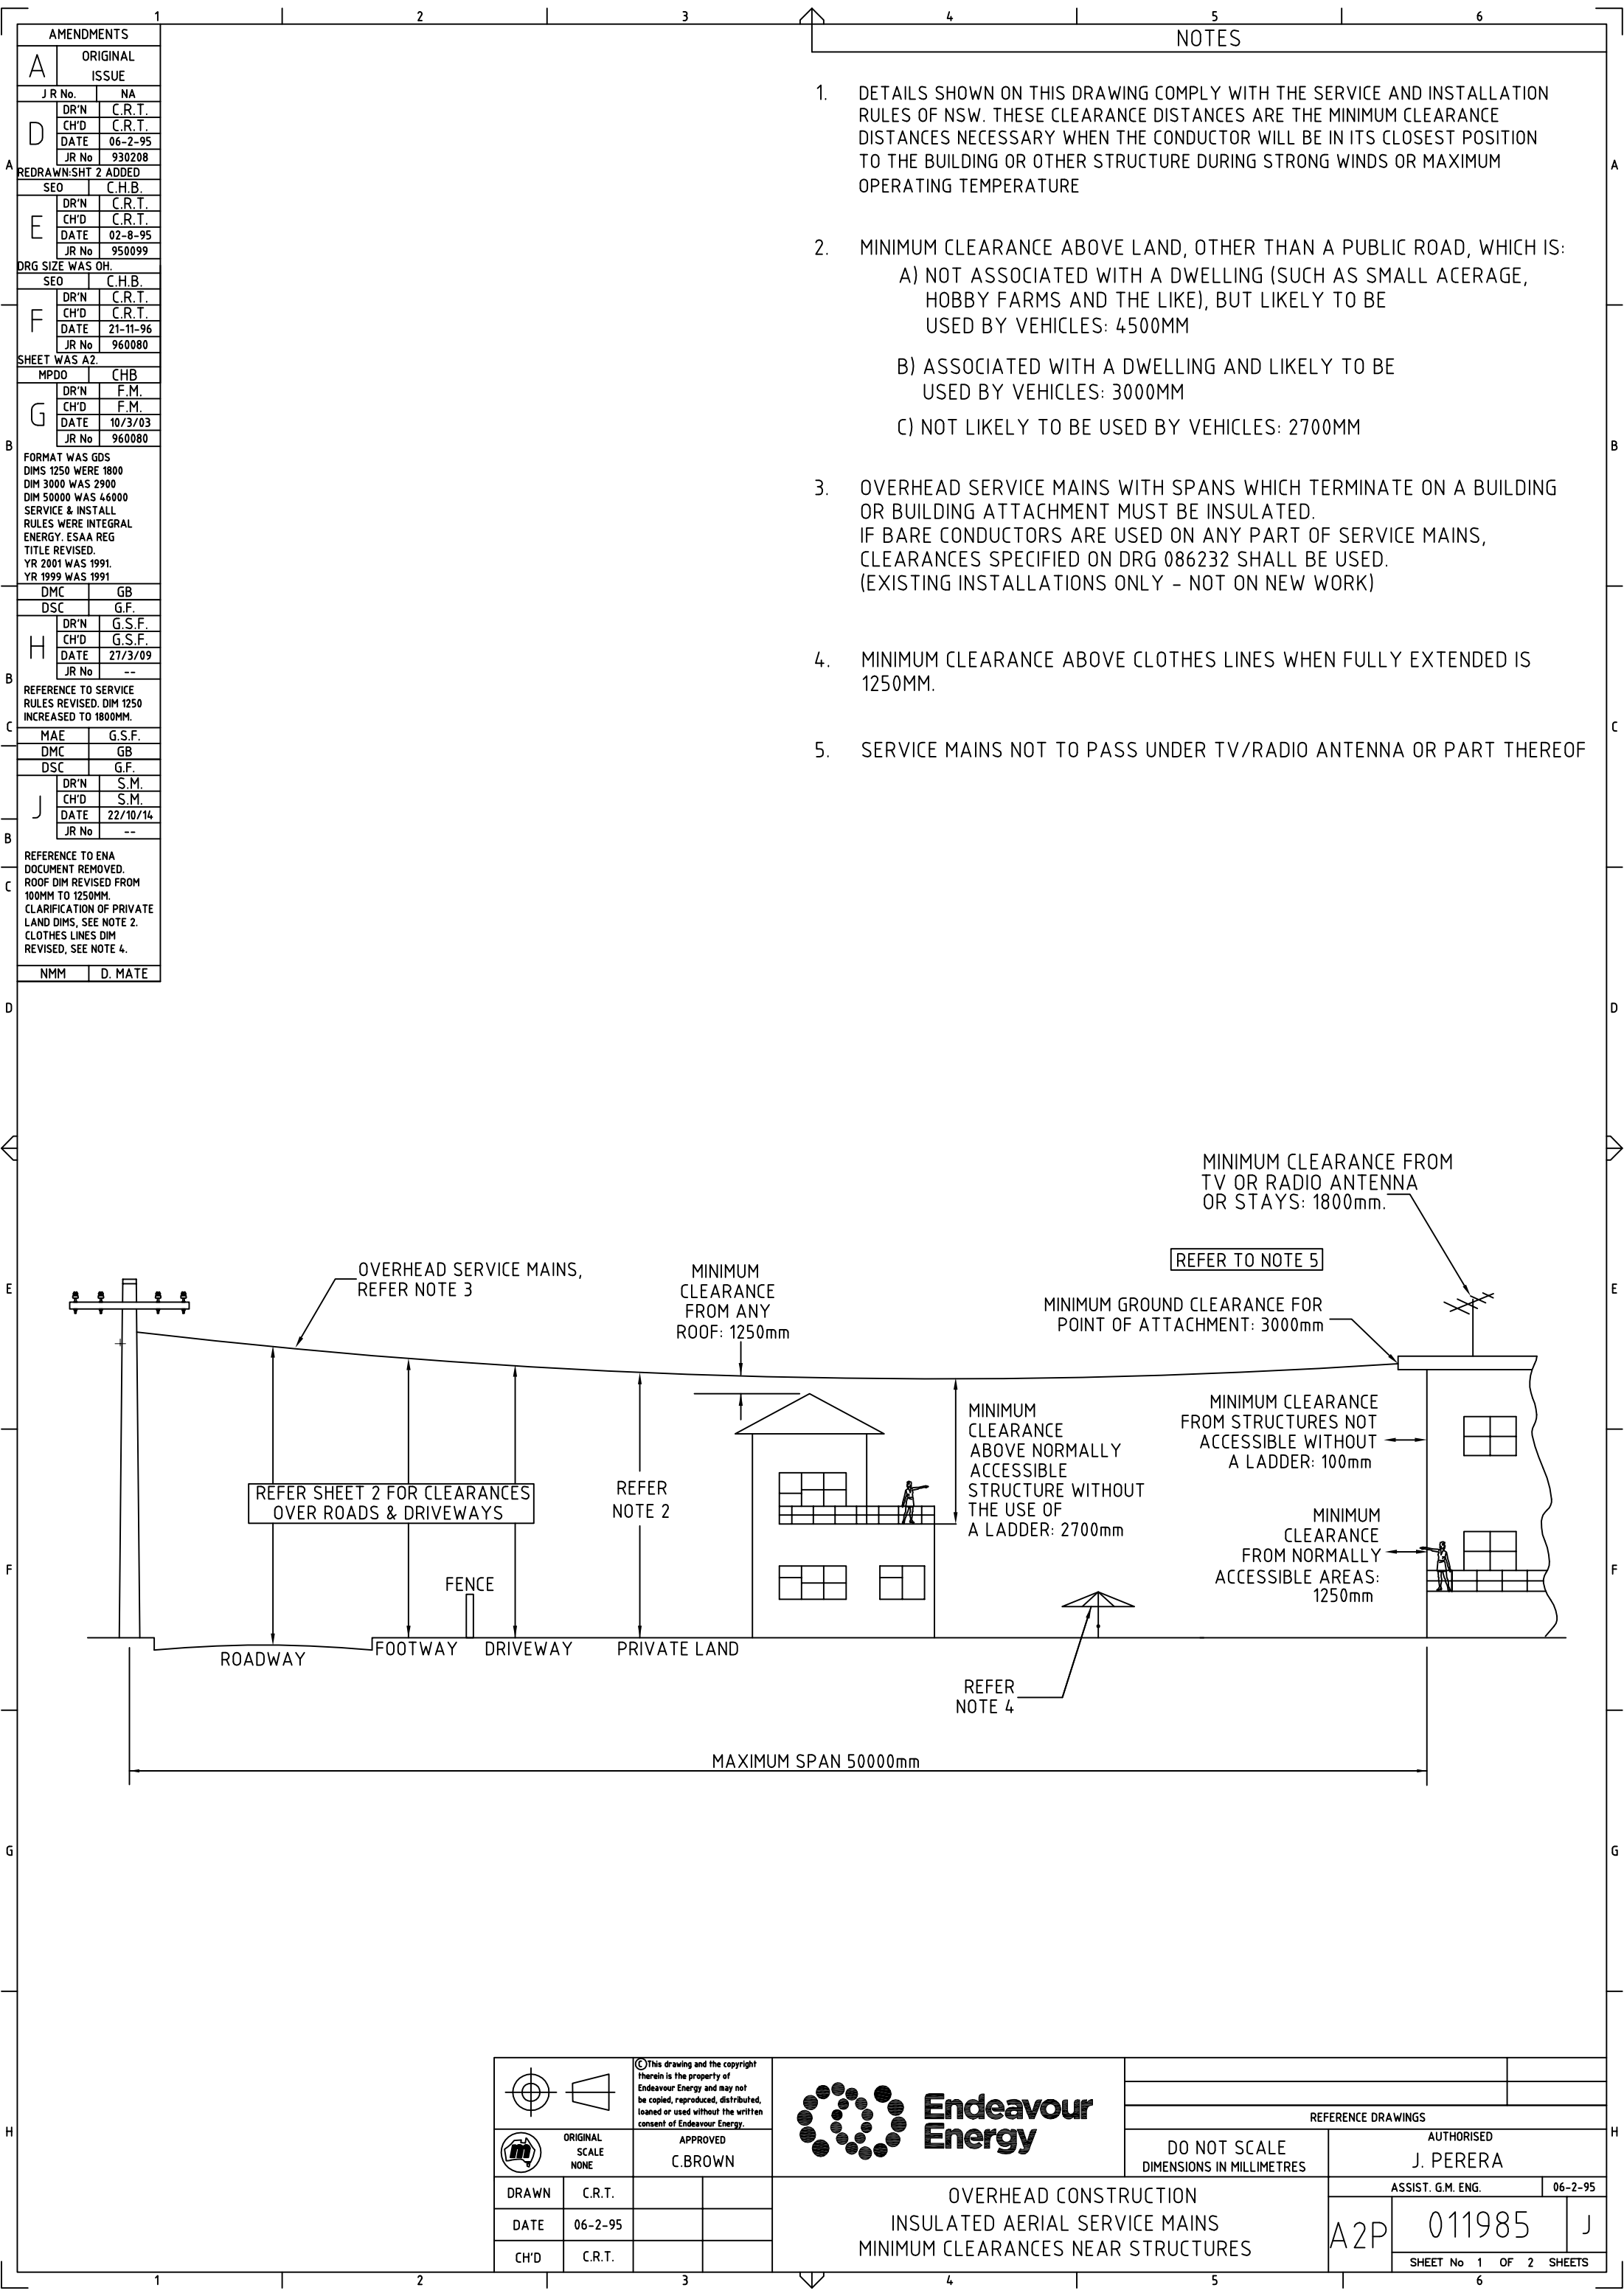

AMENDMENTS		
A	ORIGINAL ISSUE	
	J R No.	NA
D	DR'N	C.R.T.
	CH'D	C.R.T.
	DATE	06-2-95
	JR No	930208
REDRAWN-SHT 2 ADDED		
E	DR'N	C.H.B.
	CH'D	C.H.B.
	DATE	02-8-95
	JR No	950099
DRG SIZE WAS OH.		
F	DR'N	C.H.B.
	CH'D	C.H.B.
	DATE	21-11-96
	JR No	960080
SHEET WAS A2.		
G	DR'N	F.M.
	CH'D	F.M.
	DATE	10/3/03
	JR No	960080
FORMAT WAS GDS DIMS 1250 WERE 1800 DIM 3000 WAS 2900 DIM 50000 WAS 46000 SERVICE & INSTALL RULES WERE INTEGRAL ENERGY. ESAA REG TITLE REVISED. YR 2001 WAS 1991. YR 1999 WAS 1991		
H	DMC	GB
	DSC	G.F.
	DR'N	G.S.F.
	CH'D	G.S.F.
J	DATE	27/3/09
	JR No	--
REFERENCE TO SERVICE RULES REVISED. DIM 1250 INCREASED TO 1800MM.		
J	MAE	G.S.F.
	DMC	GB
	DSC	G.F.
	DR'N	S.M.
J	CH'D	S.M.
	DATE	22/10/14
	JR No	--
REFERENCE TO ENA DOCUMENT REMOVED. ROOF DIM REVISED FROM 100MM TO 1250MM. CLARIFICATION OF PRIVATE LAND DIMS, SEE NOTE 2. CLOTHES LINES DIM REVISED, SEE NOTE 4.		
NMM D. MATE		

1. DETAILS SHOWN ON THIS DRAWING COMPLY WITH THE SERVICE AND INSTALLATION RULES OF NSW. THESE CLEARANCE DISTANCES ARE THE MINIMUM CLEARANCE DISTANCES NECESSARY WHEN THE CONDUCTOR WILL BE IN ITS CLOSEST POSITION TO THE BUILDING OR OTHER STRUCTURE DURING STRONG WINDS OR MAXIMUM OPERATING TEMPERATURE
2. MINIMUM CLEARANCE ABOVE LAND, OTHER THAN A PUBLIC ROAD, WHICH IS:

A) NOT ASSOCIATED WITH A DWELLING (SUCH AS SMALL ACERAGE, HOBBY FARMS AND THE LIKE), BUT LIKELY TO BE USED BY VEHICLES: 4500MM

B) ASSOCIATED WITH A DWELLING AND LIKELY TO BE USED BY VEHICLES: 3000MM

C) NOT LIKELY TO BE USED BY VEHICLES: 2700MM
3. OVERHEAD SERVICE MAINS WITH SPANS WHICH TERMINATE ON A BUILDING OR BUILDING ATTACHMENT MUST BE INSULATED. IF BARE CONDUCTORS ARE USED ON ANY PART OF SERVICE MAINS, CLEARANCES SPECIFIED ON DRG 086232 SHALL BE USED. (EXISTING INSTALLATIONS ONLY - NOT ON NEW WORK)
4. MINIMUM CLEARANCE ABOVE CLOTHES LINES WHEN FULLY EXTENDED IS 1250MM.
5. SERVICE MAINS NOT TO PASS UNDER TV/RADIO ANTENNA OR PART THEREOF

©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

ORIGINAL SCALE NONE

APPROVED C.BROWN

DRAWN C.R.T.

DATE 06-2-95

CH'D C.R.T.

DO NOT SCALE DIMENSIONS IN MILLIMETRES

AUTHORISED J. PERERA

ASSIST. G.M. ENG. 06-2-95

OVERHEAD CONSTRUCTION
INSULATED AERIAL SERVICE MAINS
MINIMUM CLEARANCES NEAR STRUCTURES

A2P 011985 J

SHEET No 1 OF 2 SHEETS