
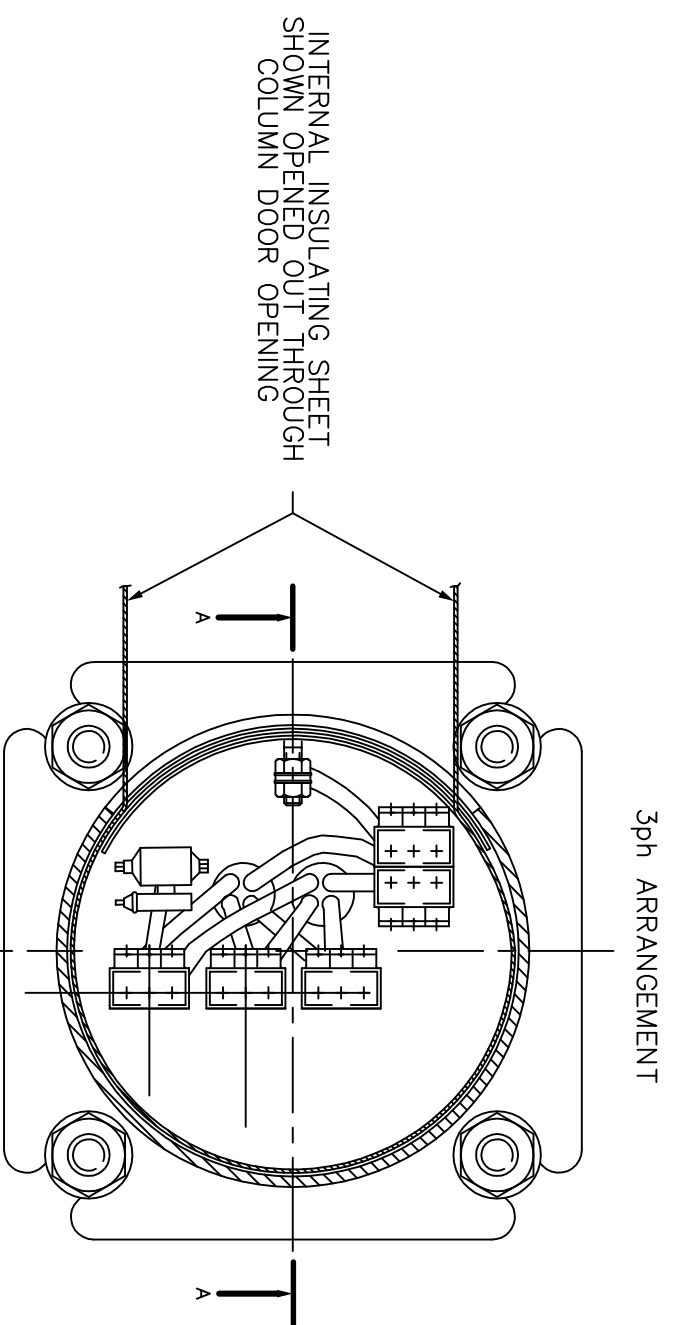
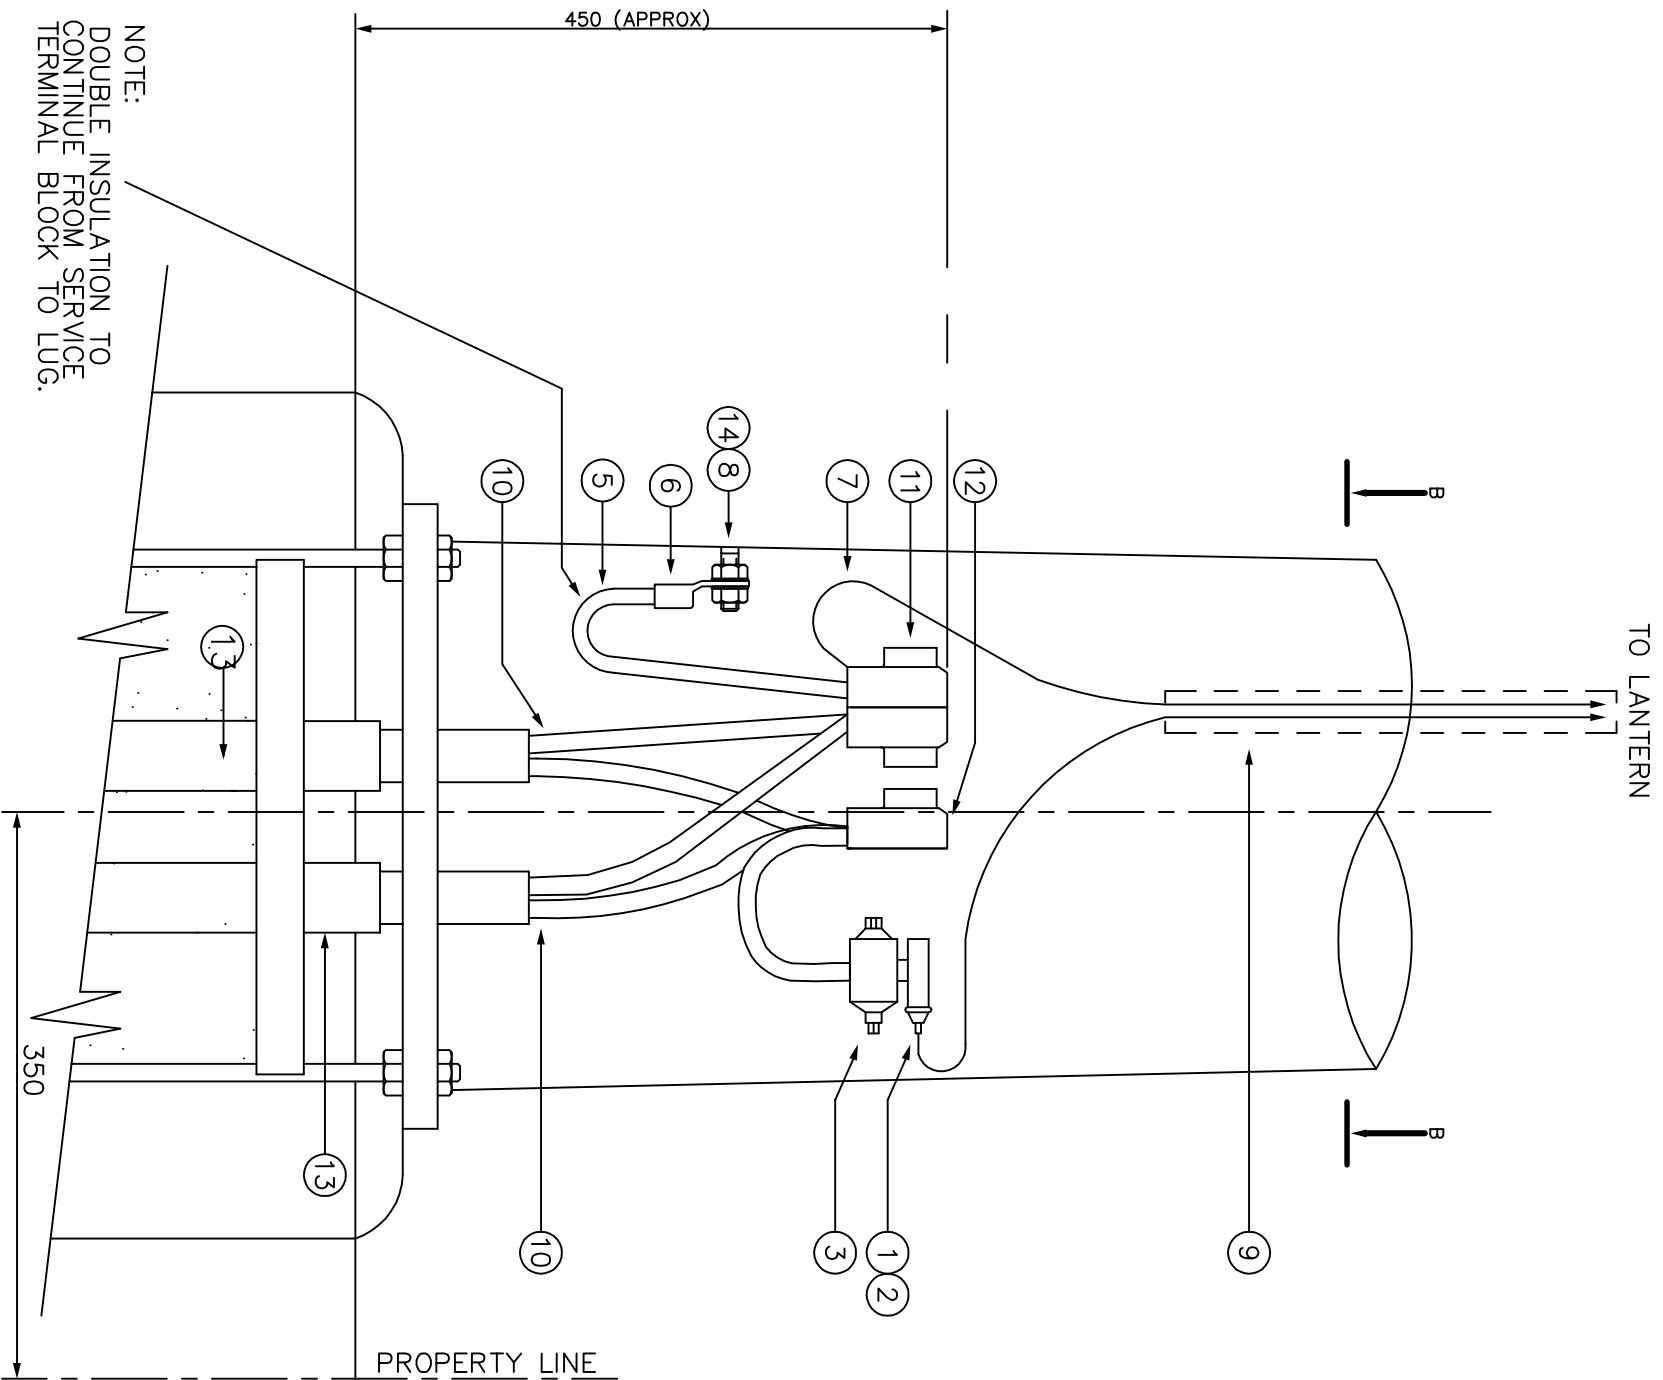






QTY	ITEM	DESCRIPTION	STOCK REF.
–	15	–	
2	14	M10 SS WASHER	SW10167
1	13	50mm UPVC H.D	1005900
3	12	SERVICE CABLE TERMINAL BLOCK	SB10339
1	11	SERVICE CABLE TERMINAL BLOCK – NEUTRAL	SB10509
1	10	MIN 16mmsq S.D.I CONDUCTOR	SZ12643
1	9	2x1.5mmsqr SINGLE CORE COPPER CONDUCTOR	001551076
2	8	S/STEEL LOCKING NUT – M10 – EARTH STUD	SN12319
1	7	LANTERN NEUTRAL CONNECTION	
1	6	70mmsq Cu CABLE LUG – M10	SL12727
1	5	70mmsq S.D.I EARTH CONDUCTOR	SZ10780
–	4	–	–
1	3	I.P.C – 6/54MM TO 6/35MM	1066286
1	2	FUSE CARTRIDGE – 10 AMP	1145424
1	1	FUSE CARRIER	1145416

AMENDMENTS					
A	ORIGINAL ISSUE				
	J R No.	DA			
B	DR'N	G5F			
	CH'D	G5F			
	DATE	24-8-05			
	JR No	--			
EARTH CABLE NOW 70mm. LANTERN CABLE CHANGED.					
M.A.E.	G5F				
			© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.		
					
 ORIGINAL SCALE NTS		APPROVED			
DRAWN	DFL				
DATE	25.6.03				
CH'D	DPM				
 Endeavour Energy					
PUBLIC LIGHTING PE CELL CONTROLLED 1ph & 3ph STREET LIGHT ONLY CONNECTION ARRANGEMENT			SL TERMINATION ARRANGEMENT		
			DO NOT SCALE DIMENSIONS IN MILLIMETRES		
			REFERENCE DRAWINGS		
			AUTHORISED		
MANAGER ASSET ENGINEERING					
A3		280146		B	
SHEET No 1 OF 1 SHEETS					