
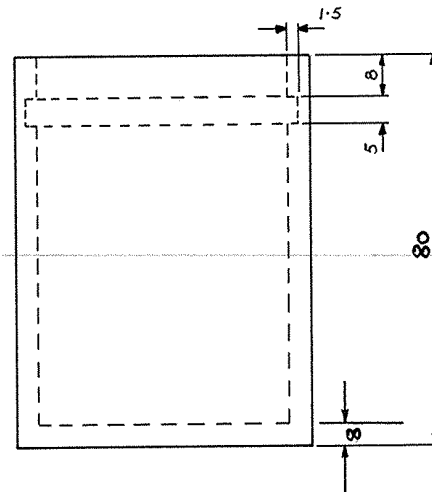


NOTES

1. ALTERNATIVE MATERIAL MUST BE HV WITHSTAND TESTED TO 22.5KV FOR 1 MIN
2. STEM CAP IS TO BE MACHINED FROM ONE COMPLETE PIECE.

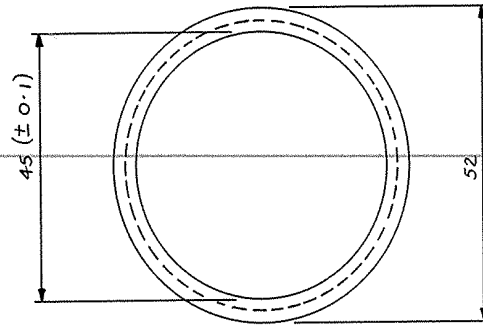

MATERIAL : CAST MONOMER NYLON GRADE C100
BLACK OR OTHER SUITABLE MATERIAL (REFER NOTE 1)

VOCAB No. SC10015



AMENDMENTS	ORIGINAL ISSUE	J.R. No.	D.R.N. MSL	CH'D JK	DATE 11/11/94	J.R. No.	D.R.N. JK	CH'D JK	DATE 2-8-95	J.R.	22.5kv was 28 kv	80 was 75.	MN55: JK
A													
B													
C													

NOTE 1 AMENDED DIMENSION ADDED

	ORIGINAL SCALE	APPROVED	C. Horvat
DRAWN	D.L.		
CH'D	JK		
SUP D'MAN	Ref		

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

REFERENCE DRAWINGS

HAZEMEYER HOLEC MD4 12KV SWITCHGEAR
CABLE CONNECTION STEM CAP
CONSTRUCTION DETAIL

D.B. Britten /ct	ASSIST. G.M. ENG.	DATE
A3	073667	A
SHEET No	OF SHEETS	
INDEX REF	SO08 A	