
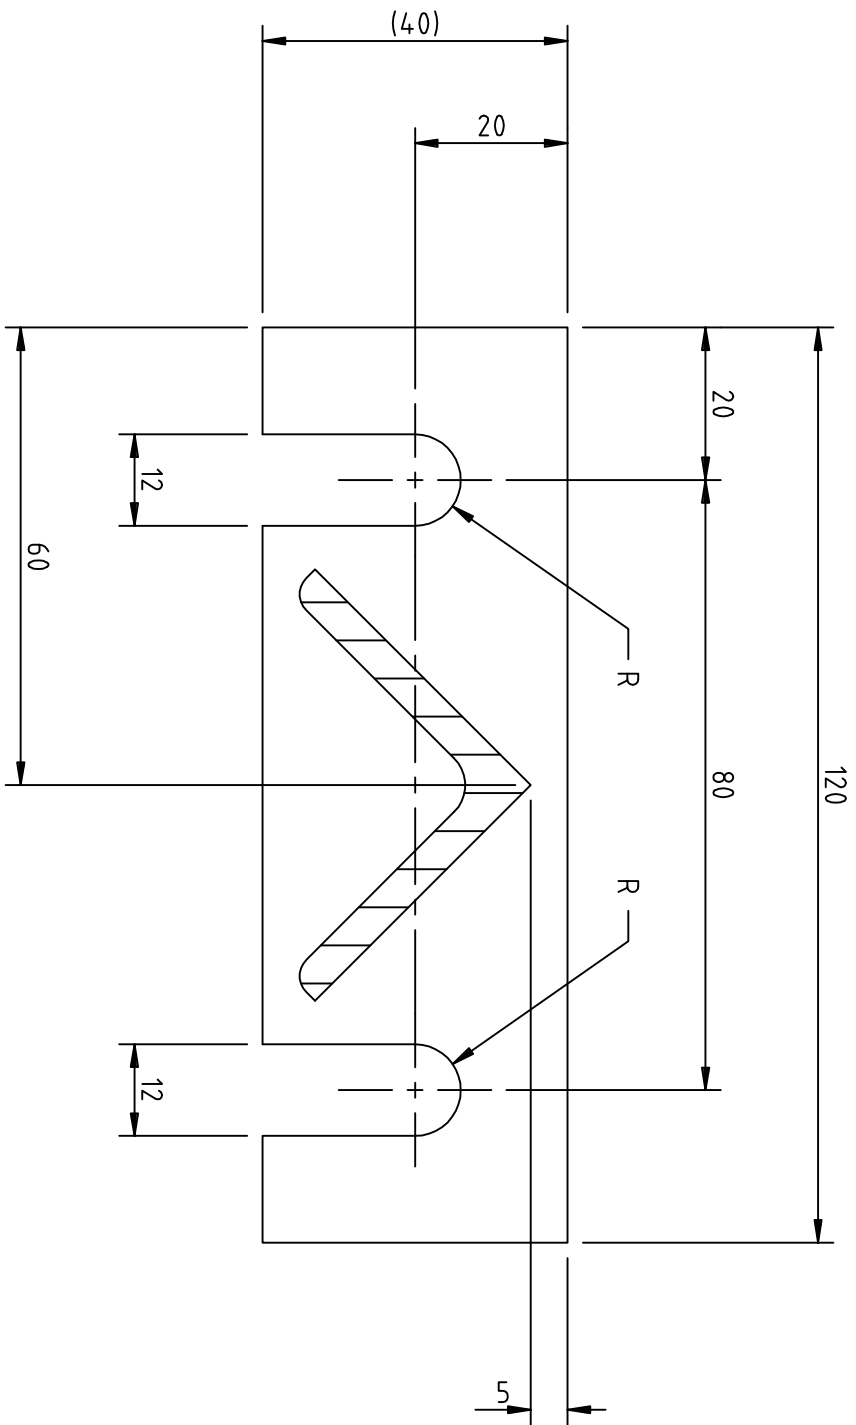



NOTES

1. ALL WELDED CONSTRUCTION TO BE USED THROUGHOUT IN ACCORDANCE WITH AS 1554.1.
2. A GENERAL TOLERANCE OF 1mm APPLIES TO ALL DIMENSIONS.
3. TO BE HOT DIP GALVANISED AFTER FABRICATION IN ACCORDANCE WITH AS 1650.
4. QUANTITY: 2 OFF REQ'D.
SUPPLY WITH PLUGBOARD FRAME DRG No. 077512 AS VOCAB No. SF12666.

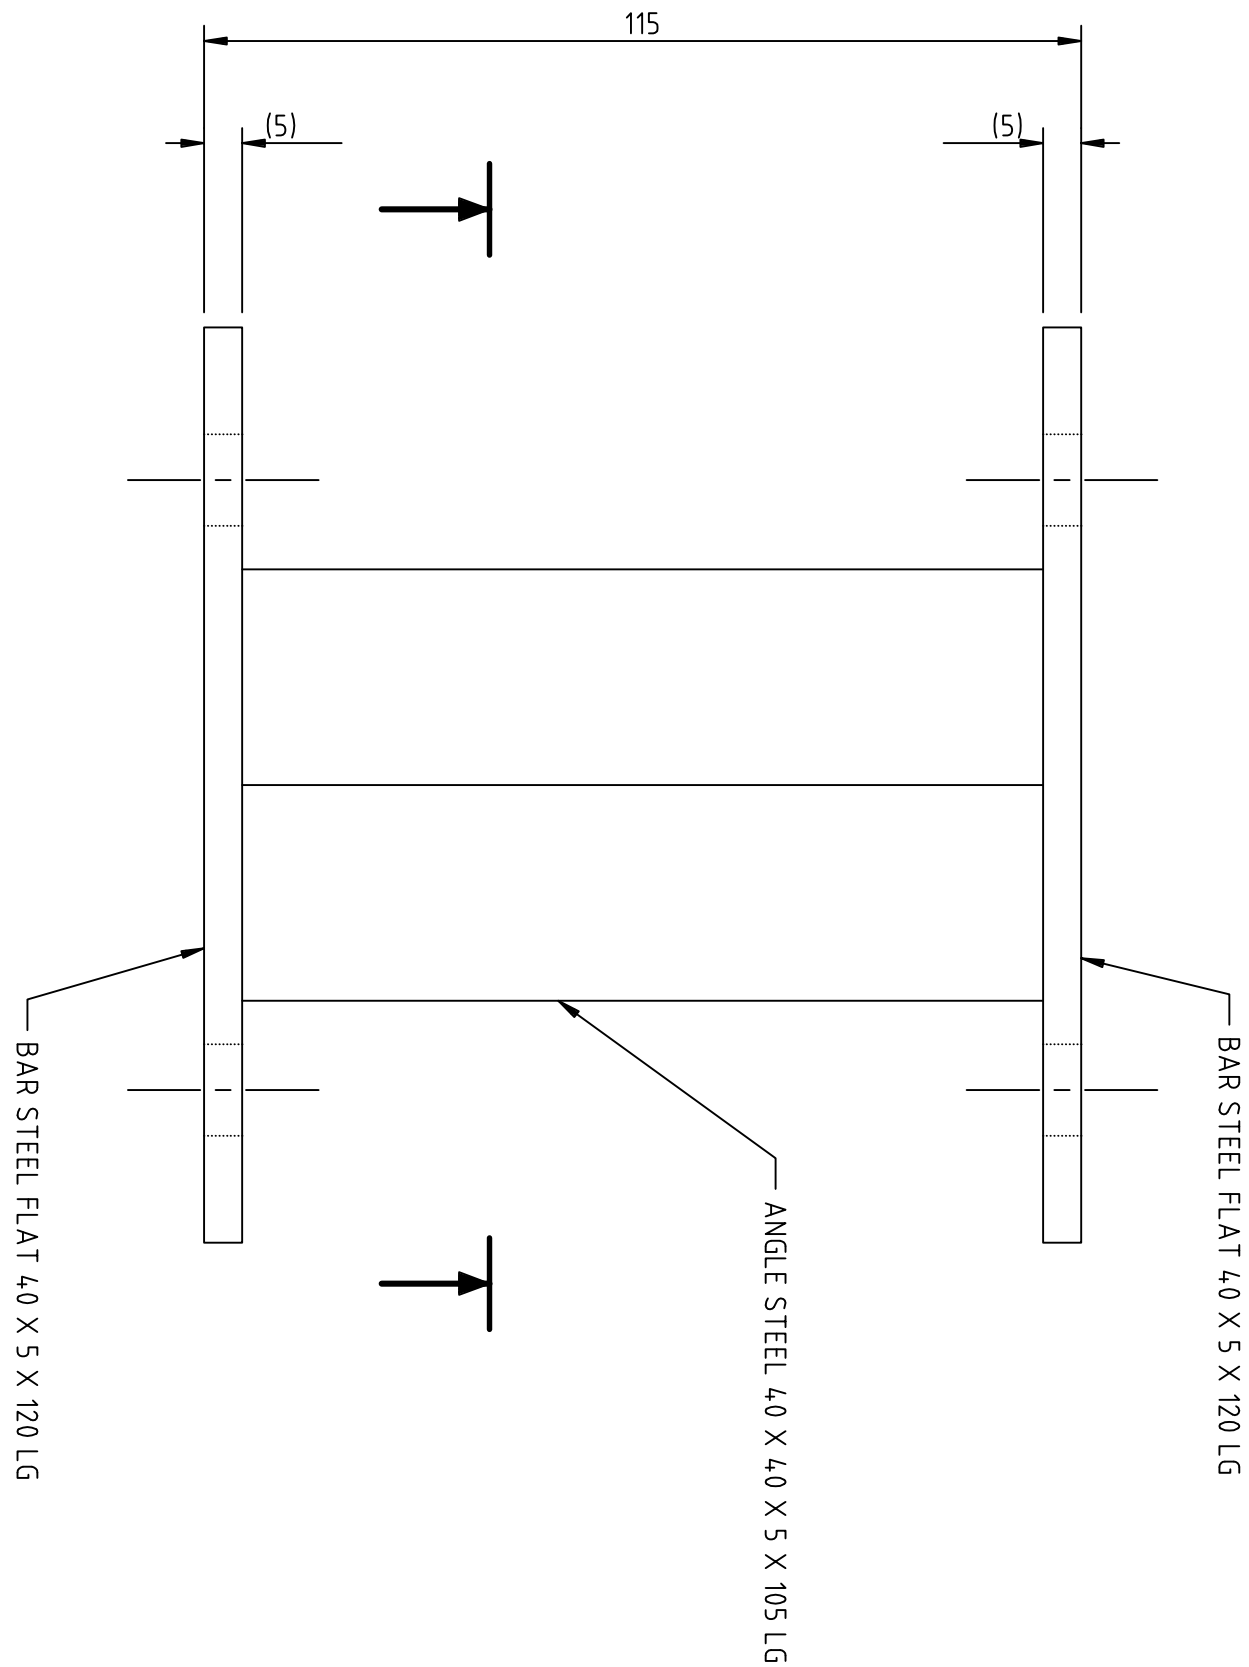

VOCAB No. SF12666
(REFER NOTE 4.)

AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	930099

		©This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.	
ORIGINAL SCALE 1:1	APPROVED CHowat		



22kV PLUGBOARD FRAME		077512	
DO NOT SCALE		REFERENCE DRAWINGS	
DIMENSIONS IN MILLIMETRES		AUTHORISED J.N.Allen/CH	

DRAWN	T.A.B.
DATE	12-12-94
CHD	D.J.Z

22kV PLUGBOARD FRAME
BRACE DETAIL

G.M. NETWORK		17-01-95	
--------------	--	----------	--

A2		077535	
SHEET No 1 OF 1 SHEETS		A	