


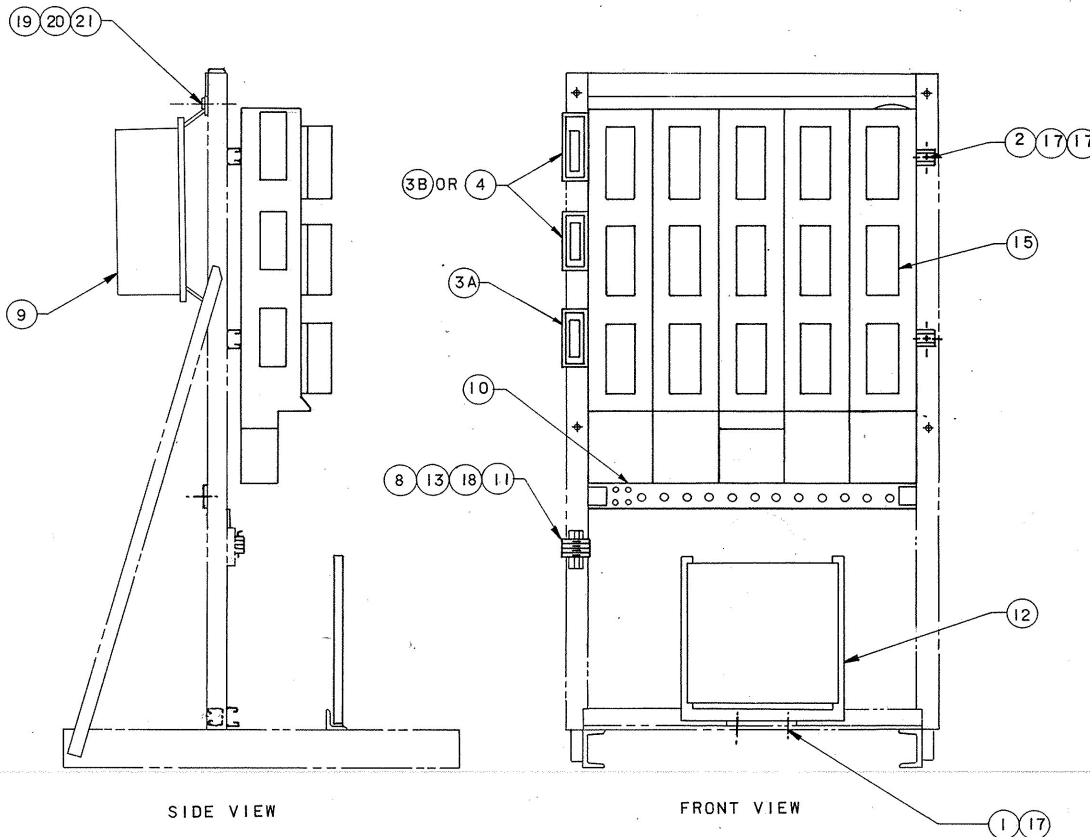

NOTES

- STREET LIGHT CONTROL PANEL TO BE WIRED & FITTED BY P.C.C. ON SITE (IF REQUIRED).
- M.D.I.'s TO BE FITTED BY P.C.C. ON SITE.
- REFER T.S.I. 155 FOR APPLICATION OF CATEGORY 1 OR 2 DISTRIBUTION PANELS.
REFER SHEET 2 FOR CATEGORY 2 GEC GENERAL ARRANGEMENT.

ITEM	QTY	DESCRIPTION	QTY
22		CABLE TIE 'PANDUIT'	
21	2	WASHER STAINLESS STEEL ROUND FLAT 6	
20	2	NUT STAINLESS STEEL HEX M6	
19	2	SCREW STAINLESS STEEL CSK HD M6 x 25 LG	
18	2	WASHER BRASS ROUND FLAT 5	
17	8	WASHER STEEL ROUND FLAT GALV 10	
15	1	SWITCHGEAR 'COMPACT' 4 FDR BOARD	
13	2	SETSCREW BRASS RD HD M5 x 20 LG	
12	1	PANEL 'STREET LIGHT CONTROL' (AS REQD)	
11	2	NUT BRASS HEX M5	
10	1	NEUTRAL/EARTH BAR	
9	1	M.D.I. 'WARBURTON FRANKI' TYPE WF73 3Ø	
8	4	LINKS 'KLIPPON' TYPE SAKC 10 C/W 2 PLUG BOLTS	
	1	LINKS END SECTION CAT. No. 1467/2	
	2	LINKS END BRACKET CAT. No. 2061/6	
4		FUSE SINGLE AUX 'COMPACT' 60A TYPE ABPF	WHEN REQD.
3B		FUSE SINGLE AUX 'COMPACT' 30A TYPE AFM	WHEN REQD.
3A	1	FUSE SINGLE AUX 'COMPACT' 30A TYPE AFM	
2	5	BOLT STEEL HEX HD GALV M10 x 25 LG	
1	2	BOLT STEEL HEX HD GALV M10 x 40 LG	
ITEM	VOCAB No.	DESCRIPTION	QTY

DIMENSIONS IN MILLIMETRES
UNLESS OTHERWISE SHOWN



SHEET 1 OF 3 SHEETS

AMENDMENTS ORIGINAL PRINT ISSUE A B C D E		ST. LT. CONTROL PNL 1Ø P.M. SUB MOUNTED FABN. DET. - B44200 STD. CONSTN. RM. SUB. MV CAT. 1&2 PANELS FRAME FABN - C16659 REFERENCE DRAWINGS		ENDEAVOUR ENERGY STANDARD CONSTRUCTION PAD MOUNT SUB MEDIUM VOLTAGE PANELS FRAME CATEGORY 1-"COMPACT" GENERAL ARRANGEMENT		SCALE NONE APPROVED DRAWN CH'KD SUP D'MAN		A. C. Moore CHIEF ELEC ENG DATE 7-5-79 C 16619 A SHEET No 1 OF 3 SHEETS	
--	--	---	--	---	--	---	--	---	--