


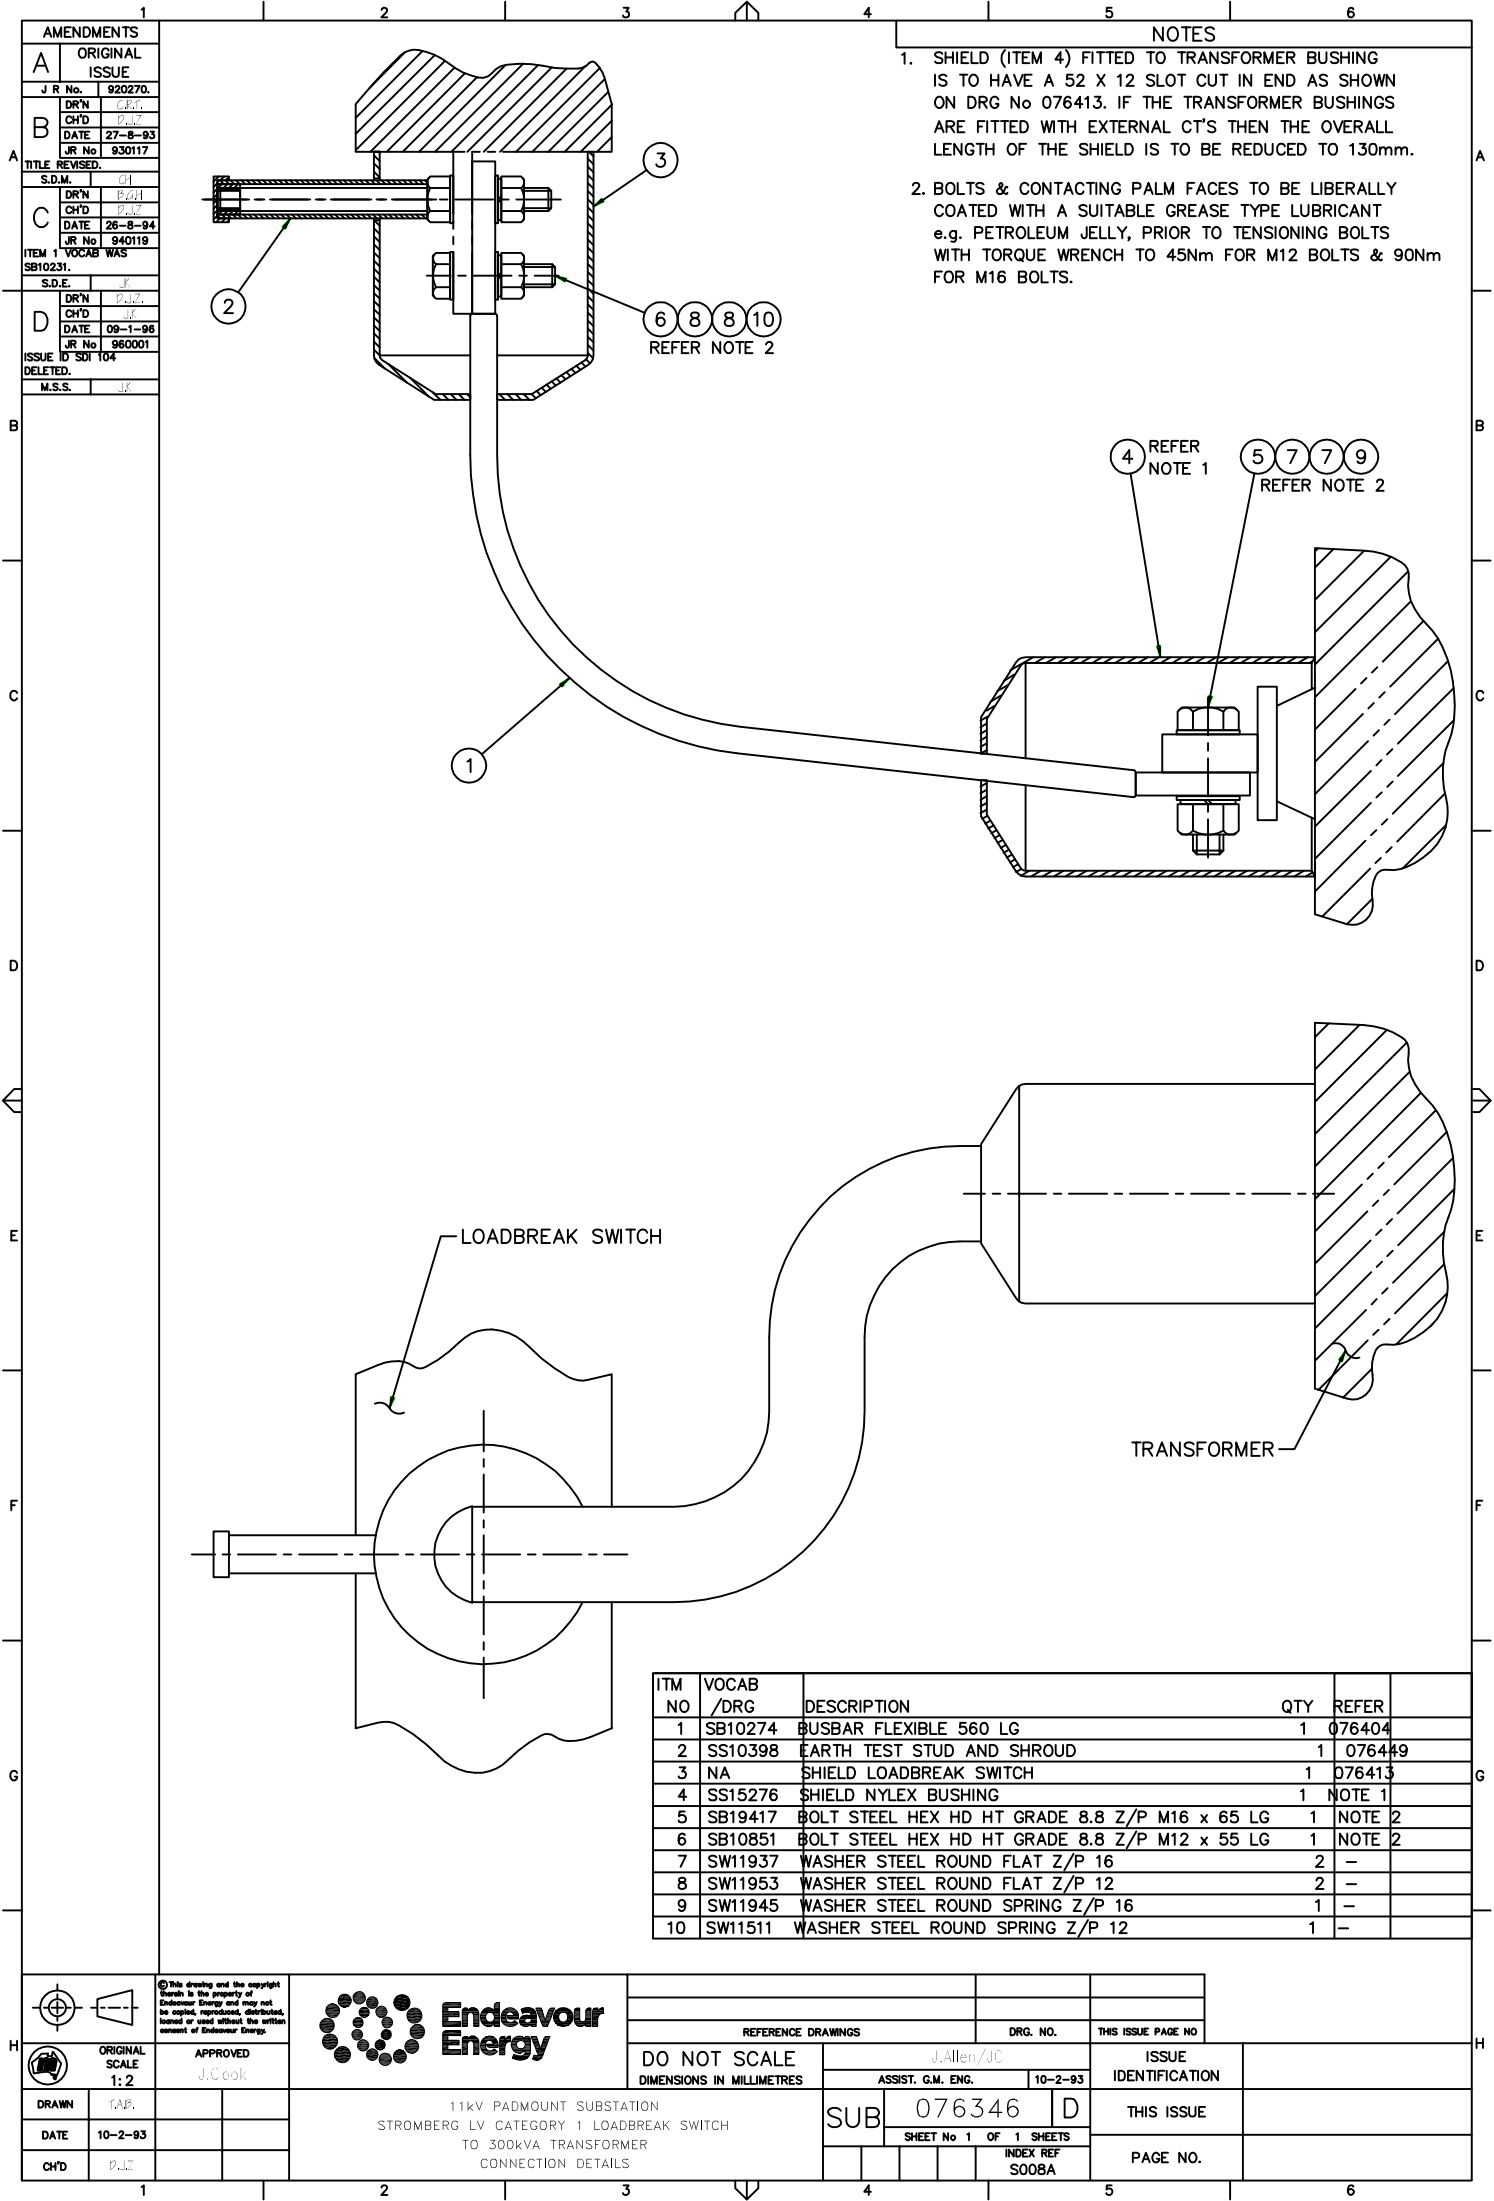

AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	920270.
DRN	P.J.L.
CHD	P.J.L.
DATE	27-8-93
JR No	930117
TITLE REVISED.	
S.D.M.	G.I.
DRN	P.J.L.
CHD	P.J.L.
DATE	26-8-94
JR No	940119
ITEM 1 VOCAB WAS SB10231.	
S.D.E.	P.
DRN	P.J.L.
CHD	P.J.L.
DATE	09-1-96
JR No	960001
ISSUE 10 SDI 104 DELETED.	
M.S.S.	J.L.

- NOTES
1. SHIELD (ITEM 4) FITTED TO TRANSFORMER BUSHING IS TO HAVE A 52 X 12 SLOT CUT IN END AS SHOWN ON DRG No 076413. IF THE TRANSFORMER BUSHINGS ARE FITTED WITH EXTERNAL CT'S THEN THE OVERALL LENGTH OF THE SHIELD IS TO BE REDUCED TO 130mm.
 2. BOLTS & CONTACTING PALM FACES TO BE LIBERALLY COATED WITH A SUITABLE GREASE TYPE LUBRICANT e.g. PETROLEUM JELLY, PRIOR TO TENSIONING BOLTS WITH TORQUE WRENCH TO 45Nm FOR M12 BOLTS & 90Nm FOR M16 BOLTS.

ITM NO	VOCAB /DRG	DESCRIPTION	QTY	REFER
1	SB10274	BUSBAR FLEXIBLE 560 LG	1	076404
2	SS10398	EARTH TEST STUD AND SHROUD	1	076449
3	NA	SHIELD LOADBREAK SWITCH	1	076413
4	SS15276	SHIELD NYLEX BUSHING	1	NOTE 1
5	SB19417	BOLT STEEL HEX HD HT GRADE 8.8 Z/P M16 x 65 LG	1	NOTE 2
6	SB10851	BOLT STEEL HEX HD HT GRADE 8.8 Z/P M12 x 55 LG	1	NOTE 2
7	SW11937	WASHER STEEL ROUND FLAT Z/P 16	2	-
8	SW11953	WASHER STEEL ROUND FLAT Z/P 12	2	-
9	SW11945	WASHER STEEL ROUND SPRING Z/P 16	1	-
10	SW11511	WASHER STEEL ROUND SPRING Z/P 12	1	-

**Endeavour Energy**

11kV PADMOUNT SUBSTATION
STROMBERG LV CATEGORY 1 LOADBREAK SWITCH
TO 300kVA TRANSFORMER
CONNECTION DETAILS

DO NOT SCALE DIMENSIONS IN MILLIMETRES	J.Allen/J.C. ASSIST. G.M. ENG. 10-2-93	ISSUE IDENTIFICATION THIS ISSUE PAGE NO.
---	---	--

ORIGINAL SCALE 1:2	APPROVED J.Cook
DRAWN T.A.P.	
DATE 10-2-93	
CHD P.J.L.	