


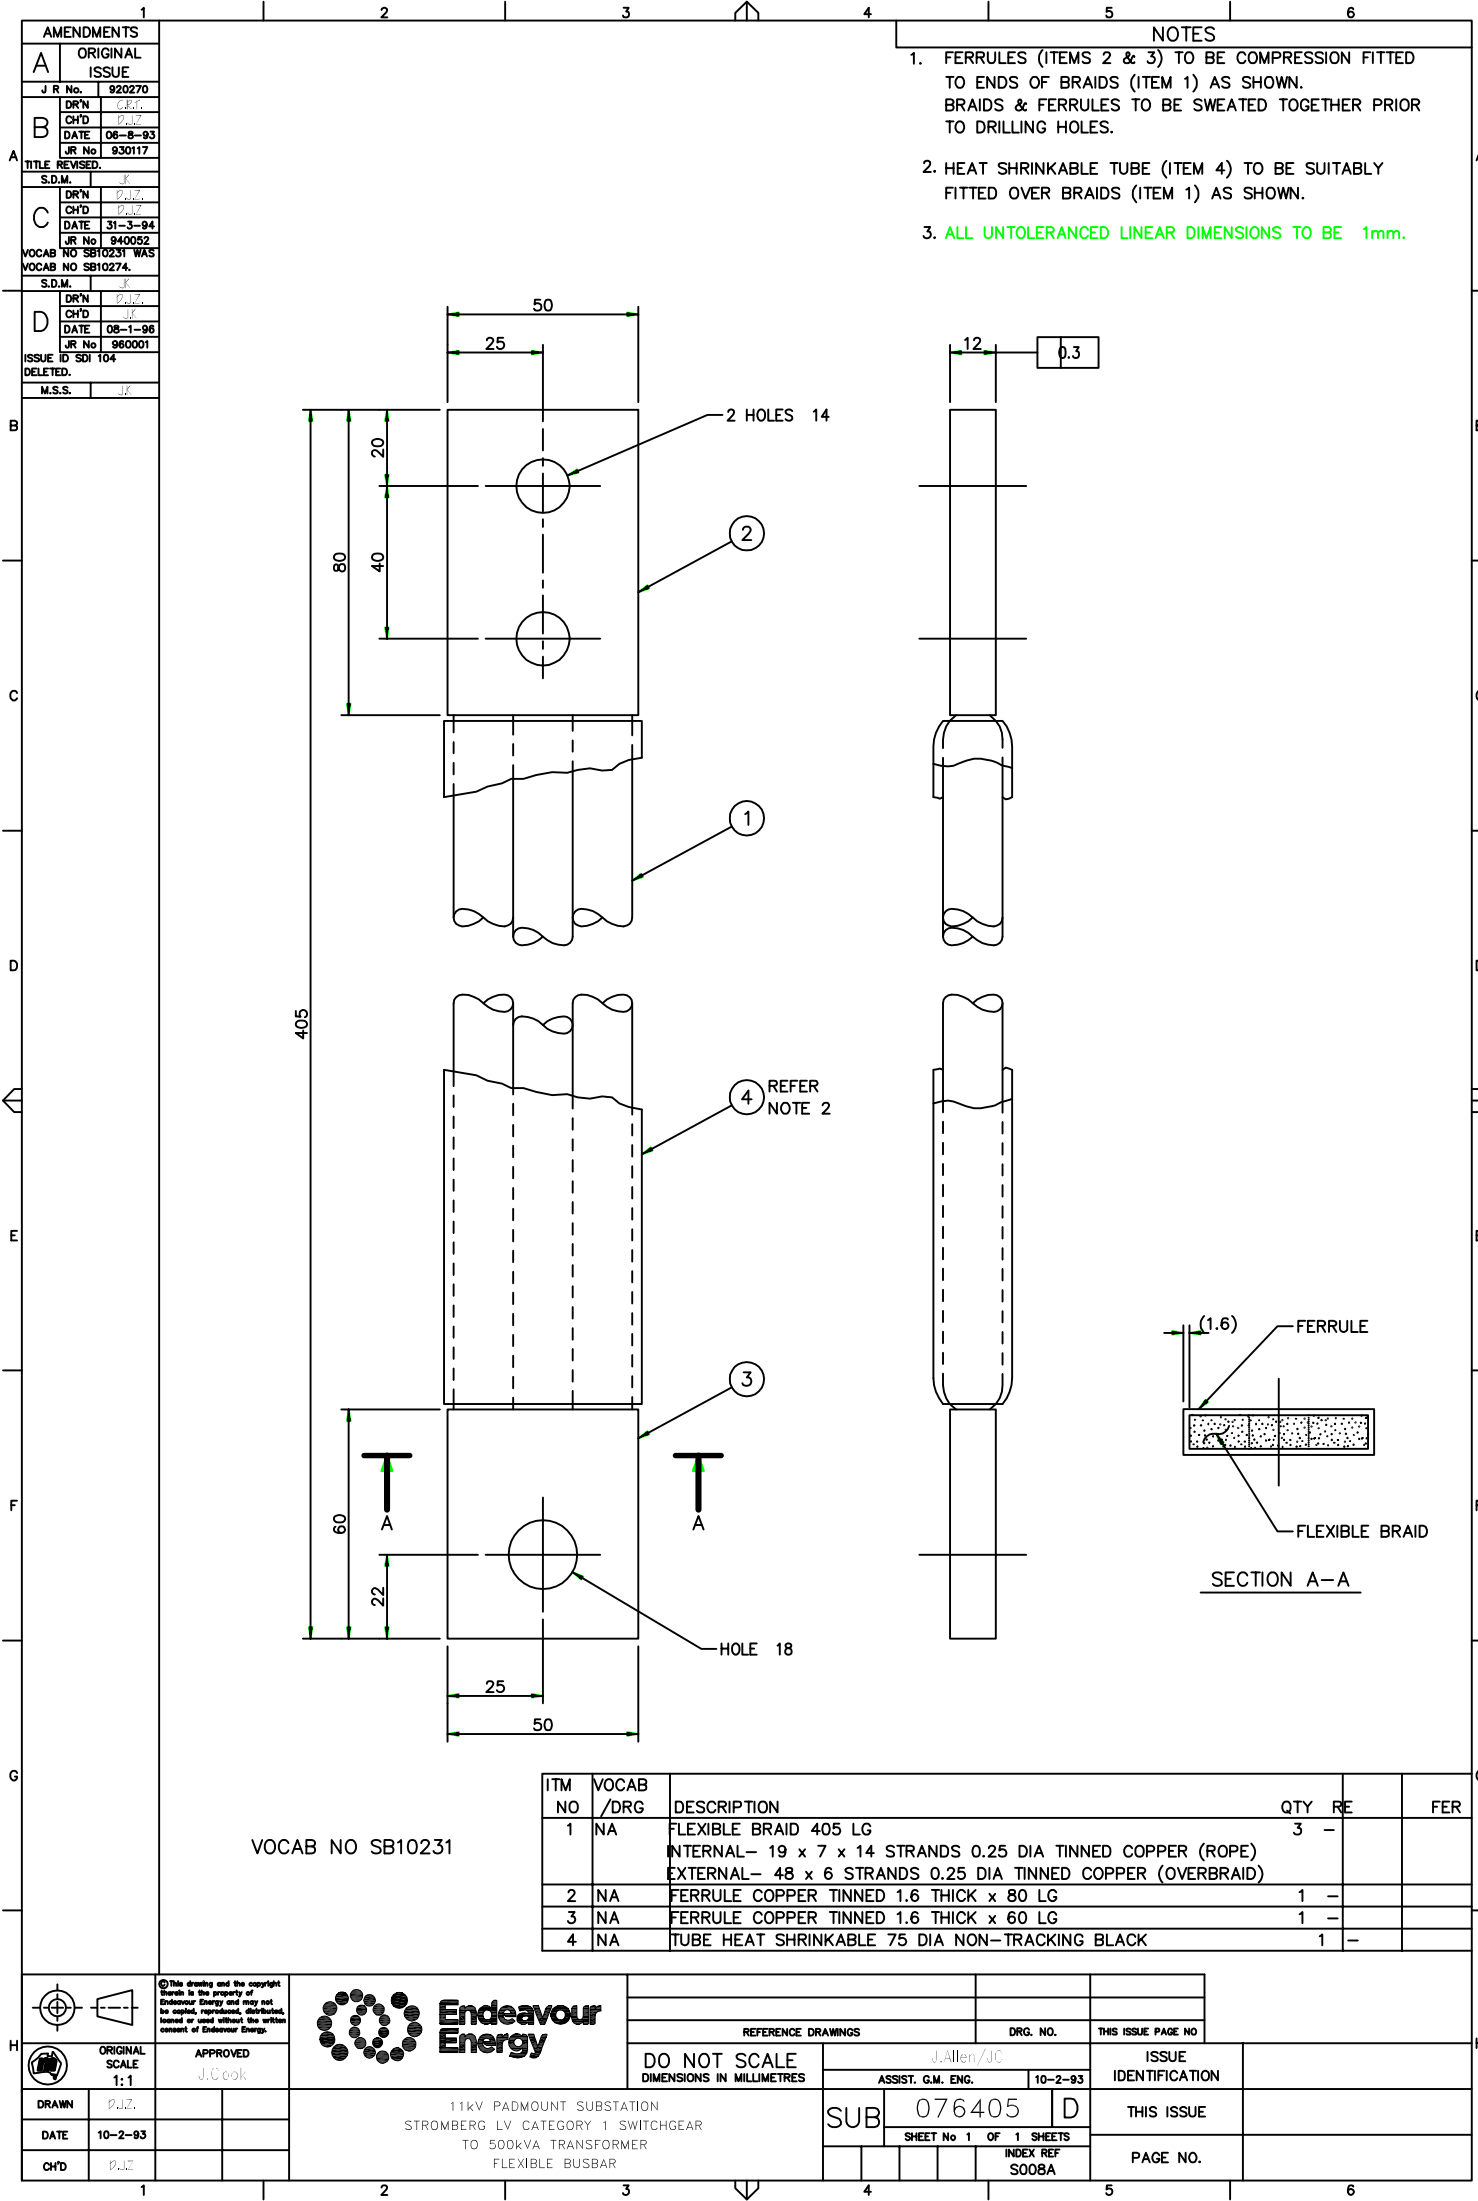

AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	920270
DRN	P.J.Z.
CHD	P.J.Z.
DATE	06-8-93
JR No	930117
TITLE REVISED.	
S.D.M.	J
DRN	P.J.Z.
CHD	P.J.Z.
DATE	31-3-94
JR No	940052
VOCAB NO SB10231 WAS VOCAB NO SB10274.	
S.D.M.	J
DRN	P.J.Z.
CHD	P.J.Z.
DATE	08-1-96
JR No	960001
ISSUE ID SDI 104 DELETED.	
M.S.S.	J

- NOTES
- FERRULES (ITEMS 2 & 3) TO BE COMPRESSION FITTED TO ENDS OF BRAIDS (ITEM 1) AS SHOWN. BRAIDS & FERRULES TO BE SWEATED TOGETHER PRIOR TO DRILLING HOLES.
 - HEAT SHRINKABLE TUBE (ITEM 4) TO BE SUITABLY FITTED OVER BRAIDS (ITEM 1) AS SHOWN.
 - ALL UNTOLERANCED LINEAR DIMENSIONS TO BE 1mm.

ITM NO	VOCAB /DRG	DESCRIPTION	QTY	RE	FER
1	NA	FLEXIBLE BRAID 405 LG INTERNAL- 19 x 7 x 14 STRANDS 0.25 DIA TINNED COPPER (ROPE) EXTERNAL- 48 x 6 STRANDS 0.25 DIA TINNED COPPER (OVERBRAID)	3	-	
2	NA	FERRULE COPPER TINNED 1.6 THICK x 80 LG	1	-	
3	NA	FERRULE COPPER TINNED 1.6 THICK x 60 LG	1	-	
4	NA	TUBE HEAT SHRINKABLE 75 DIA NON-TRACKING BLACK	1	-	

**Endeavour Energy**

11kV PADMOUNT SUBSTATION
STROMBERG LV CATEGORY 1 SWITCHGEAR
TO 500kVA TRANSFORMER
FLEXIBLE BUSBAR

DO NOT SCALE DIMENSIONS IN MILLIMETRES	J.Allen/JC ASSIST. G.M. ENG. 10-2-93	ISSUE IDENTIFICATION
SUB 076405	D	THIS ISSUE
SHEET No 1 OF 1 SHEETS	INDEX REF S008A	PAGE NO.

ORIGINAL SCALE 1:1	APPROVED J.Cook
DRAWN P.J.Z.	
DATE 10-2-93	
CHD P.J.Z.	