


AMENDMENTS	
A	ORIGINAL ISSUE
J R No.	920270
DRN	P.J.L.
CHD	P.J.L.
DATE	27-8-93
JR No	930117
B	TITLE REVISED.
S.D.M.	G.I.
DRN	P.J.L.
CHD	P.J.L.
DATE	26-8-94
JR No	940119
C	ITEM 1 VOCAB WAS SB10274.
S.D.E.	P
DRN	P.J.L.
CHD	P.J.L.
DATE	09-1-96
JR No	960001
D	ISSUE 10 SDI 104 DELETED.
M.S.S.	J.L.

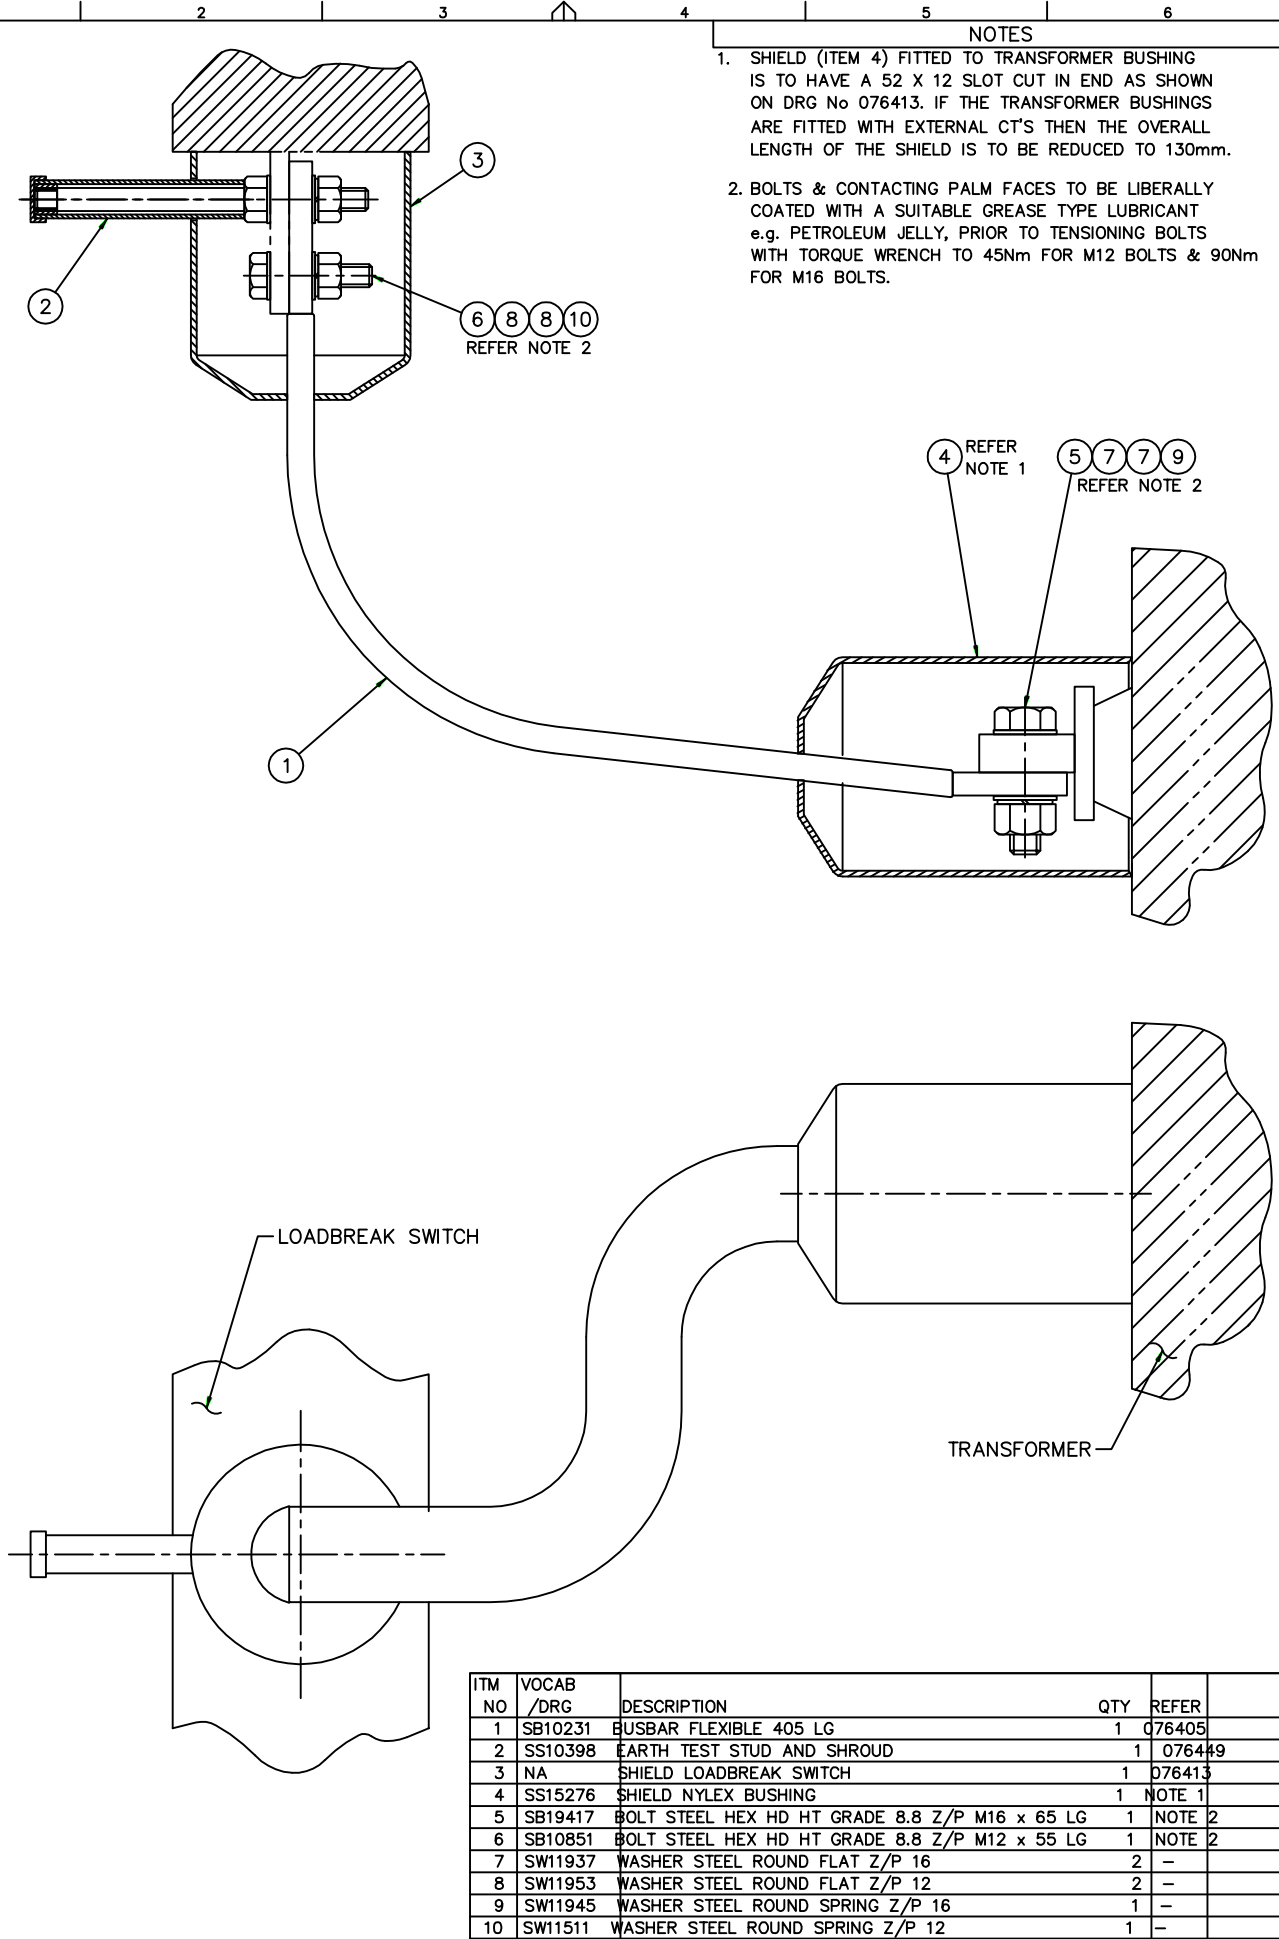

ITM NO	VOCAB /DRG	DESCRIPTION	QTY	REFER
1	SB10231	BUSBAR FLEXIBLE 405 LG	1	076405
2	SS10398	EARTH TEST STUD AND SHROUD	1	076449
3	NA	SHIELD LOADBREAK SWITCH	1	076413
4	SS15276	SHIELD NYLEX BUSHING	1	NOTE 1
5	SB19417	BOLT STEEL HEX HD HT GRADE 8.8 Z/P M16 x 65 LG	1	NOTE 2
6	SB10851	BOLT STEEL HEX HD HT GRADE 8.8 Z/P M12 x 55 LG	1	NOTE 2
7	SW11937	WASHER STEEL ROUND FLAT Z/P 16	2	-
8	SW11953	WASHER STEEL ROUND FLAT Z/P 12	2	-
9	SW11945	WASHER STEEL ROUND SPRING Z/P 16	1	-
10	SW11511	WASHER STEEL ROUND SPRING Z/P 12	1	-

	© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.		REFERENCE DRAWINGS		DRG. NO.		THIS ISSUE PAGE NO	
	ORIGINAL SCALE 1:2		DO NOT SCALE DIMENSIONS IN MILLIMETRES		J.Allen/J.C ASSIST. G.M. ENG. 10-2-93		ISSUE IDENTIFICATION	
	APPROVED J.Cook		SUB 076406 D		SHEET No 1 OF 1 SHEETS		THIS ISSUE	
	11kV PADMOUNT SUBSTATION STROMBERG LV CATEGORY 1 LOADBREAK SWITCH TO 500kVA TRANSFORMER CONNECTION DETAILS		INDEX REF S008A		PAGE NO.			