





ITM NO	VOCAB /DRG	DESCRIPTION	QTY	REFER
1	SB10118	BUSBAR FLEXIBLE 500kVA TRANSFORMER (900 LG)	1	077180
2	SB12012	BUSBAR FLEXIBLE 300kVA TRANSFORMER (840 LG)	1	077180
3	SS10398	EARTH TEST STUD AND SHROUD	1	076449
4	NA	SHIELD LOADBREAK SWITCH	1	076413
5	SS15276	SHIELD NYLEX BUSHING	1	NOTE 1
6	SB19417	BOLT STEEL HEX HD HT GRADE 8.8 Z/P M16 x 65 LG	1	NOTE 2
7	SB10851	BOLT STEEL HEX HD HT GRADE 8.8 Z/P M12 x 55 LG	1	NOTE 2
8	SW11937	WASHER STEEL ROUND FLAT Z/P 16	2	-
9	SW11953	WASHER STEEL ROUND FLAT Z/P 12	2	-
10	SW11945	WASHER STEEL ROUND SPRING Z/P 16	1	-
11	SW11511	WASHER STEEL ROUND SPRING Z/P 12	1	-

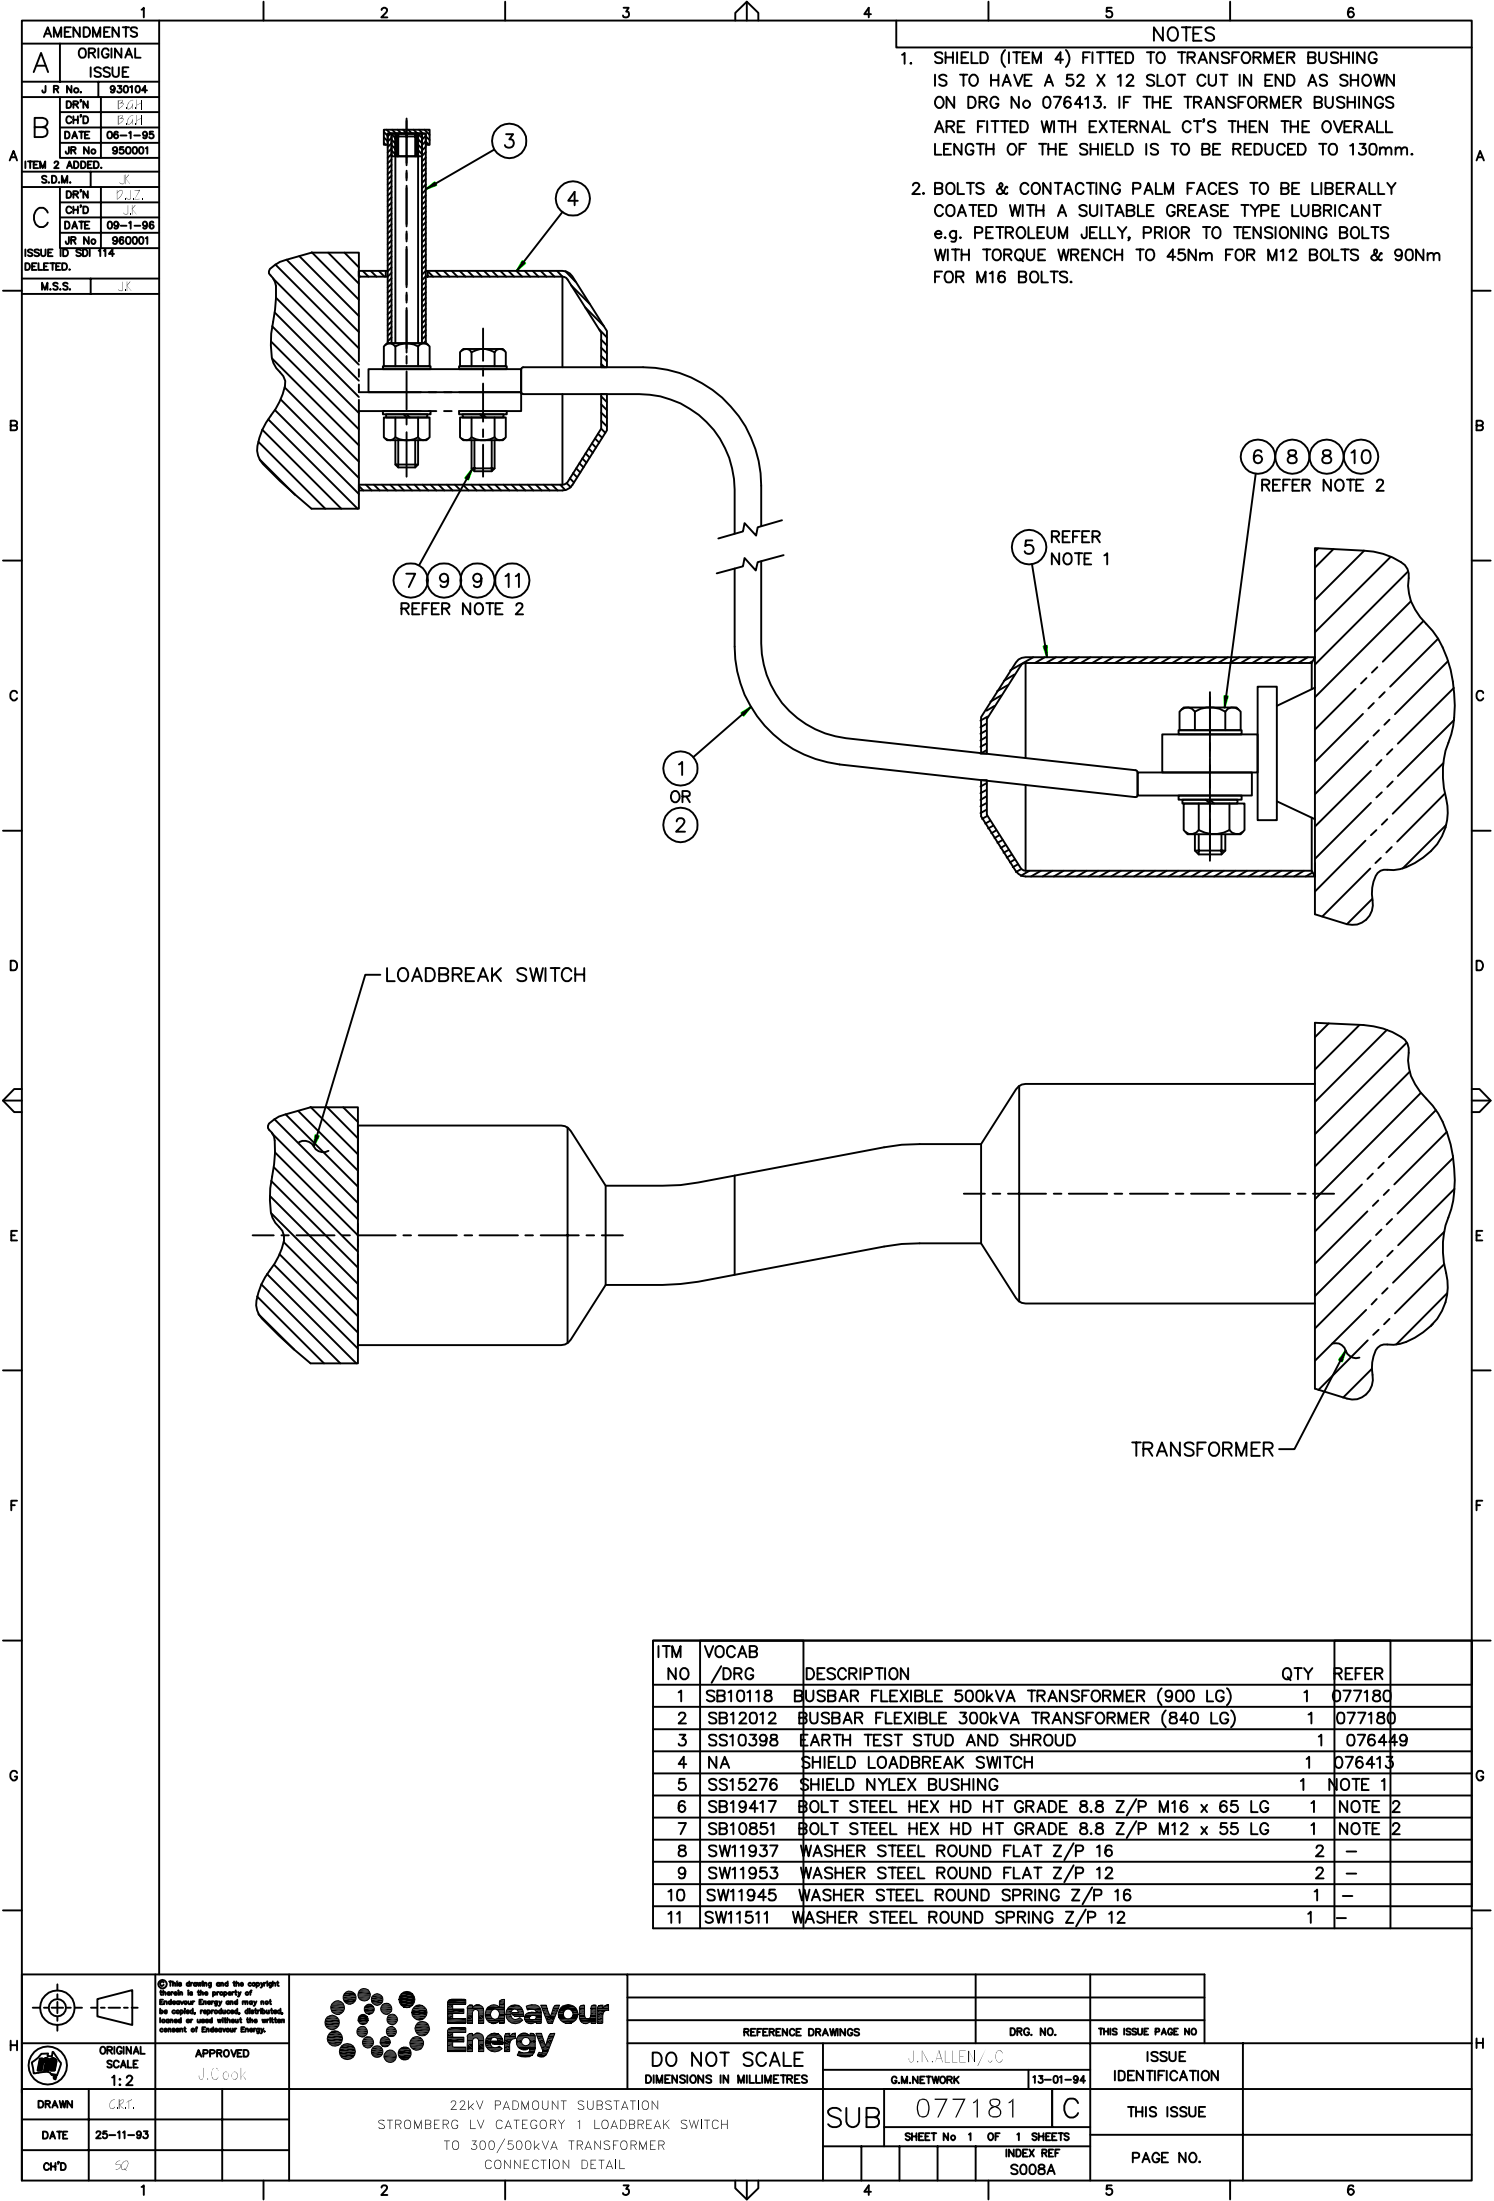

This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.



Endeavour Energy

ORIGINAL SCALE 1:2

APPROVED J. Cook

DRAWN C.R.T.

DATE 25-11-93

CH'D SQ

22kV PADMOUNT SUBSTATION
STROMBERG LV CATEGORY 1 LOADBREAK SWITCH
TO 300/500kVA TRANSFORMER
CONNECTION DETAIL

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

J.N. ALLEN/J.C
G.M. NETWORK 13-01-94

SUB 077181 C

SHEET No 1 OF 1 SHEETS
INDEX REF S008A

ISSUE IDENTIFICATION

THIS ISSUE

PAGE NO.