



20m MAST

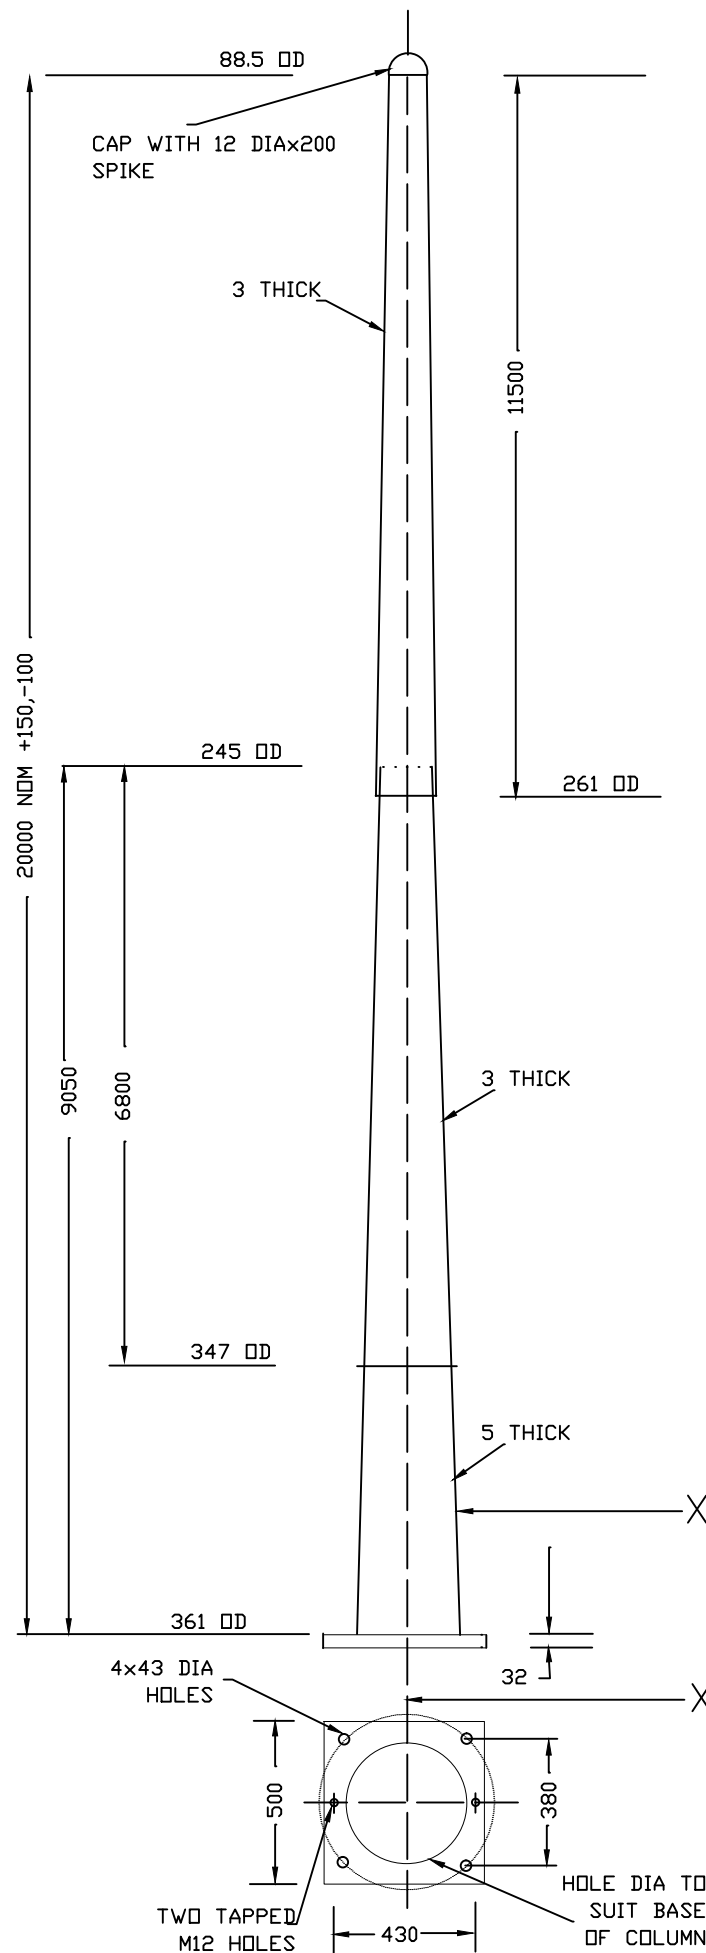


15m MAST

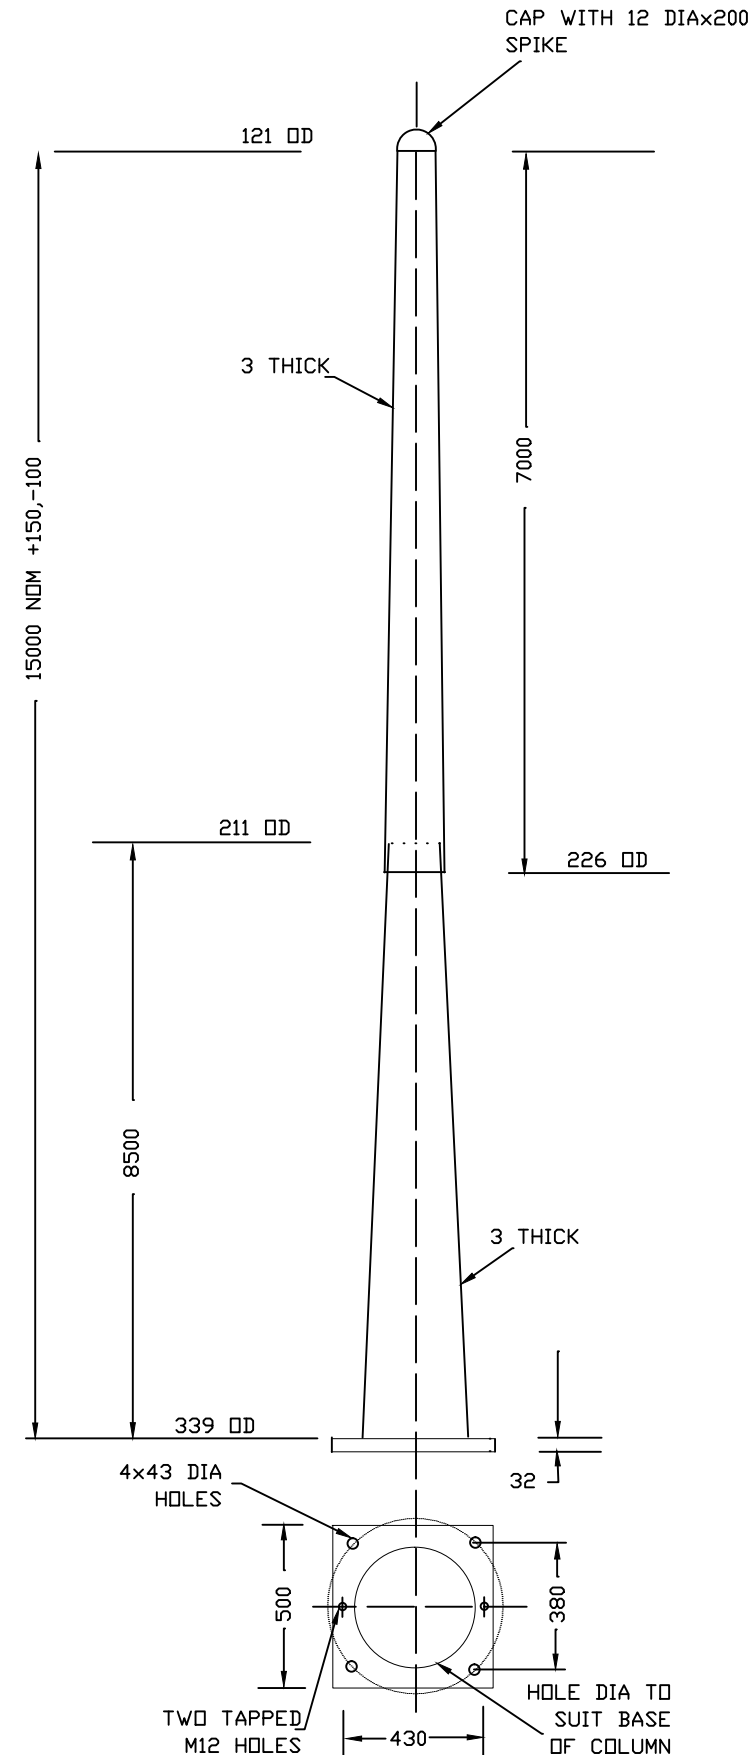

NOTES

1. DIMENSIONS EXTRACTED FROM ECNSW DRAWING S3G132-215. COMMON BASE PLATE IS USED
2. STEEL PLATES TO CONFORM TO AS3678
3. ALL WELDS TO CONFORM TO AS1554-1.
4. ALL STEEL ITEMS TO BE HOT DIP GALVANIZED AFTER FABRICATION TO CONFORM TO AS4680.
- 5 ALL SHARP EDGES AND BURRS TO BE REMOVED.
6. IDENTIFICATION PLATE INFORMATION EITHER ENGRAVED OR SIMILAR PERMANENT MARKING CONFORM TO AS/NZS4677. CHARACTERS TO BE A MIN 5mm HIGH.

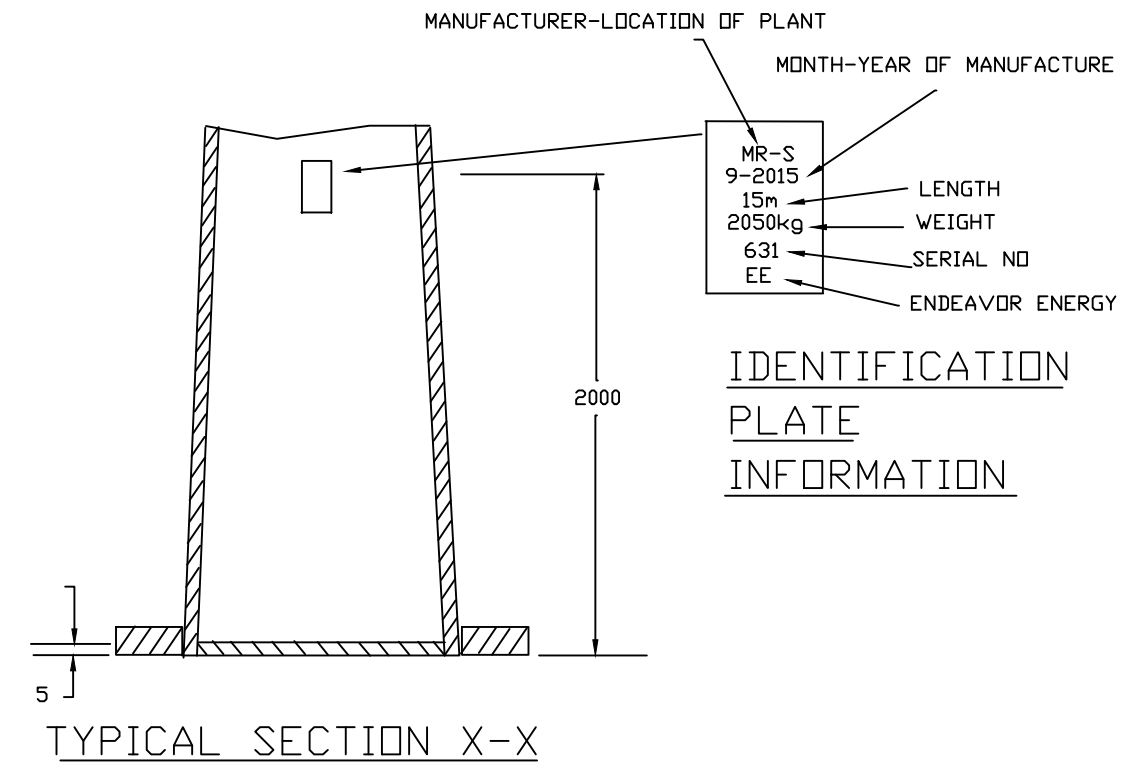

		© This drawing and the copyright therein is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.		 Endeavour Energy		FOOTING AND EARTHING FOR LIGHTNING MAST 20m/15m		397979			
 ORIGINAL SCALE SHOWN		APPROVED S.L.EWIS		LIGHTNING PROTECTION MAST 20m AND 15m		DO NOT SCALE DIMENSIONS IN MILLIMETRES		REFERENCE DRAWINGS			
DRAWN GA						AUTHORISED J.PERERA					
DATE 28/1/15						MANAGER PRIMARY SYSTEMS		29/1/15			
CH'D KS						A1		397978		A	
										SHEET No 1 OF 1 SHEETS	