
| AMENDMENTS | |
|---|---|
| A | ORIGINAL ISSUE |
| J R No. | NA |
| B — DR'N | C.R.T. |
| B — CH'D | C.R.T. |
| B — DATE | 13-8-97 |
| B — JR No | 970059 |
| (NOMINAL) ADDED TO TRENCH DEPTH. | |
| MPDO | CHB |

## NOTES

1. TRENCH LOCATED FROM KERB SUBJECT TO VARIATION DUE TO EXISTING SERVICES.

2. TRENCH CROSS-SECTION COMPLIES WITH RTA-SPECIFICATION 1258A.

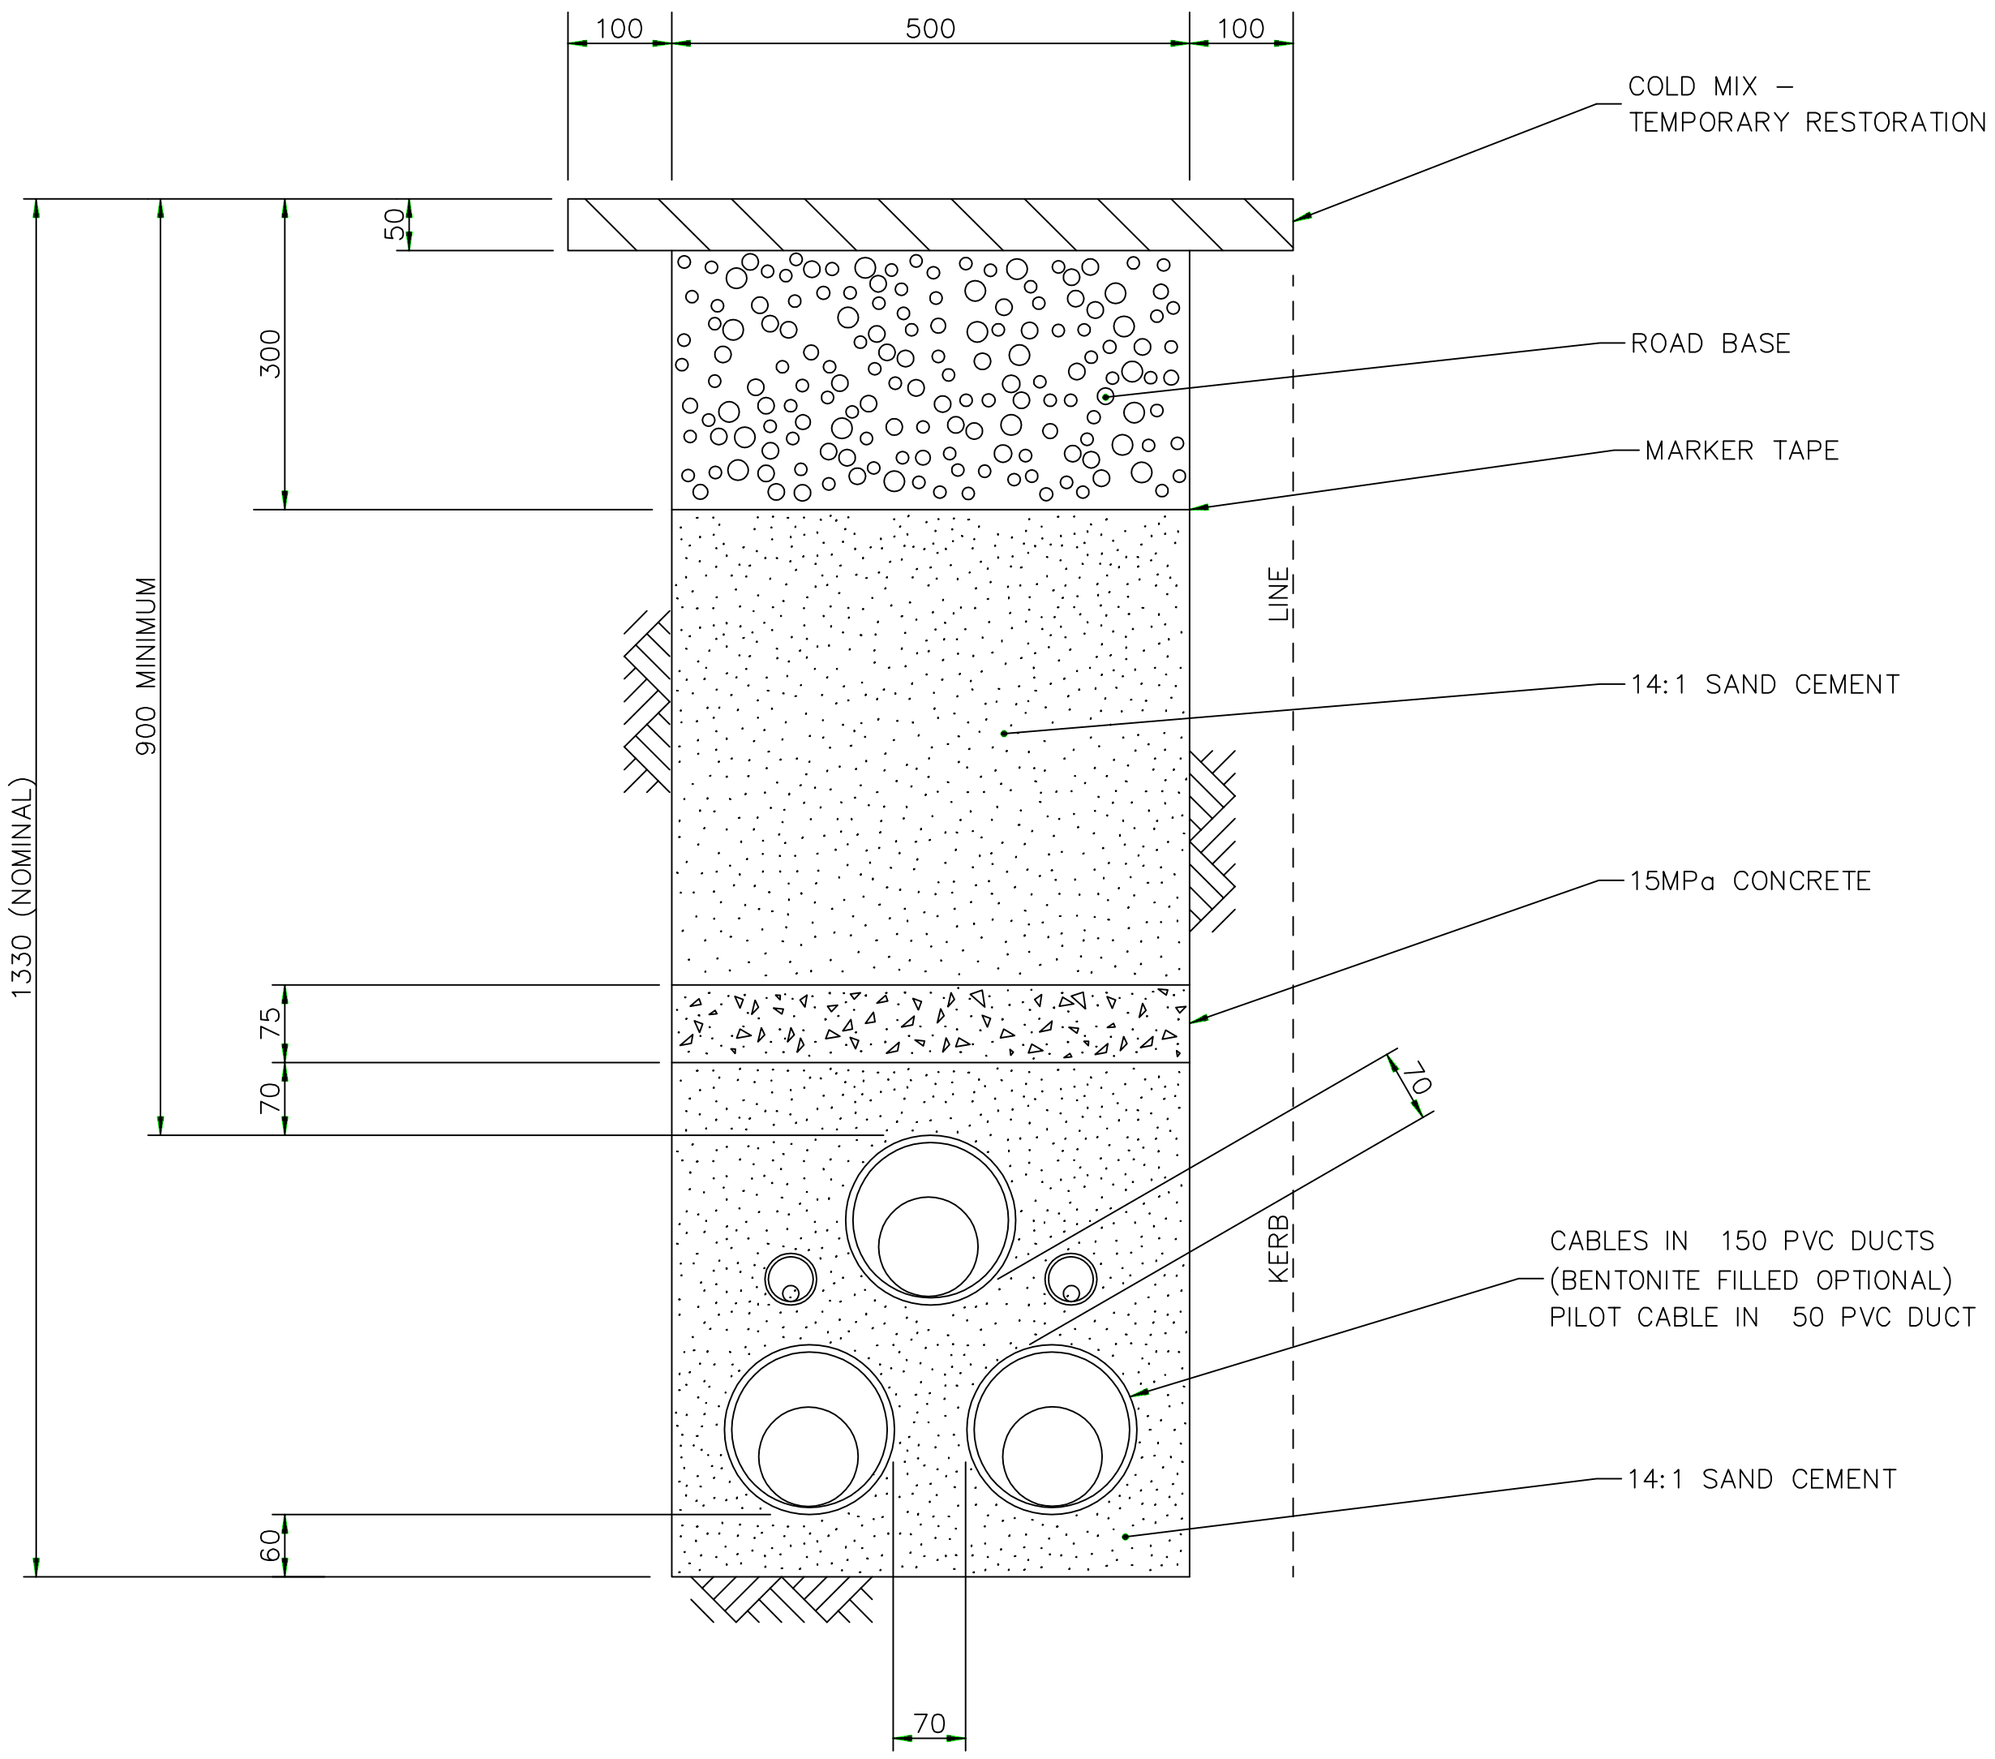


© This drawing and the copyright therin is the property of Endeavour Energy and may not be copied, reproduced, distributed, loaned or used without the written consent of Endeavour Energy.

Endeavour Energy

| | | | |
|---|---|---|---|
| ORIGINAL SCALE 1:6 | | APPROVED C.Brown | |
| DRAWN | C.R.T. | | |
| DATE | 23-8-96 | | |
| CH'D | C.R.T. | | |

REFERENCE DRAWINGS

DO NOT SCALE
DIMENSIONS IN MILLIMETRES

AUTHORISED
W.Isley
MAN'S DEVELOPMENT MANAGER 12-09-96

# 132KV UNDERGROUND CABLES INSTALLATION TRENCH CROSS-SECTION FOR ROADWAY INSTALLATION

A2P 240868 B

SHEET No 1 OF 1 SHEETS